



- NOTES**
1. TANK BUILT IN ACCORDANCE OF UL 142, UL 2085, AND STI F941 STANDARD AND LABELED AS SUCH.
 2. ALL MATERIAL IS CARBON STEEL, 10 GAUGE PRIMARY TANK, 10 GAUGE SECONDARY TANK.
 3. TANK EXTERIOR TO RECEIVE SSPC-SP6/NACE #3 SANDBLAST AND ONE COAT OF CHEMLINE CHEMTHANE 3107 (WHITE) ACRYLIC POLYURETHANE AT 5-6 MILS DFT.
 4. APPROXIMATE WEIGHT OF TANK IS 2,604 LBS.

IMPORTANT NOTE		CUSTOMER APPROVAL REQUIRED		 SOUTHERN Tank & Mfg Co 800-876-2321	FOR		CUSTOMER ORDER NO. 4500599280	FIREGUARD	DRAWING DESCRIPTION GENERAL ARRANGEMENT 550 GALLON CYLINDRICAL FIREGUARD			
IF POSSIBLE, REVIEW THIS DRAWING WITH YOUR CONTRACTOR. OF SPECIFIC IMPORTANCE, DOES THE TANK HAVE THE NECESSARY FITTINGS FOR THE EQUIPMENT YOU PLAN TO INSTALL		<input type="checkbox"/> MAKE NOTED CHANGES AND RE-SUBMIT <input type="checkbox"/> APPROVED WITH CHANGES NOTED <input type="checkbox"/> APPROVED AS DRAWN			DRAWN BY D. HIGDON		CHECKED BY		QUANTITY ONE	DATE 5-2-17	DRAWING FILE 88665-1	SHEET 1 OF 3
SIGNATURE _____ DATE _____												

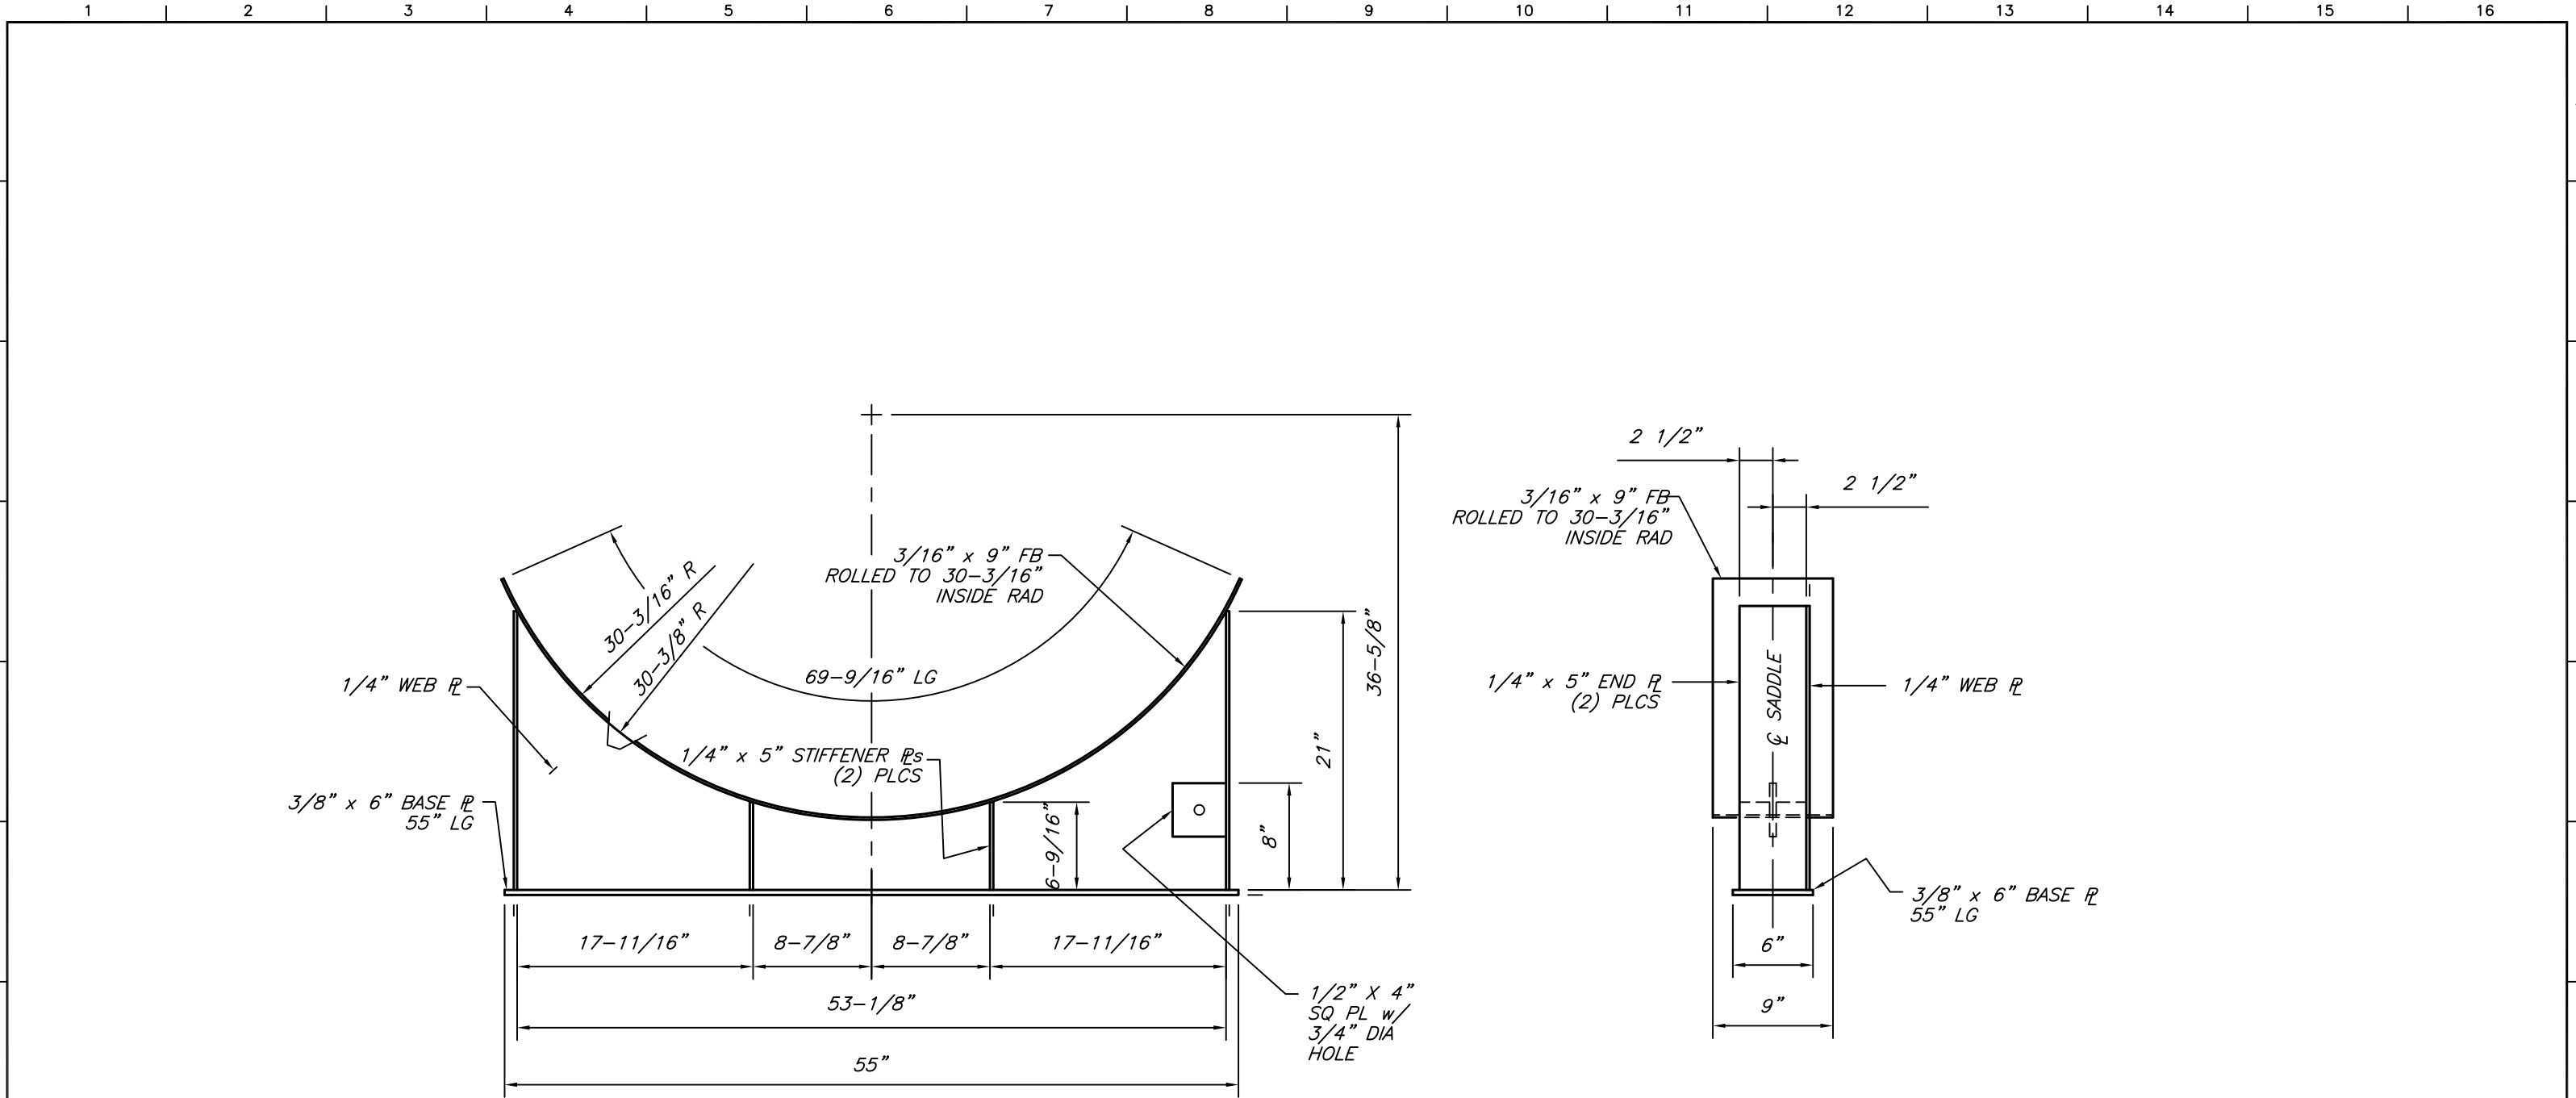

- NOTES**
- SADDLES BUILT IN ACCORDANCE WITH S.T.I. MANUFACTURING PROCEDURE FOR FIREGUARD, SEC. 2.6, TABLE 2.6.1.2, FIGURE 2.6.1.2A REV. 5/12.
 - ALL MATERIAL CARBON STEEL.
 - NOMINAL WEIGHT (1) SADDLE: 130 LBS.
 - SADDLES TO BE WELDED TO TANK.

IMPORTANT NOTE IF POSSIBLE, REVIEW THIS DRAWING WITH YOUR CONTRACTOR. OF SPECIFIC IMPORTANCE, DOES THE TANK HAVE THE NECESSARY FITTINGS FOR THE EQUIPMENT YOU PLAN TO INSTALL				CUSTOMER APPROVAL REQUIRED <input type="checkbox"/> MAKE NOTED CHANGES AND RE-SUBMIT <input type="checkbox"/> APPROVED WITH CHANGES NOTED <input type="checkbox"/> APPROVED AS DRAWN SIGNATURE _____ DATE _____				 SOUTHERN Tank & Mfg Co 800-876-2321				FOR _____ DRAWN BY <u>D. HIGDON</u> CHECKED BY _____ DATE <u>5-2-17</u>		CUSTOMER ORDER NO. <u>4500599280</u> QUANTITY <u>TWO</u>		DRAWING DESCRIPTION GENERAL ARRANGEMENT 60" DIAMETER SADDLE			
												DRAWING FILE <u>88665-2</u>		SHEET <u>2 OF 3</u>		REVISION 			

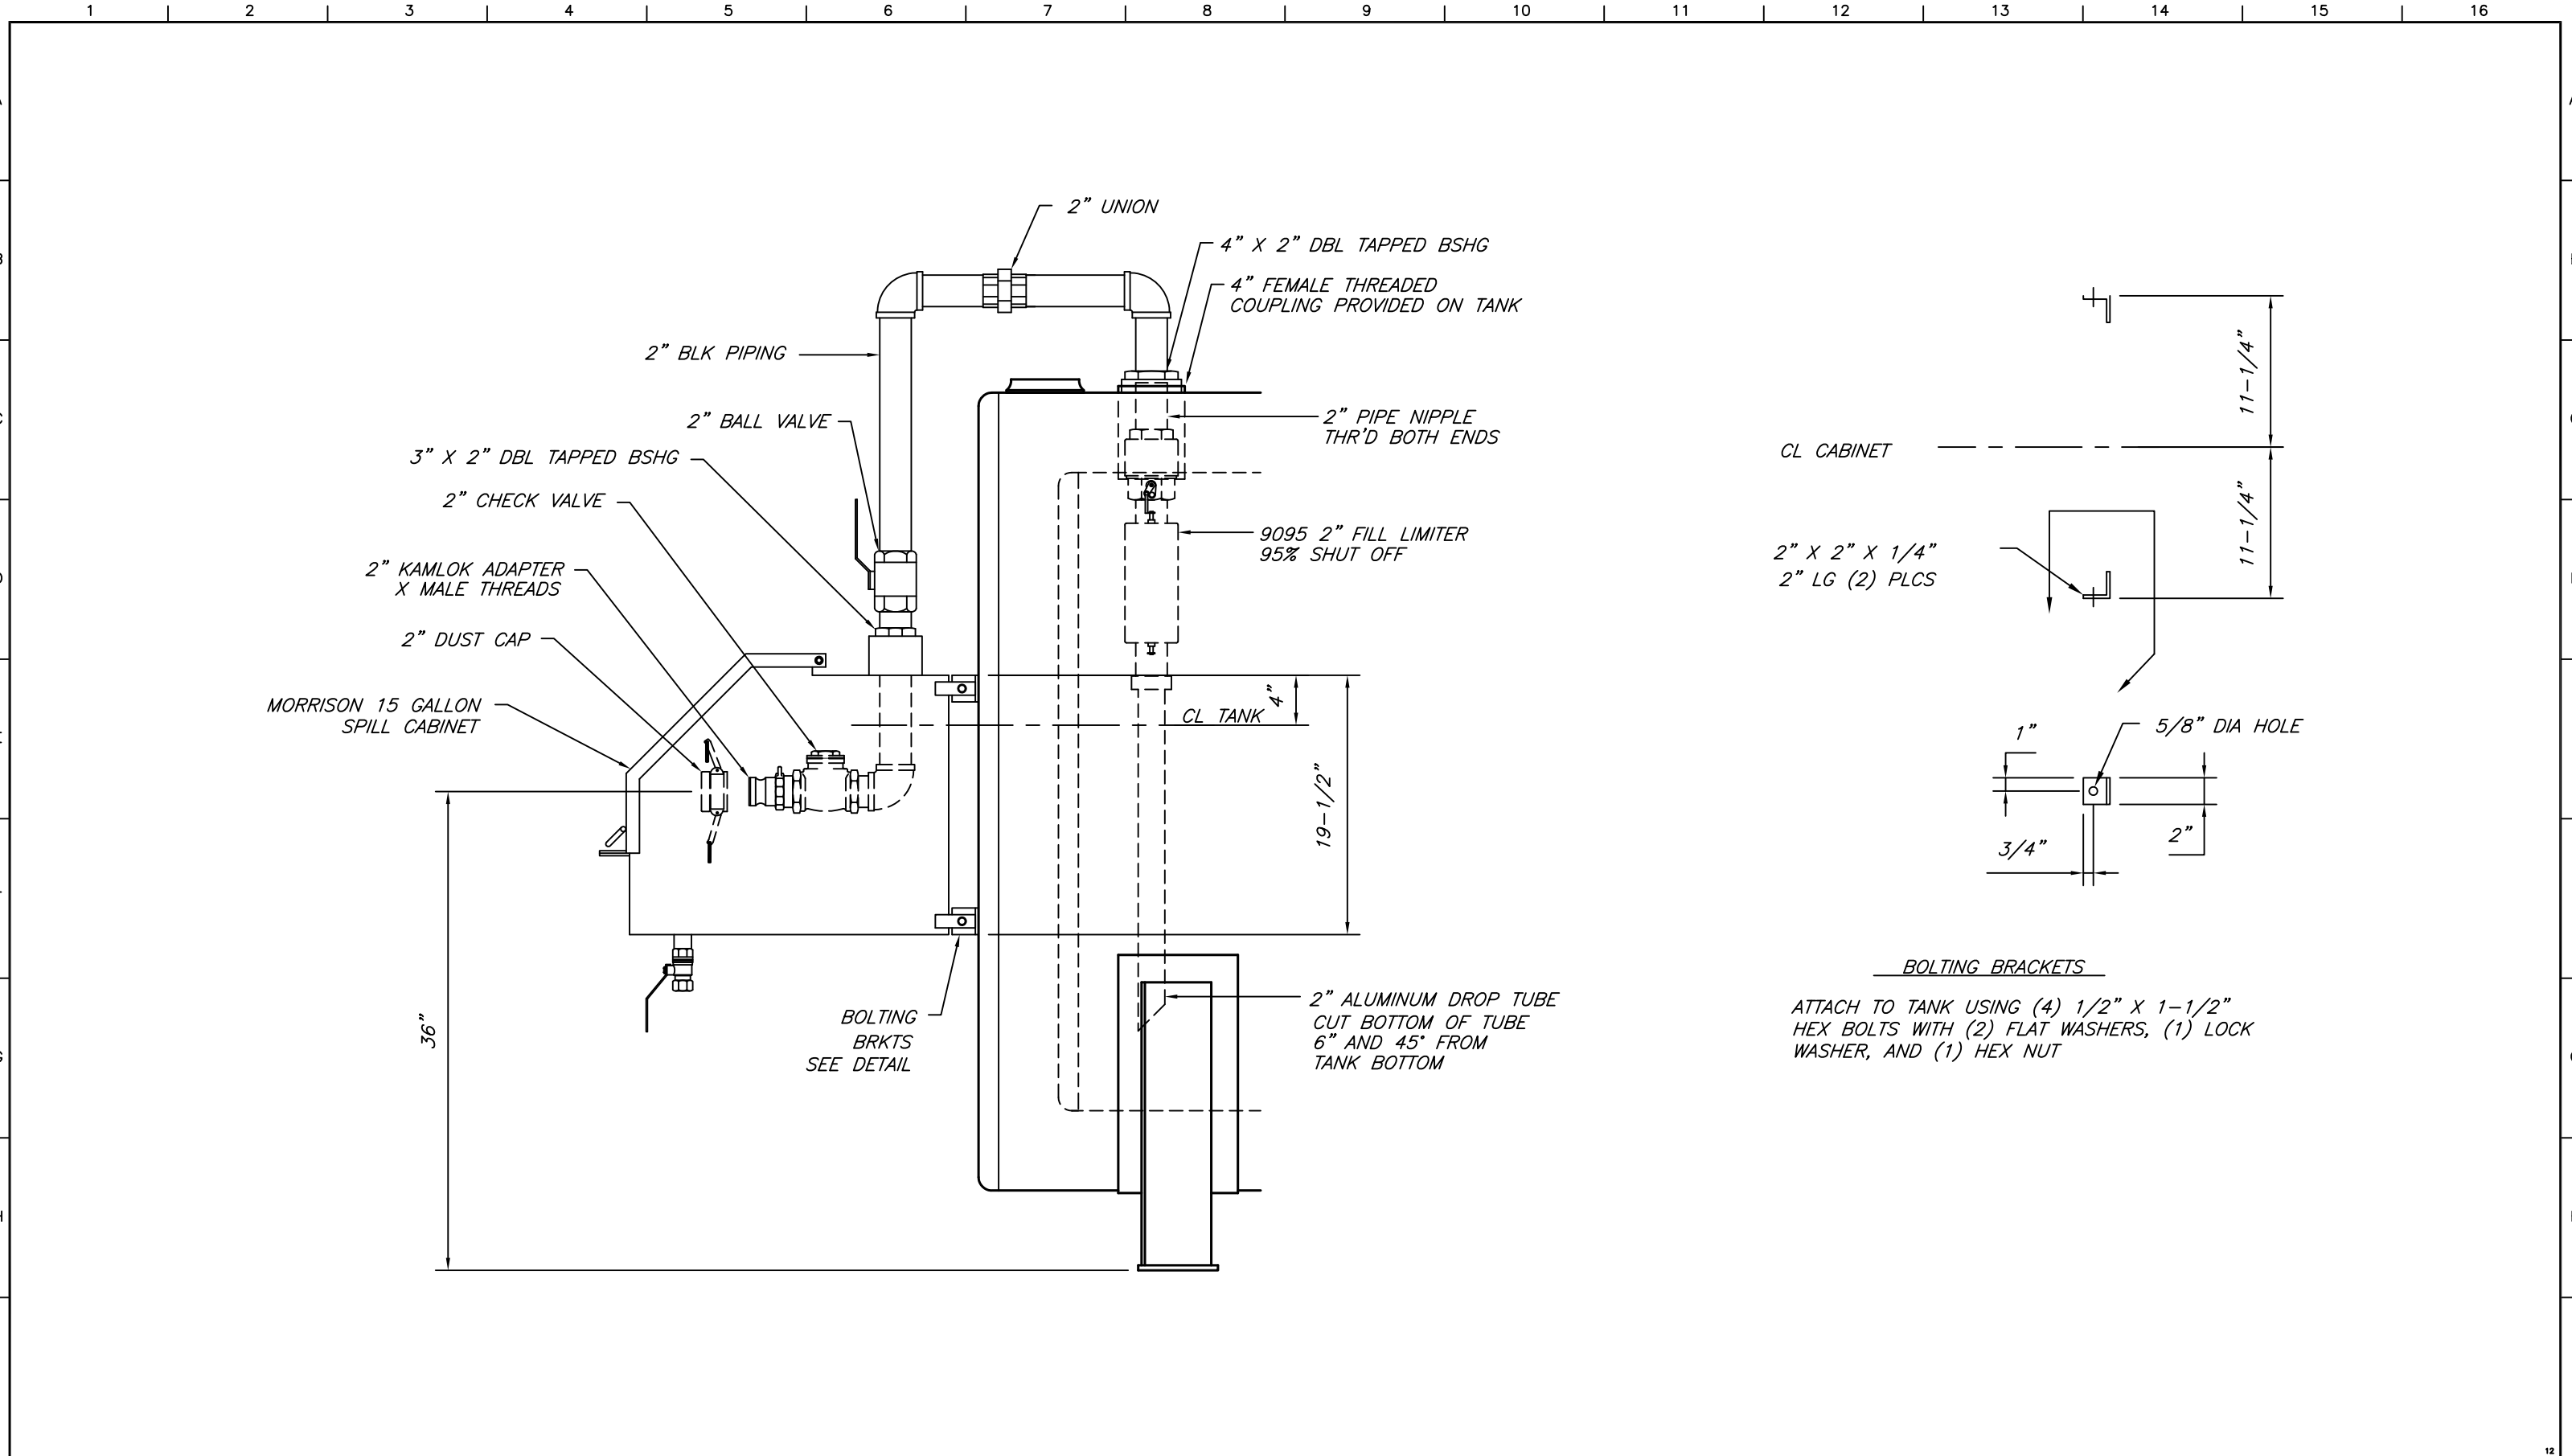

IMPORTANT NOTE				CUSTOMER APPROVAL REQUIRED				<div></div> <div>SOUTHERN Tank & Mfg Co 800-876-2321</div>				FOR				CUSTOMER ORDER NO. 4500599280		DRAWING DESCRIPTION GENERAL ARRANGEMENT 2" GROUND LEVEL LOAD			
IF POSSIBLE, REVIEW THIS DRAWING WITH YOUR CONTRACTOR. OF SPECIFIC IMPORTANCE, DOES THE TANK HAVE THE NECESSARY FITTINGS FOR THE EQUIPMENT YOU PLAN TO INSTALL				<input type="checkbox"/> MAKE NOTED CHANGES AND RE-SUBMIT <input type="checkbox"/> APPROVED WITH CHANGES NOTED <input type="checkbox"/> APPROVED AS DRAWN								QUANTITY ONE		DATE 5-2-17							
SIGNATURE _____ DATE _____								DRAWN BY D. HIGDON		CHECKED BY				DRAWING FILE 88665-3		SHEET 3 OF 3		REVISION 			

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16