

INDEX TO DRAWINGS

SITE

SS1.0 SITE SURVEY
DS1.0 SITE DEVELOPMENT PLAN
SD1.0 OVERALL SITE DEVELOPMENT PLAN
SD1.1 SITE DEVELOPMENT PLAN ENLARGEMENT 1
SD1.2 SITE DEVELOPMENT PLAN ENLARGEMENT 2
SD1.3 SITE DEVELOPMENT PLAN ENLARGEMENT 3
SD2.0 OVERALL SITE GRADING AND DRAINAGE PLAN
SD3.0 SITE DETAILS
SD3.1 SITE DETAILS
SD3.2 SITE DETAILS
SD3.3 SITE DETAILS

STRUCTURAL

S1.1 FOUNDATION PLAN ATHLETIC BUILDING
S1.2 MEZZANINE FRAMING PLAN ATHLETIC BUILDING
S1.3 ROOF FRAMING PLAN ATHLETIC BUILDING
S1.4 FOUNDATION PLAN ACADEMIC BUILDING
S1.5 ROOF FRAMING PLAN ACADEMIC BUILDING
S2.0 TYPICAL FOUNDATION DETAILS & FOUNDATION SCHEDULES
S2.1 FOUNDATION SECTIONS AND DETAILS
S3.0 TYPICAL BAR JOIST, METAL DECK AND STEEL FRAMING DETAILS, STEEL BEAM SCHEDULE
S3.1 TYPICAL STEEL FRAMING DETAILS
A4.0 MASONRY HEADER BEAM SCHEDULE, TYPICAL MASONRY DETAILS
S4.1 TYPICAL MASONRY DETAILS
S4.2 TYPICAL MASONRY DETAILS MODIFYING EXISTING MASONRY
S5.1 MECHANICAL PLATFORM, STRUCTURAL STEEL FRAMING SECTIONS AND DETAILS
S6.1 STRUCTURAL STEEL + LIGHT - GAUGE METAL TRUSSES SECTIONS AND DETAILS
S6.2 OPEN-WEB STEEL BAR JOIST ROOF FRAMING SECTIONS AND DETAILS
S6.3 STRUCTURAL STEEL + LIGHT-GUAGE METAL TRUSSES SECTIONS AND DETAILS

ARCHITECTURAL

N1.1 WALL/ PARTITION TYPES AND ABBREVIATIONS
A1.1 FLOOR PLANS & DETAILS
A1.2 ROOF PLAN, REFLECTED CEILING PLAN & DETAILS
A1.3 ENLARGED PLANS & DETAILS
A1.4 BUILDING ELEVATIONS, BUILDING SECTIONS & DETAILS
A1.5 DOOR & WINDOW FRAME TYPES, DOOR TYPES AND DOOR & FRAME SCHEDULE
A2.1 FIRST FLOOR PLAN, ROOF PLAN AND DETAILS
A2.2 DOOR SCHEDULE, DOOR & FRAME TYPES AND DETAILS
A2.3 BUILDING ELEVATIONS, SECTIONS AND DETAILS

M.E.P.

SITE UTILITIES

SU1.1 PLUMBING SITE UTILITIES PLAN

MECHANICAL

M1.1 FIRST FLOOR PLAN -HVAC
M1.2 HIGH SCHOOL - FIRST FLOOR PLAN - HVAC
M4.1 MECHANICAL DETAILS

ELECTRICAL

E1.1 FIRST FLOOR PLAN - LIGHTING
E1.2 HIGH SCHOOL - FIRST FLOOR PLAN - LIGHTING
E2.1 ATHLETIC - FIRST FLOOR PLAN - POWER & SYSTEMS
E3.1 ELECTRICAL LEGEND
E3.2 ELECTRICAL DETAILS
E3.3 ELECTRICAL RISER DIAGRAM & SCHEDULES

PLUMBING

P1.1 FIRST FLOOR PLANS - PLUMBING
P3.1 LEGEND, GENERAL NOTES, & SCHEDULES - PLUMBING
P3.2 PLUMBING DETAILS

SPENCER COUNTY HIGH SCHOOL
ACADEMIC AND ATHLETICS BUILDING


BG# 17-236

APRIL 23, 2018

OWNER:

SPENCER COUNTY BOARD OF EDUCATION

CHUCK ADAMS - SUPERINTENDENT
BART STARK - BOARD MEMBER
JANET BONHAM - BOARD MEMBER
LYNN SHELburnE - BOARD MEMBER
SANDY CLEVenger - MEMBER
DEBBIE HERNDON- MEMBER

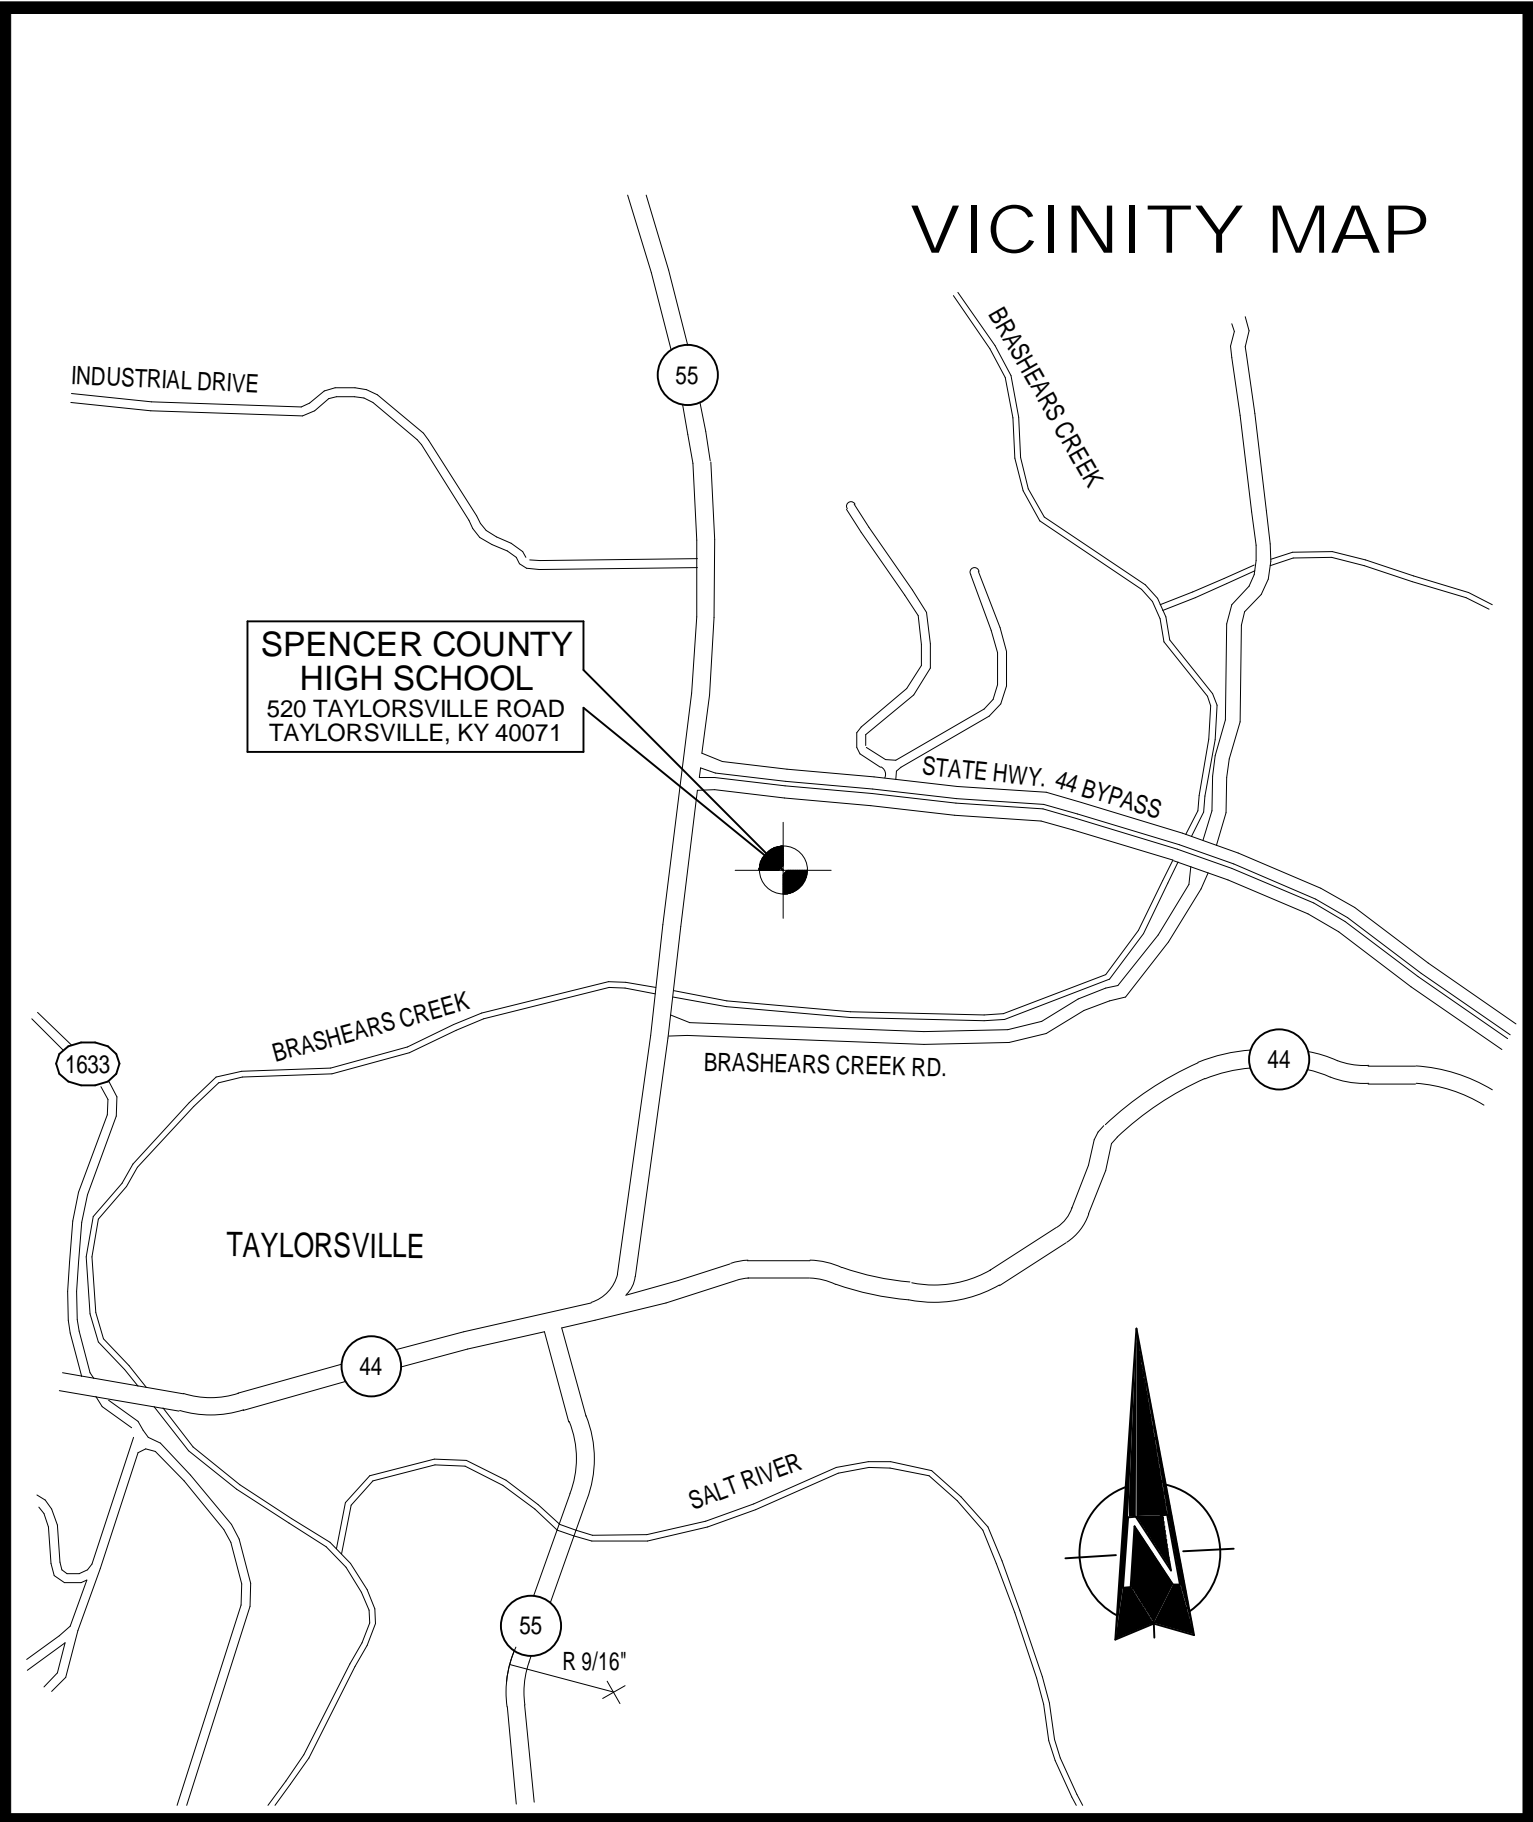

SHERMAN CARTER BARNHART
ARCHITECTS, PLLC

2405 HARRODSBURG ROAD
LEXINGTON, KY 40504-3329
PHONE: 859.224.1351
FAX: 859.224.8446

www.scbarchitects.com

CIVIL ENGINEER





SHERMAN CARTER BARNHART
2405 HARRODSBURG RD.
LEXINGTON, KY 40504
P (859) 224-1351 F (859) 224-8446

STRUCTURAL ENGINEER

SHERMAN CARTER BARNHART
9300 SHELBYVILLE ROAD, SUITE #502
LOUISVILLE, KY 40222
P (502) 721-6100 F (859) 721-6111

MECHANICAL/ELECTRICAL ENGINEER

SHROUT TATE WILSON
CONSULTING ENGINEERS
628 WINCHESTER RD.
LEXINGTON, KY 40505
P (859) 277-8177 F (000) 555-5555



SCB PROJECT NO.

JOB NO.	1744, BG#17-236
DATE	APR 23, 2018
DRAWN	BA
CHECKED	JMc (P.I.C.)

COPYRIGHT © 2018
SHERMAN CARTER BARNHART
ARCHITECTS, PLLC

REVISIONS		
No.	Description	Date

SHEET

C0.1

ENERGY CODE - 90.1 (2010) COMPLIANCE DATA

BUILDING ENVELOPE COMCHECK MODEL - PASS BY 12%

SCHOOL OCCUPANT LOADS (TABLE 1004.1.2)

TRAINING ROOM / WHIRLPOOL
50 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 6 OCCUPANTS FOR 272 SQ. FT.

STORAGE ROOMS
300 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 4 OCCUPANTS FOR 942 SQ. FT. TOTAL (5 STORAGE ROOMS TOTAL)

CONCESSIONS
200 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 4 OCCUPANTS FOR 608 SQ. FT.

HEALTH & WELLNESS (WEIGHT TRAINING)
50 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 28 OCCUPANTS FOR 1,353 SQ. FT.

FOOTBALL LOCKER ROOM
50 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 34 OCCUPANTS FOR 1,653 SQ. FT. (INCLUDES RESTROOMS & SHOWERS)

MDF / IDF ROOM
300 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 1 OCCUPANT FOR 130 SQ. FT.

COACHES OFFICES
100 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 7 OCCUPANTS FOR 660 SQ. FT. TOTAL (3 OFFICE SPACES)

LAUNDRY ROOM
50 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 3 OCCUPANTS FOR 119 SQ. FT.







CLASSROOM
20 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 65 OCCUPANTS FOR 1,282 SQ. FT.

PUBLIC RESTROOMS
FIXED FIXTURE COUNT (4 FIXTURES, 2 SINKS) = 6 OCCUPANTS PER RESTROOM (TWO PUBLIC RESTROOMS)
MAXIMUM CALCULATED OCCUPANCY = 12 OCCUPANTS TOTAL (FOR BOTH RESTROOMS)





GIRL'S & BOY'S LOCKER ROOMS (COMBINED)
50 SQ. FT. PER OCCUPANT (TABLE 1004.1.2)
MAXIMUM CALCULATED OCCUPANCY = 38 OCCUPANTS FOR 1,856 SQ. FT. TOTAL (INCLUDES RESTROOMS & SHOWERS)

TOTAL MAXIMUM CALCULATED OCCUPANT LOAD = 202 OCCUPANTS

MINIMUM FIRE RESISTANCE RATINGS

RECORDS ROOM ENCLOSURE	 - 2 HR. KDC REQUIREMENT,	 - 2 HR. HORIZONTAL ASSEMBLY
ELEVATOR & ELEV. MACHINE ROOM ENCLOSURE	 - 1 HR. KBC SECTIONS 713.4 & 3006.4,	 - 1 HR. HORIZONTAL ASSEMBLY
BOOKSTORE/STORAGE BELOW STAIR	 - 1 HR. KBC SECTION 1009.9.3	 - 1 HR. HORIZONTAL ASSEMBLY
UNENCLOSED EXIT ACCESS STAIR ENCLOSURES (1009.3)	- 0 HR. RATING (KBC SECTION 1009.3; EXCEPTION NO. 1)	
STRUCTURAL FRAME	- 0 HR. RATING (KBC TABLE 601)	
INTERIOR BEARING & NON-BEARING WALLS	- 0 HR. RATING (KBC TABLE 601)	
ROOF CONSTRUCTION	- 0 HR. RATING (KBC TABLE 601)	
EXTERIOR WALLS	- 0 HR. RATING (KBC TABLE 602; FIRE SEPARATION DISTANCE GREATER THAN 10')	

UL ASSEMBLY RATINGS

6" CMU WALL	 UL NO. <u>U906</u> 1HR FIRE BARRIER
6" CMU WALL	 UL NO. <u>U905</u> 2HR FIRE BARRIER
6" HOLLOW CORE CONC. PLANK W/ 2" LIGHTWEIGHT CONC. TOPPING SLAB	 UL NO. <u>J901</u> 1HR HORIZ. ASSEMBLY
1" FIRE RATED GYPSUM WALL BOARD SHIRT LINER PANEL, 4" CH METAL STUDS, (2) LAYERS 5/8" FIRECODE TYPE "C" CLG. BD.	 UL NO. <u>WH-438</u> 2HR HORIZ. ASSEMBLY

SPENCER CO. HIGH SCHOOL ACADEMIC AND ATHLETIC BUILDING

GENERAL INFORMATION :

CODE: KENTUCKY BUILDING CODE (2013, 4TH EDITION)
USE GROUP: E (EDUCATIONAL GROUP - (FIELDHOUSE))
CAPACITY: REFER TO OCCUPANCY CALCULATIONS
CONSTRUCTION TYPE: TYPE II B (NON-COMBUSTIBLE)
FIRE PROTECTION: NOT SPRINKLERED
FIRE BARRIERS: (SEE MINIMUM FIRE RESISTANCE RATINGS BELOW)
DEAD END CORRIDORS: 50 FEET MAX, OR LESS THAN 2.5 TIMES LEAST CORRIDOR WIDTH (SECTION 1018.4; EXCEPTIONS 2 & 3)
COMMON PATH OF EGRESS TRAVEL: 75 FEET MAX (SECTION 1014.3)

BUILDING HEIGHT CALCULATIONS :

ALLOWABLE HEIGHT = 2 STORIES / 55'-0" (PER TABLE 503; TYPE II B)
SPRINKLER INCREASE = 0 STORIES / 0'-0" (PER SECTION 504.2)
TOTAL ALLOWABLE HEIGHT = 2 STORIES / 55'-0"
ACTUAL BUILDING HEIGHT = 1 STORY / 23'-6"

ALLOWABLE AREA CALCULATIONS :

FRONTAGE INCREASE : (SECTION 506.2) $I_f = \left[\frac{E}{P} - 25 \right] \frac{W}{30}$
 $I_f = 25$
SPRINKLER INCREASE : (SECTION 506.3) $I_g = 0$ (NOT SPRINKLERED)

ALLOWABLE AREA PER STORY: $A_1 = 14,500$ SQ. FT. (PER TABLE 503) (TABLE 503)

ALLOWABLE AREA TOTAL: (SECTION 506.1) $A_a = A_1 + \left[A_1 \times I_f \right] + \left[A_1 \times I_g \right]$

ALLOWABLE AREA TOTAL: $A_a = 14,500 + \left[14,500 \times 25 \right] + \left[14,500 \times 0 \right]$

$A_a = 14,500 + 3,625 = 0$
 $A_a = 18,125$ SQUARE FEET (TOTAL ALLOWABLE) / FLOOR

ACTUAL AREA CALCULATIONS:

(TOTAL TABULATIONS PER FLOOR PLAN @ RIGHT)

FLOOR PLAN:
BUILDING AREA (MEASURED TO OUTSIDE OF WALLS) 11,167 SQ. FT.
COVERED STRUCTURED OVERHANGS (INCLUDING BREEZEWAY) + 2,618 SQ. FT.
TOTAL BUILDING AREA 13,785 SQ. FT.

TRAVEL DISTANCES:

TRAVEL DISTANCE TO EXIT: _____
ACTUAL MAXIMUM TRAVEL DISTANCE: 214 FT. (AT SECOND FLOOR PLAN)
(MAXIMUM ALLOWABLE TRAVEL DISTANCE: 250 FT. (PER TABLE 1016.2))

SPECIAL INSPECTIONS PER CHAPTER 17 OF THE KENTUCKY BUILDING CODE

IN ADDITION TO OTHER TESTING AND INSPECTION REQUIRED TO BE PROVIDED BY THE CONTRACTOR PER THE TECHNICAL SPECIFICATIONS, THE OWNER SHALL PROVIDE QUALIFIED THIRD - PARTY INSPECTORS FOR SPECIAL INSPECTIONS AS FOLLOWS:

SECTION	ITEM	REQUIRED?		REMARKS
		YES	NO	
1704.2.5	FABRICATORS	<u>X</u>	___	PER SECTION 1704.2.5
1704.5.1	STRUCTURAL OBSERVATION FOR SEISMIC REQUIREMENTS	___	<u>X</u>	SEISMIC DESIGN CATEGORY "C"
1704.5.2	STRUCTURAL OBSERVATION FOR WIND REQUIREMENTS	___	<u>X</u>	V ₅₀ = 72 MPH (5x120)
1705.2	STEEL	<u>X</u>	___	PER AISC 360 & TABLE 1705.2.2
1705.3	CONCRETE	<u>X</u>	___	PER TABLE 1705.3
1705.4	MASONRY	<u>X</u>	___	LEVEL B TMS 402/ ACI 530/ ASCE 5
1705.5	WOOD	___	<u>X</u>	NONE
1705.6	SOILS	<u>X</u>	___	PER TABLE 1705.6
1705.7	DRIVEN DEEP FOUNDATIONS	___	<u>X</u>	NONE
1705.8	CAST IN PLACE DEEP FOUNDATIONS	___	<u>X</u>	NONE
1705.9	HELICAL PILE FOUNDATION	___	<u>X</u>	NONE
1705.10.1	WIND - STRUCTURAL WOOD	___	<u>X</u>	NONE
1705.10.2	WIND - COLD FORMED STEEL FRAMING	___	<u>X</u>	NONE
1705.10.3	WIND - WIND RESISTING COMPONENTS	___	<u>X</u>	NONE
1705.11.1	SEISMIC - STRUCTURAL STEEL	___	<u>X</u>	NONE
1705.11.2	SEISMIC - STRUCTURAL WOOD	___	<u>X</u>	NONE
1705.11.3	SEISMIC - COLD FORMED STEEL FRAMING	___	<u>X</u>	NONE
1705.11.4	DESIGNATED SEISMIC SYSTEMS	___	<u>X</u>	NONE
1705.11.5	SEISMIC - ARCHITECTURAL COMPONENTS- INTERIOR/EXTERIOR NON-LOAD BEARING WALLS AND VENEER IN STRUCTURES	___	<u>X</u>	SEISMIC DESIGN CATEGORY "C"
1705.11.6	SEISMIC - MECHANICAL AND ELECTRICAL COMPONENTS	___	<u>X</u>	AS REQUIRED FOR SEISMIC DESIGN CATEGORY "C" NO HAZARD MATERIALS
1705.11.7	SEISMIC - STORAGE RACKS AND ACCESS FLOORS	___	<u>X</u>	NONE
1705.13	SPRAYED FIREPROOFING	___	<u>X</u>	NONE
1705.14	MASTIC INTUMESCENT COATING	___	<u>X</u>	NONE
1705.15	EIFS	___	<u>X</u>	NONE
1705.16	FIRE RESISTANT PENETRATIONS & JOINTS	___	<u>X</u>	NONE
1705.17	SMOKE CONTROL	___	<u>X</u>	NONE

REFER TO SHEET S0.1 THROUGH S0.3 FOR ADDITIONAL INFORMATION REGARDING SPECIAL INSPECTIONS FOR STRUCTURAL COMPONENTS.

SEISMIC DESIGN CRITERIA

SOURCE: 2013 KENTUCKY BUILDING CODE (KBC), 4TH EDITION
SEISMIC RISK CATEGORY: III
SEISMIC DESIGN CATEGORY: C
SDS: 0.222
SDI: 0.097
SEISMIC SITE CLASS: B
BASIC SEISMIC-FORCE RESISTING SYSTEM: ORDINARY REINFORCED CONCRETE SHEAR WALLS
SEISMIC ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE METHOD (E.L.F.M.)

SEE STRUCTURAL DRAWINGS FOR ADDITIONAL SEISMIC INFORMATION AND STRUCTURAL DESIGN LOAD INFORMATION.

SYMBOL LEGEND

A

FACE BRICK /
1 1/4" AIR SPACE /
1 1/2" RIGID INSULATION /
BITUMINOUS DAMPPROOFING /
8" (NOM.) CMU

B

FACE BRICK /
AIR SPACE /
BITUMINOUS DAMPPROOFING /
8" (NOM.) CMU

C

FACE BRICK /
AIR SPACE /
BITUMINOUS DAMPPROOFING /
4" (NOM.) CMU

D

FACE BRICK /
AIR SPACE /
BITUMINOUS DAMPPROOFING /
8" (NOM.) CMU /
BITUMINOUS DAMPPROOFING /
AIR SPACE /
FACE BRICK

E

FACE BRICK /
1 1/4" AIR SPACE /
1 1/2" RIGID INSULATION /
BITUMINOUS DAMPPROOFING /
8" (NOM.) CMU /
BITUMINOUS DAMPPROOFING /
1 1/2" RIGID INSULATION /
1 1/4" AIR SPACE /
FACE BRICK

6" METAL STUD FRAMING @ 16" O.C. /
5/8" EXTERIOR GRADE GYP.
SHEATHING (BOTH SIDES) /
R-22 BATT INSULATION & SEALANT
AT FULL PERIMETER (TO TRUSSES)

F

★★ AT EXTERIOR, TYPE 'A' WALLS ★★
DESIGNATED WITH 'EX' (ABOVE).
ALSO SEE DETAIL 2, THIS SHEET

EXTERIOR WALL TYPES

1

8" (NOM.) CMU
(RATED ASSEMBLY
AS NOTED ON
FLOOR PLANS)

2

6" (NOM.) CMU
(RATED ASSEMBLY
AS NOTED ON
FLOOR PLANS)

3

3.5/8" METAL STUD FRAMING @ 16" O.C. /
5/8" GYP. BD. (BOTH SIDES) /
SOUND ATTN. INSULATION /
(BRACE STUDS TO TRUSSES)

★★ AT INTERIOR WALL TYPES
DESIGNATED WITH 'EX' (ABOVE).
ALSO SEE DETAIL 2, THIS SHEET

INTERIOR WALL TYPES

ROOM SIGNAGE SCHEDULE

C

SIGN DETAIL
3" = 1'-0"

B

SIGN DETAIL
3" = 1'-0"

A

SIGN DETAIL
3" = 1'-0"

E

SIGN DETAIL
3" = 1'-0"






























D

SIGN DETAIL
3" = 1'-0"

SIGNAGE GENERAL NOTES

- CHARACTERS SHOWN ON THIS SHEET ARE COMPUTER GENERATED. SPACING OF CHARACTERS IS NOT ACCURATE. CORRECT "VISUAL" SPACING IS THE RESPONSIBILITY OF THE MFR.
- PICTOGRAMS ARE SHOWN HEREIN FOR INFORMATION AND INTENT ONLY.
- MECHANICAL, CAMERA-READY ARTWORK SHALL BE SUPPLIED BY THE SIGNAGE CONTRACTOR.
- COLORS OF PANEL SIGNS TO BE SELECTED BY ARCHITECT.
- UNLESS OTHERWISE NOTED, ALL SIGNS TO BE MOUNTED BESIDE DOORS AT 60" A.F.F. TO TOP OF SIGN AND 2" FROM EDGE OF DOOR FRAME ON THE LATCH SIDE. WHERE THERE IS NO WALL SPACE TO THE LATCH SIDE OF THE DOOR, INCLUDING AT DOUBLE LEAF DOORS, SIGNS SHALL BE PLACED ON THE NEAREST ADJACENT WALL. MOUNTING LOCATION FOR SUCH SIGNAGE SHALL BE SO THAT A PERSON MAY APPROACH WITHIN 3 FEET OF SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITHIN THE SWING OF A DOOR. THE ARCHITECT SHALL BE CONSULTED BEFORE PLACEMENT OF SIGNAGE FOR LEFTHAND AND RIGHTHAND ORIENTATION OF SIGNS.
- * = THREE CHARACTER NUMBER TO BE SUPPLIED BY ARCHITECT/OWNER.
- ALL SIGNAGE SHALL MEET THE CURRENT REQUIREMENTS OF ADAAG OF THE AMERICANS WITH DISABILITIES ACT (ADA).
- MESSAGE (COPY) TO BE DETERMINED BY ARCHITECT/OWNER.
- PROVIDE (30) EXTRA SIGNS TYPE 'E' FOR DIRECTIONAL SIGNAGE. OWNER TO SELECT LOCATION AND VERBAGE.
- UNLESS NOTED OTHERWISE, IF SIGNAGE OCCURS AT STRIKE SIDE OF DOOR ON A WINDOW, STOREFRONT, OR SIDEWALK, MOUNT SIGN AT 60" A.F.F. TO TOP OF SIGN (OR LOWER, DEPENDING ON MULLION) AND ON FACE OF GLASS. PROVIDE BLANK SIGN ON BACKSIDE OF GLASS, ALONG A MATCH COLOR.
- ALL SIGNS TO BE 8" X 8", U.N.O.
- ASSEMBLY SPACE SIGNAGE OCCUPANT LOAD NUMBER TO BE DETERMINED BY LOCAL

1. WHERE MORE THAN ONE FINISH IS LISTED REFER TO PLANS, SECTIONS, AND DETAILS.	
2. <u>SOFFIT PAINT TO BE ACCENT COLORS</u> UNLESS DIRECTED OTHERWISE BY ARCHITECT.	
3. REFER TO TYPICAL FLOOR TRANSITION / THRESHOLD DETAILS, SHEET A7.1.	
4. REFER TO REFLECTED CEILING PLAN, SHEET A1.2 FOR CEILING INFORMATION.	
5. REFER TO MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION AT CEILINGS.	
<p>P28 AT ALL GYPSUM BOARD OUTSIDE CORNERS EXTENDING TO FLOOR, INSTALL HIGH ABUSE RESILIENT CORNER GUARDS FROM 6\"/> </p>	
<p>P29 AT ALL EXPOSED GYPSUM BOARD NOT COVERED WITH BRICK OR CMU AS PART OF ANOTHER WALL TYPE TO BE MUD & TAPED MINIMUM, AND THEN PAINTED WHERE EXPOSED TO VIEW.</p>	
<p>P30 AT RATED GYPSUM ASSEMBLIES USE TYPE "X" GYP. BD., FULL HT.</p>	

	ROOM FINISH GROUPS (REFER TO SHEET No.01)
	ROOM NUMBER
	DOOR NUMBER (DOOR SCHEDULE SHEET A1.6)
	PLAN KEY NOTES (THIS SHEET)
	WALL / PARTITION TYPE (SCHEDULE SHEET No.1)
	WINDOW OR STOREFRONT TYPE (REFER TO FLOOR PLANS AND SCHEDULE SHEET A1.5)
	TOILET ACCESSORIES (SCHEDULE SHEET A1.3)
	ELEVATION KEY NOTE (SHEET A1.4)
	ROOF KEY NOTE (SHEET A1.2)
	CEILING PLAN KEY NOTE (SHEET A1.2)
	SIGNAGE KEY NOTE (SHEET No.1)
	WALL MOUNTED FIRE EXTINGUISHER (MOUNT CTR. LINE OF HANDLE AT 4'-0" A.F.F.)
	FIRE EXTINGUISHER CABINET (SEMI-RECESSED), REFER TO DETAILS 9 & 10, THIS SHEET.
	ROOM / WALL DESIGNATION FB1 1 HOUR FIRE BARRIER
	MARKER BOARD (MB), TACK BOARD (TB), TACK STRIP (TS) PROJECTION SCREEN (PS) AND/OR WALL PADS. REFER TO SPECS. MOUNT TOP OF BOARD AT 6'-8" A.F.F.
	CONTROL JOINT. REFER TO A1.1 - A1.3 FOR LOCATIONS. REFER TO EXTERIOR ELEVATIONS FOR EXTERIOR LOCATIONS.
	ELEVATION MARK
	DETAIL OR ENLARGED PLAN
	EXTERIOR OR INTERIOR ELEVATIONS
	PARTIAL SECTION OR DETAILS
	WALL OR BUILDING SECTION
	MARKER BOARD (MB), TACK BOARD (TB), TACK STRIP (TS) PROJECTION SCREEN (PS) AND/OR WALL PADS. REFER TO SPECS. MOUNT TOP OF BOARD AT 6'-8" A.F.F.
	CONTROL JOINT. REFER TO A1.1 - A1.3 FOR LOCATIONS. REFER TO EXTERIOR ELEVATIONS FOR EXTERIOR LOCATIONS.
	PROJECTION SCREEN. REFER TO FLOOR PLANS FOR LOCATIONS.
	CEILING MOUNTED PROJECTOR FOR PROJECTION SCREEN. PROJECTOR & MOUNT N.I.C. (BY OWNER) REFER TO REFLECTED CEILING PLANS & ELECTRICAL DWGS. FOR ROUGH-IN LOCATIONS & REQUIREMENTS
	LIGHT FIXTURE - SEE ELECTRICAL
	1/4 LIGHT FIXTURE - SEE ELECTRICAL
	2x4 LIGHT FIXTURE - SEE ELECTRICAL
	(CHAIN HUNG) 1/4 LIGHT FIXTURE - SEE ELECTRICAL
<h2>GENERAL NOTES</h2>	
(NIC) MEANS NOT IN CONTRACT. TO BE PROVIDED BY OWNER AND INSTALLED BY OWNER.	
DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS.	
ALL DIMENSIONS SHOWN ARE TO FACE OF MASONRY, METAL STUDS, OR CENTERLINE OF STRUCTURE. MASONRY DIMENSIONS ARE NOMINAL. EXTERIOR WALL DIMENSIONS ARE TO EXTERIOR SIDE OF VENEER.	
REFER TO ENLARGED PLANS FOR DIMENSIONS NOT SHOWN ON 1/8" PLANS	
PROVIDE BULLNOSE UNITS AT ALL EXPOSED CONCRETE BLOCK CORNERS, UNLESS OTHERWISE NOTED. FIRST CORNER BLOCK BE SQUARE BLOCK TO CATCH BASE, TYPICAL. REFER TO DETAIL, THIS SHEET.	
ALL CONCEALED WOOD FRAMING AND PLYWOOD SHALL BE FIRE-RETARDANT TREATED (FRT) EXCEPT THAT NON-F.R.T. BLOCKING, VALERS AND FURRING MAY BE USED WHERE INSTALLED IN ACCORDANCE WITH HBC SECTION 803.4 (INCLUDING DIMENSIONAL WOOD BLOCKING, FIRE BLOCKING, REQUIREMENTS, ETC.). WOOD BLOCKING INSTALLED IN ACCORDANCE WITH HBC SECTION 803.4, PARAGRAPH 1 FOR HANDRAILS, MILLWORK, CABINETS, WINDOWS AND DOORS IS NOT REQUIRED TO BE F.R.T. AT COPINGS AND ROOFING TERMINATIONS ALL BLOCKING SHALL BE PRESSURE TREATED (PT). WHERE WOOD BLOCKING IS IN CONTACT WITH CMU, MASONRY OR CONCRETE, SUCH BLOCKING SHALL BE PRESSURE TREATED.	
REFER TO STRUCTURAL DRAWINGS FOR TYPES, SIZE, LOCATION, CONNECTIONS, REINFORCEMENT AND OTHER REQUIREMENTS PERTAINING TO STRUCTURAL COMPONENTS INDICATED.	
REFER TO STRUCTURAL DRAWINGS FOR VERTICAL REINFORCING IN CMU WALLS, POURED CONCRETE SLABS AND FOUNDATIONS.	
REFER TO STRUCTURAL DRAWING FOR LINTEL SCHEDULE.	
VERIFY REQUIRED DEPTH OF ALL RECESSED SLABS WITH APPROPRIATE MANUFACTURER PRIOR TO PLACEMENT OF SLAB.	
ALL CHANGES IN FLOOR FINISHES SHALL OCCUR AT DOOR THRESHOLDS - TYPICAL, UNO.	
MOUNTING HEIGHTS: (UNLESS NOTED OTHERWISE) TB (TACK BOARD) - MOUNT TOP @ 6'-8" A.F.F. MB (MARKER BOARD) - MOUNT TOP @ 6'-8" A.F.F. WALL PAD - MOUNT BOTTOM @ 6" A.F.F.	
ALL CONTRACTORS SHALL REVIEW DWGS FOR MATERIALS AND MANUFACTURER'S MODEL NUMBERS LISTED ON DWGS.	
CONTACT BETWEEN DISSIMILAR METALS SHALL BE SEPARATED WITH BUTYL TAPE, OR OTHER APPROVED MEANS TO PREVENT GALVANIC CORROSION.	
CONTRACTOR SHALL PROVIDE ALL CONCEALED BLOCKING REQUIRED FOR ATTACHMENT AND SUPPORT OF EQUIPMENT, FIXTURES, WINDOWS, ETC.	
GYPSUM CEILING BOARD SHALL BE USED AT ALL HORIZONTAL APPLICATIONS OF GYPSUM BOARD.	
ALL EXPOSED CORNERS AND EDGES OF GYPSUM BOARD SHALL BE FINISHED WITH CORNER BEAD OR J-BEAD, RESPECTIVELY.	
IF INTERIOR PARTITIONS WALLS EXTEND FULL HEIGHT PROVIDE CLOSURE TO DECK OR ROOF W/ BATT INSULATION AND FIRE-RATING AS REQUIRED. ANY ADJACENT A.F.F. DESIGNATION IDENTIFIES A SPECIFIC PARTITION HEIGHT.	
PARTITIONS TYPES ARE TO MAINTAIN THEIR RESPECTIVE SEPARATION/RATING IF ANY PARTITION HEIGHT. ALL HVAC, ELECTRICAL, PLUMBING PENETRATIONS ARE TO BE SEALED / SAFED / DAMPERED TO COMPLY WITH LOCAL CODES.	
CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS SIZES FOR WINDOWS AND DOORS AND COORDINATE ANY REQUIRED ADJUSTMENTS WITH THE ARCHITECT.	
SYMBOLS THAT REPRESENT M&E ITEMS ON ARCHITECTURAL DRAWINGS ARE FOR GRAPHIC PURPOSES ONLY. REFER TO M&E DRAWINGS FOR SPECIFIC INFORMATION.	
ALL WOOD BLOCKING, VALERS, SILL PLATES, ETC. IN CONTACT WITH SLABS ON GRADE OR EXTERIOR MASONRY OR CONCRETE SHALL BE PRESSURE-PRESERVATIVE TREATED (P.T.). REFER TO THE DRAWINGS FOR OTHER LOCATIONS WHERE P.T. WOOD IS REQUIRED.	
ALL P.T. WOOD COMPONENTS SHALL BE SEPARATED FROM CONTACT WITH ADJACENT METALS WITH PERMANENTLY AFFIXED NO. 15 FELT, SELF-ADHERING ELASTOMERIC MEMBRANE, OR OTHER SUCH PERMANENT NON-CORROSIVE SEPARATION MATERIAL.	
ALL ANCHORS, FASTENERS, ETC. IN CONTACT WITH P.T. WOOD COMPONENTS SHALL BE STAINLESS STEEL OR G-90 (MIN.) HOT-DIPPED GALVANIZED.	
REFER TO MECHANICAL DWG'S. FOR ALL FLOOR DRAIN LOCATIONS.	
SEAL ALL FLOOR / WALL PENETRATIONS AT MECHANICAL PLATFORMS FOR SOUND ISOLATION.	
AT ALL DETAILS REFERRING TO "CYMENE" OR SPRAY FOAM INSULATION (OR EQUIVALENT), 6" MIN. OF SPRAY FOAM INSULATION SHALL BE UTILIZED TO ACHIEVE A MINIMUM THERMAL RESISTANCE RATING OF R-22.	
PROVIDE FILLER PANELS AT LOCKER LOCATIONS AS REQ'D. FILLER PANELS TO HAVE SLOPED TOPS.	

JOB NO.	1744, BGR17-236
DATE	APR 23, 2018
DRAWN	BA
CHECKED	JMc (P.I.C.)


COPYRIGHT © 2018
SHERMAN CARTER BARNHART
ARCHITECTS, P.L.L.C.

REVISIONS

No.	Description	Date

SHEET

A1.1

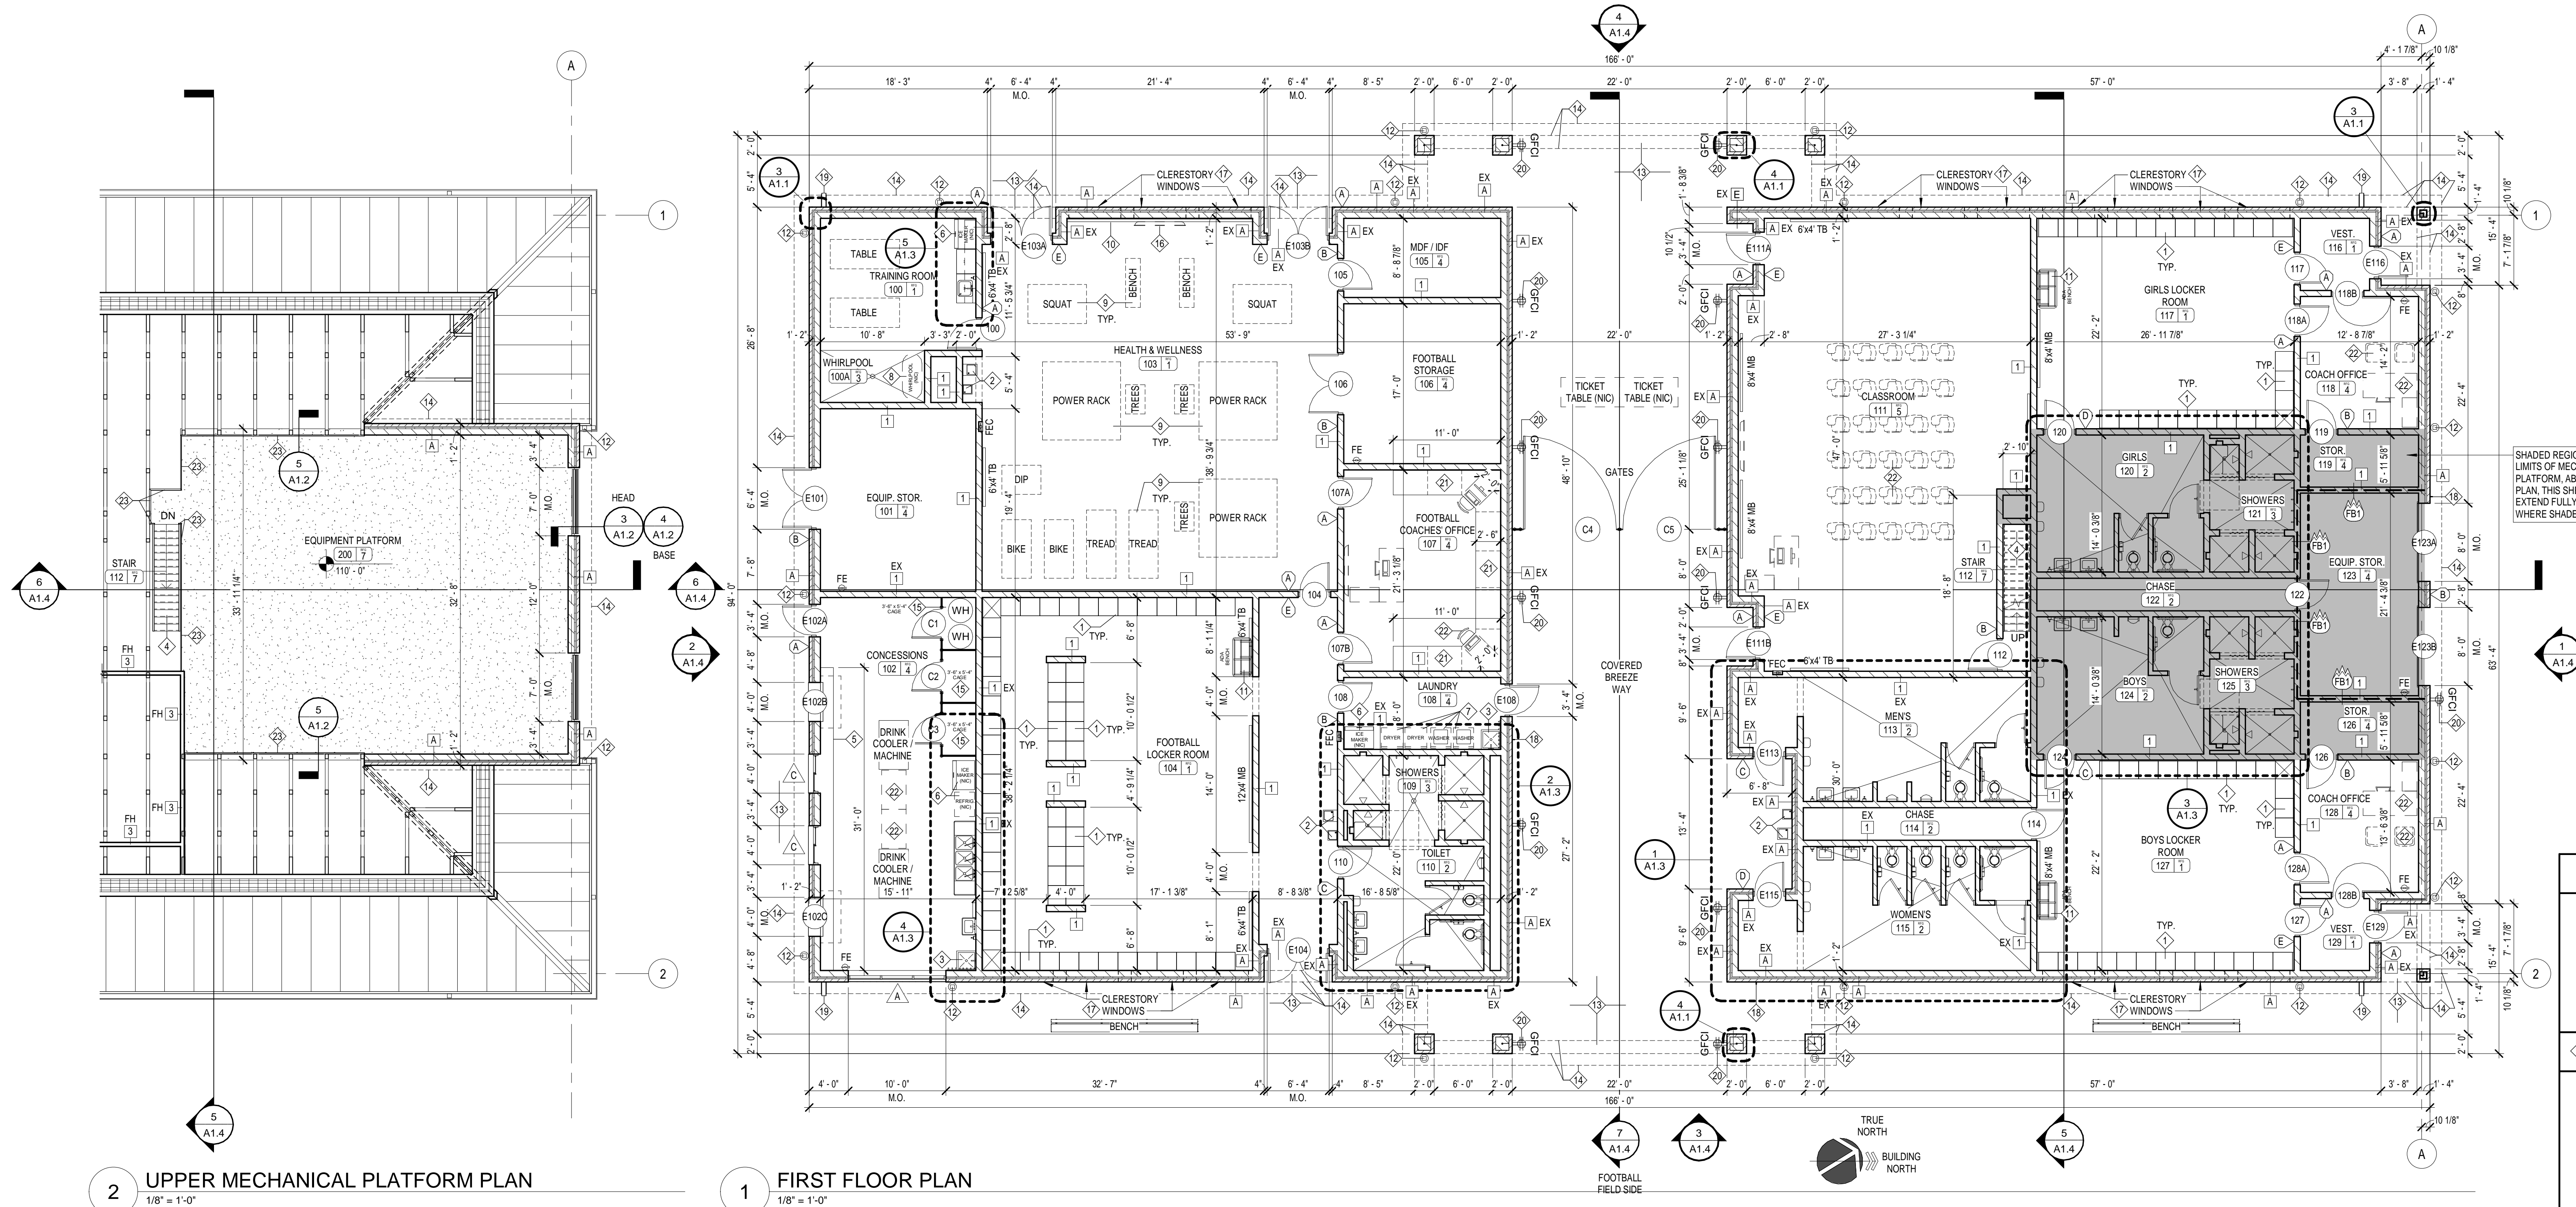

GENERAL WORK NOTES

- 1 REFER TO MECH./ELEC. DRAWINGS FOR SPECIFIC NOTES REGARDING MECH/ELEC ITEMS NOT SHOWN ON THIS SHEET.
- 2 REFER TO ROOF PLAN AND MECH DRAWINGS FOR ADDITIONAL INFORMATION REGARDING WORK AT ROOF.
- 3 REFER TO SHEET N-1 FOR GENERAL NOTES AND PARTITION TYPES.
- 4 REFER TO DETAILS ON SHEET A6.1 FOR TYPICAL WALL INTERSECTION DETAILS.
- 5 REFER TO SHEET A2.2 FOR TOILET ACCESSORY SCHEDULE.

PLAN KEY NOTES

- 1 22"Dx24"Wx72"H ATHLETIC LOCKER W/ RECESSED HANDLE, INTEGRAL SECURITY, BACKSEAT, AND FOOTLOCKER. REFER TO SPECIFICATIONS.
- 2 DRINKING FOUNTAIN. REFER TO M.P.E. DWGS.
- 3 MOP BASIN. REFER TO M.P.E. DWGS.
- 4 PAINTED FIXED INDUSTRIAL STEEL STAIR TO PLATFORM. REFER TO DETAIL 10A1.3.
- 5 STAINLESS STEEL COUNTERTOP. REFER TO DETAILS 7 & 8/A1.1, AND 12/A1.6.
- 6 REFRIGERATOR (N.I.C.) AND/OR ICE MACHINE (N.I.C.) WITH WATER HOOKUP. REFER TO M.P.E. DWGS.
- 7 WASHER AND DRYER (N.I.C.). REFER TO M.P.E. DWGS.
- 8 WHIRLPOOL - IN CONTRACT. REFER TO M.P.E. DWGS.
- 9 WEIGHT TRAINING EQUIPMENT LAYOUT FOR REFERENCE ONLY. EQUIPMENT NOT IN CONTRACT (N.I.C.).
- 10 3'-0"Wx6'-0"H FULL LENGTH OF WALL, WALL MOUNTED MIRRORS. MOUNT BOTTOM AT 8" A.F.F.
- 11 PROVIDE FOLD-DOWN ADA "DRESSING BENCH" / TABLE - MODEL D-101" AS MANUFACTURED BY NORTHWEST BUILDERS NETWORK, INC. OR APPROVED EQUAL. PROVIDE ALL NECESSARY BLOCKING, SUPPORT HOOKS, AND LOCKING MECHANISMS, ANCHORS, AND ANCHORING HARDWARE.
- 12 PREFINISHED DOWNSPURT, DOWNSPURT DISCHARGE INTO BOOT SYSTEM. REFER TO CIVIL FOR DETAILS AND CONTINUATION.
- 13 REFER TO SITE DRAWINGS FOR CONCRETE WALKS, STOOPS, ETC.
- 14 LINE OF SOFFIT / LINTEL / OVERHANG ABOVE. REFER TO DETAILS AND REFLECTED CEILING PLAN.
- 15 PROVIDE (3 BAY) 3'-8"x5'-4" CHAIN LINK FENCE CAGES AT 8'-10" TALL. EACH BAY SHALL HAVE A 5'x8' LOCKABLE ACCESS GATE.
- 16 60" - 80" WIDE SCREEN LCD T.V. (N.I.C.).
- 17 CLERESTORY WINDOWS ABOVE - REFER TO ELEVATIONS AND SHT. A1.2 FOR DIMENSIONAL LOCATION.
- 18 EXTERIOR HOSE BIBB LOCATION - REFER TO PLUMBING DRAWINGS.
- 19 EXTERIOR SECURITY CAMERA LOCATIONS (ABOVE) - REFER TO ELECTRICAL DRAWINGS.
- 20 EXTERIOR ELECTRICAL OUTLETS - REFER TO ELECTRICAL DRAWINGS.
- 21 30" DEEP COUNTERTOP. REFER TO DETAIL 9/A1.3.
- 22 FURNITURE SHOWN FOR REFERENCE ONLY. FURNITURE NOT IN CONTRACT (N.I.C.).
- 23 PROTECTIVE PLATFORM RAIL - REFER TO DETAILS 5 & 6/A1.2.

SYMBOL LEGEND

Name	10110	ROOM FINISH GROUPS (REFER TO SHEET NO.1)
XXXX	ROOM NUMBER	DOOR NUMBER (DOOR SCHEDULE SHEET A1.6)
X	PLAN KEY NOTES (THIS SHEET)	WALL / PARTITION TYPE (SCHEDULE SHEET NO.1)
X	WINDOW OR STOREFRONT TYPE (REFER TO FLOOR PLANS AND SCHEDULE SHEET A1.5)	TOILET ACCESSORIES (SCHEDULE SHEET A1.3)
X	ELEVATION KEY NOTE (SHEET A1.4)	ROOF KEY NOTE (SHEET A1.2)
X	CEILING PLAN KEY NOTE (SHEET A1.2)	SIGNAGE KEY NOTE (SHEET NO.1)
X	WALL MOUNTED FIRE EXTINGUISHER (MOUNT CTR. LINE OF HANDLE AT 4'-0" A.F.F.)	FIRE EXTINGUISHER CABINET (SEMI-RECESSED). REFER TO DETAILS 9 & 10, THIS SHEET.
X	ROOM / WALL DESIGNATION	1 HOUR FIRE BARRIER
Y-Y MB	MARKER BOARD (MB), TACK BOARD (TB), TACK STRIP (TS)	PROJECTION SCREEN (PS) AND/OR WALL PADS. REFER TO SPECS. MOUNT TOP OF BOARD AT 6'-8" A.F.F.
CJ	CONTROL JOINT. REFER TO A1.1 - A1.3 FOR LOCATIONS. REFER TO EXTERIOR ELEVATIONS FOR EXTERIOR LOCATIONS.	

2 UPPER MECHANICAL PLATFORM PLAN
1/8" = 1'-0"1 FIRST FLOOR PLAN
1/8" = 1'-0"11 TYP. CONTROL / C.M.U.
VENEER EXPANSION JOINT @
MASONRY
1" = 1'-0"9 TYP. FEC ELEVATION
3/4" = 1'-0"12 TYP. EXP. JNT. @ INT.
MASONRY PARTITION
1" = 1'-0"13 TYP. INT. CMU PARTITION
INTERSECTION DTL.
1" = 1'-0"10 TYP. FEC SECTION AT CMU
3/4" = 1'-0"8 COILING SHUTTER COUNTER DETAIL
1 1/2" = 1'-0"7 COILING SHUTTER COUNTER
JAMB DETAIL
1 1/2" = 1'-0"5 BASE FLASHING DETAIL
1 1/2" = 1'-0"3 PLAN DETAIL
1 1/2" = 1'-0"4 PLAN DETAIL
1 1/2" = 1'-0"6 BASE FLASHING DETAIL
1 1/2" = 1'-0"

2. ALL CEILINGS ARE 2x2 SUSP. ACOUST. CLG., TYPE 1 AT 9'-0" A.F.F., UNLESS NOTED OTHERWISE.
3. REFER TO WALL PARTITION TYPES FOR DESCRIPTION OF WALLS EXTENDING (OR NOT) TO UNDERSIDE OF DECKING AND/OR STRUCTURE ABOVE.
4. INSTALL SPRINKLER HEADS IN THE CENTER OF CEILING PANELS.
5. INSTALL ALL SPRINKLER HEADS ON SWING ARM NIPPLES. SEE MECHANICAL DRAWINGS FOR MORE SPECIFIC REQUIREMENTS.
6. PAINT ALL ITEMS EXPOSED TO VIEW INCLUDING UNDERSIDE OF METAL DECK, BAR JOISTS, CONDUIT, & PIPING.
7. CONTRACTOR TO SUBMIT FULL COORDINATION DRAWINGS FOR ALL CEILING ITEMS INCLUDING JOIST SPACING, LIGHTING, HVAC LAYOUT AND FIRE PROTECTION SYSTEMS.

A. TYPE "A" - 2" SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. CLG AT 9'-0" A.F.F. WITH EXCEPTION TO HEALTH & WELLNESS 103, WHOSE CLG. WILL BE AT 9'-11 1/2" A.F.F. (AS TIGHT AS POSSIBLE TO BTM. OF TRUSSES).

B. TYPE "B" - "VINYL" COATED 2" SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. CLG AT 9'-0" A.F.F.

C. TYPE "C" - FRP (FIBERGLASS REINFORCED PLASTIC) 2" SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. FOR TYPE DESCRIPTION. CLG AT 9'-0" A.F.F.

D. TYPE "D" - 2" PERFORATED METAL SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. CLG AT 9'-0" A.F.F. (ABOVE THIS CEILING SYSTEM, PROVIDE 1/2" MIN. GYPSUM CEILING BD. ON 1" MT. STUDS @ 8' 10" O.C. ATTACHED TO UNDERSIDE OF TRUSSES (HORIZONTALLY). FILL VOIDS W/ 2" BA INSULATION AND SEALANT AT FULL PERIMETER).

E. TYPE "E" - 2" PERFORATED METAL SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. CLG AT 9'-0" A.F.F. (SAME AS LINTEL HEIGHT). (ABOVE THIS CEILING SYSTEM, PROVIDE 1/2" MIN. GYPSUM CEILING BD. ON 1" MT. STUDS @ 8' 10" O.C. ATTACHED TO UNDERSIDE OF TRUSSES (HORIZONTALLY). FILL VOIDS W/ 2" BA INSULATION AND SEALANT AT FULL PERIMETER).

F. TYPE "F" - MOISTURE RESISTANT 5/8" GYPSUM CEILING BOARD ON 7/8" HAT CHANNEL & METAL SUSPENSION SYSTEM. (PANT). CLG AT 8'-0" A.F.F.

G. TYPE "G" - "VINYL" COATED 2" SUSPENDED ACoustICAL PANEL CEILING SYSTEM - SEE SPEC. CLG AT 8'-0" A.F.F.

H. PVC/SF/COAT ON 3/8" MTL. STUD FRAMING AT 8'-0" A.F.F. FILL W/ BATT INSULATION

J. EXPOSED STRUCTURE - PAINT.

K. C.M.U. BOND BEAM OR STEEL LINTEL - BOTTOM OF LINTEL @ 8'-0" A.F.F. (PANT).


L. C.M.U. BOND BEAM OR STEEL LINTEL - BOTTOM OF LINTEL @ 7'-4" A.F.F. (PANT).

M. 2" CONTINUOUS SOFFIT VENT.

N. DOWNPOUT - REFER TO ROOF PLAN.

P. PVC SOFFIT - PANT.

2. ALL CEILINGS ARE 2'x2' SUSP. ACOUST. CLG. TYPE 1 AT 9" O.C. A.F.F., UNLESS NOTED OTHERWISE.
3. REFER TO WALL PARTITION TYPES FOR DESCRIPTION OF WALLS EXTENDING (OR NOT) TO UNDERSIDE OF DECKING AND/OR STRUCTURE ABOVE.
4. INSTALL SPRINKLER HEADS IN THE CENTER OF CEILING PANELS.
5. INSTALL ALL SPRINKLER HEADS ON SWING ARM NIPPLES. SEE MECHANICAL DRAWINGS FOR MORE SPECIFIC REQUIREMENTS.
6. PAINT ALL ITEMS EXPOSED TO VIEW INCLUDING UNDERSIDE OF METAL DECK, BAR JOISTS, CONDUIT, & PIPING.
7. CONTRACTOR TO SUBMIT FULL COORDINATION DRAWINGS FOR ALL CEILING ITEMS INCLUDING JOIST SPACING, LIGHTING, HVAC LAYOUT AND FIRE PROTECTION SYSTEMS.

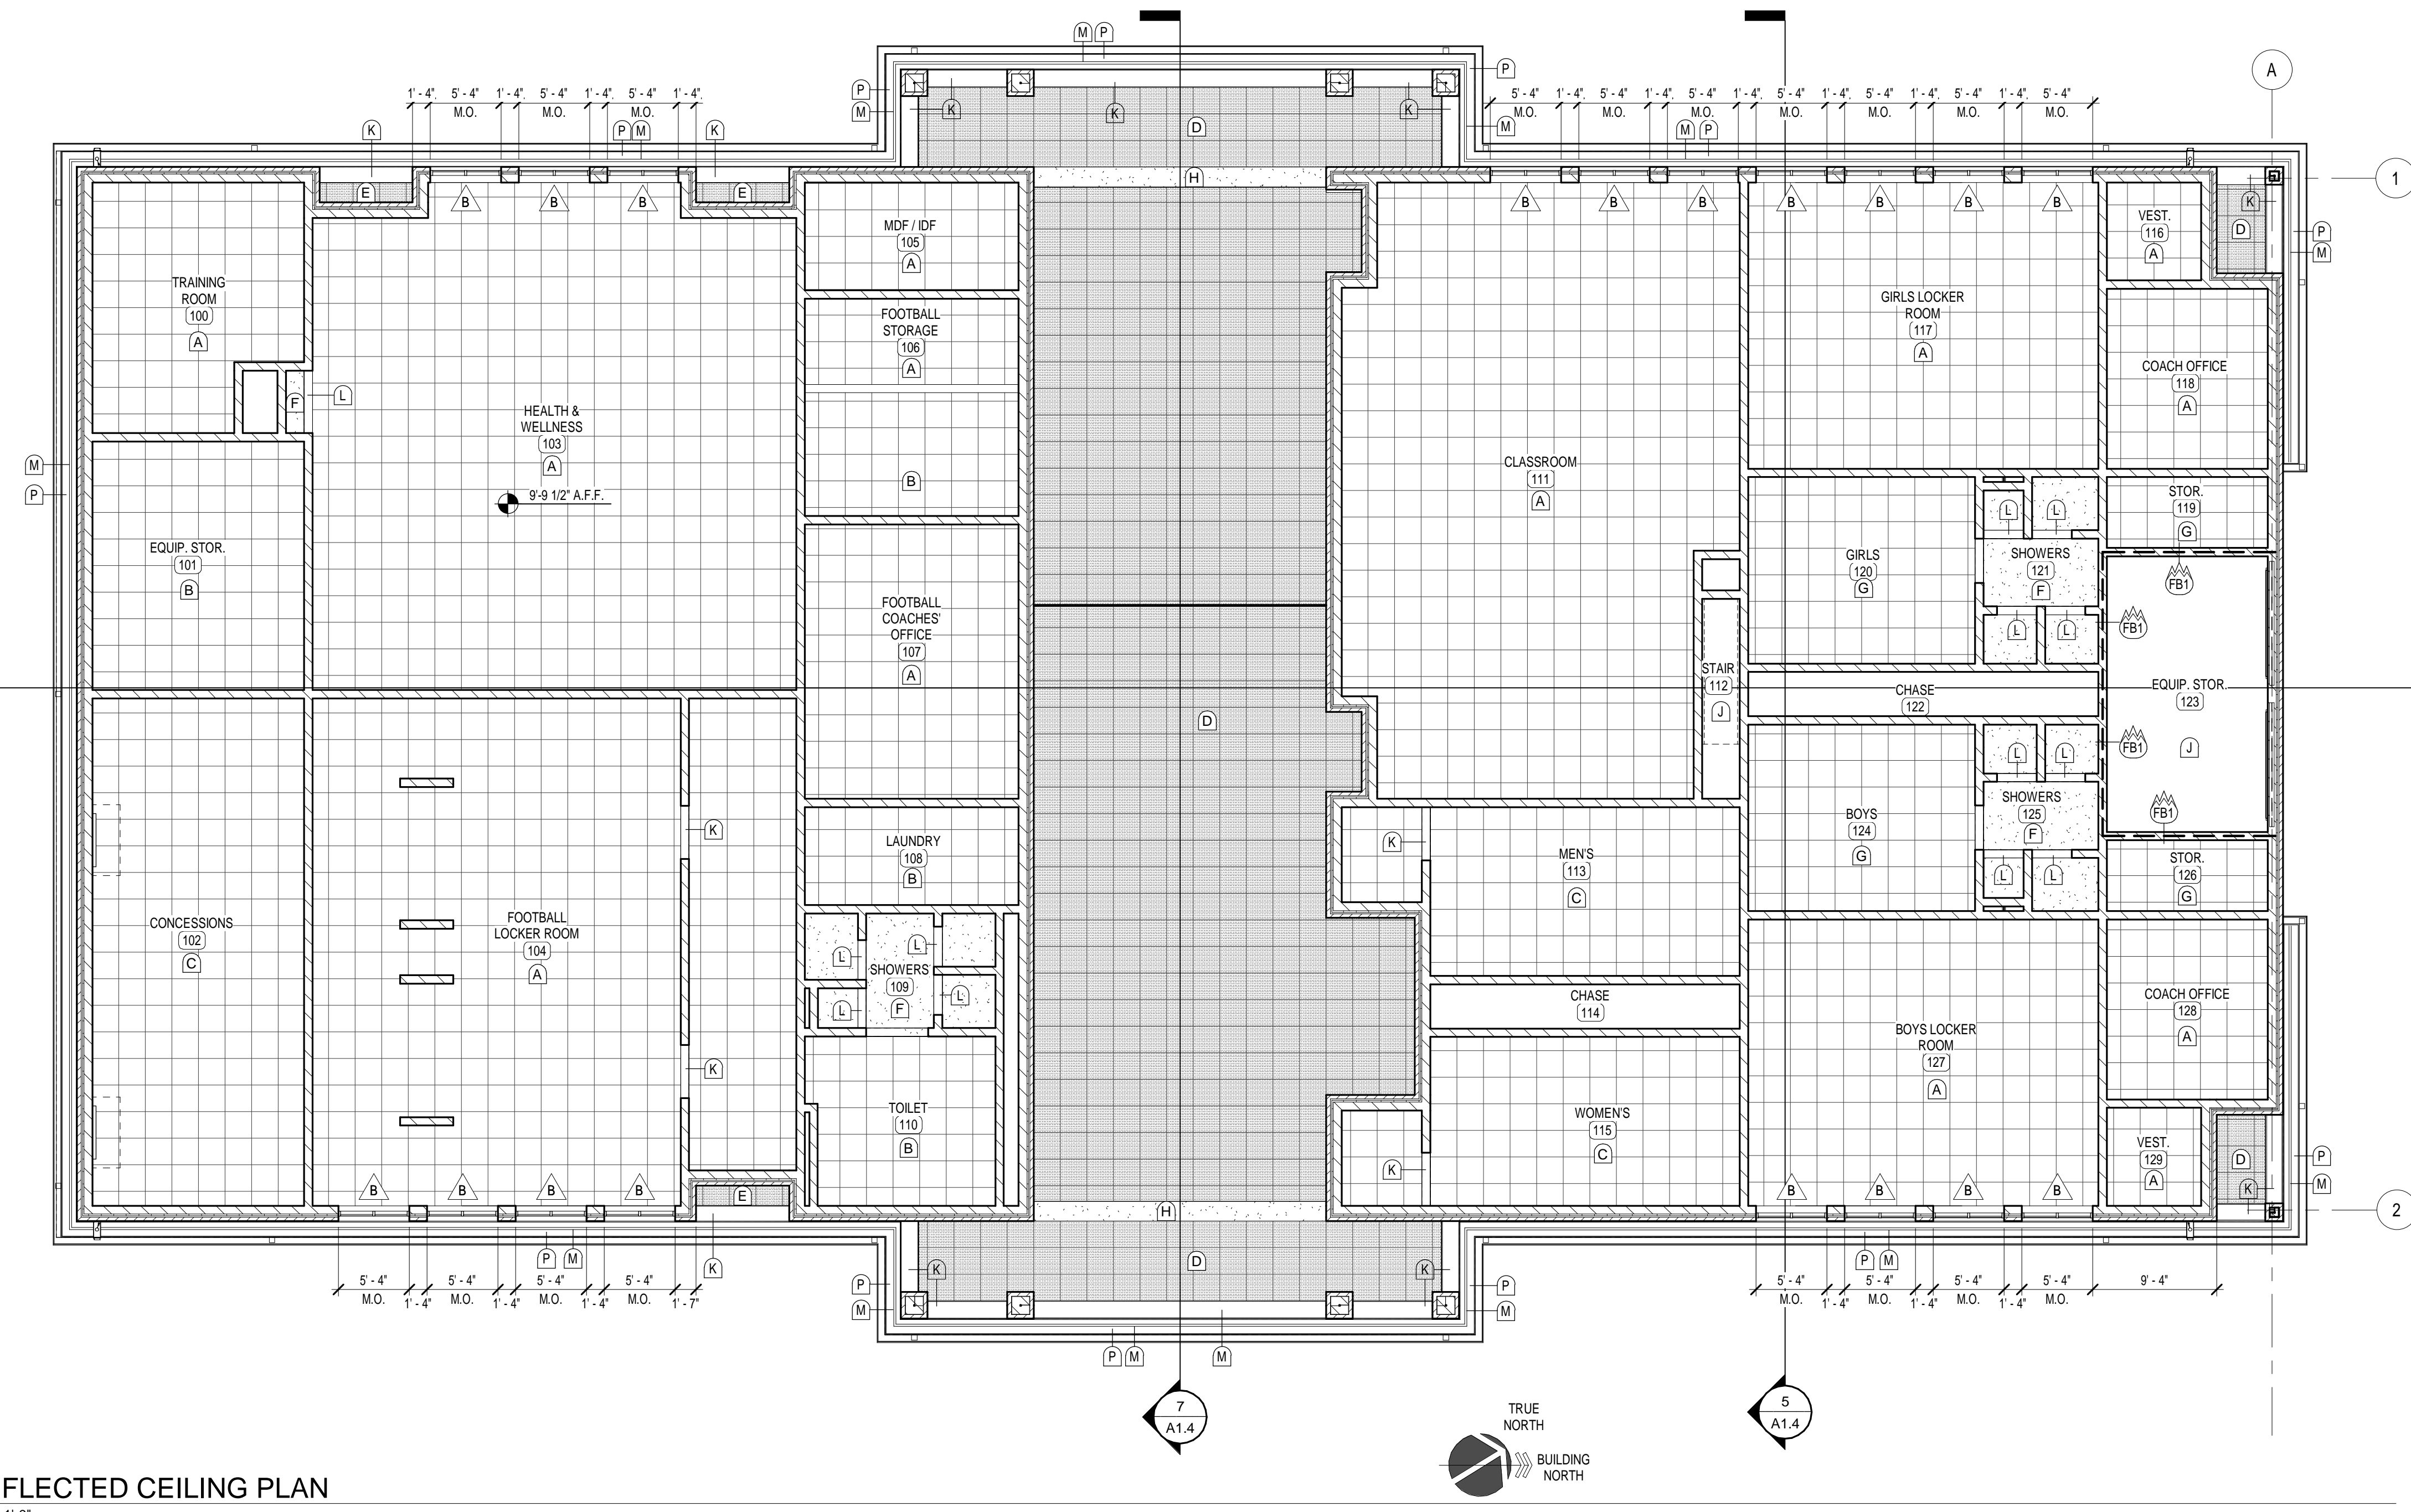

2 REFLECTED CEILING PLAN



JOB NO.	1744, BGR17-236
DATE	APR 23, 2018
DRAWN	BA
CHECKED	JMc (P.I.C.)
COPYRIGHT © 2018 SHERMAN CARTER BARNHART ARCHITECTS, PLLC	

REVISIONS		
No.	Description	Date

SHEET


A1.4

ELEVATION KEY NOTES

1. STANDING SEAM METAL ROOF SYSTEM - TYPE 'A'. REFER TO ROOF PLAN.
2. PRE-FINISHED S.M. GUTTER. REFER TO DETAIL 9/A1.4.
3. PRE-FINISHED S.M. DOWNSPOUT. DISCHARGE INTO BOOT AND BELOW GRADE DRAINAGE SYSTEM. REFER TO CIVIL FOR DETAILS AND FOR CONTINUATION.
4. PRE-FINISHED CAST IRON DOWNSPOUT BOOT.
5. FACE BRICK.
6. 3/8" PROJECTED BRICK SOLDIER COURSE, (ACCENT COLOR).
7. 3/8" RECESSED BRICK VENEER (THREE COURSES) - 8" TALL.
8. PAINTED, GALVANIZED, HOLLOW METAL INSULATED DOOR AND FRAME.
9. CONTROL / C.M.U. VENEER EXPANSION JOINT. REFER TO DETAIL 11/A1.1.
10. PREFINISHED ALUMINUM LOUVER - REFER TO DETAILS 3 & 4/A1.2, AND TO MECHANICAL DRAWINGS.
11. EXTERIOR PVC TRIM - PAINT. REFER TO DETAIL.
12. SECURITY CAMERA - REFER TO ELECTRICAL DRAWINGS.
13. CONCESSIONS COILING COUNTER SHUTTER OR PAINTED, GALVANIZED, HOLLOW METAL TRANSACTION WINDOW - REFER TO DOOR TYPES.
14. INSULATED OVERHEAD DOOR - REFER TO DOOR TYPES.
15. FIXED BENCH - REFER TO SITE DRAWINGS.
16. PRE-FIN. S.M. STEP FLASHING.


GENERAL NOTES

- GENERAL: BUILDING ELEVATIONS SHOWN ON THIS DRAWING ARE INTENDED FOR GENERAL REFERENCE PURPOSES ONLY. REFER TO REFERENCED SECTIONS AND DETAILS FOR MORE FULLY DESCRIBED CONDITIONS AND REQUIREMENTS.
- A. MATERIALS INDICATIONS AND DESCRIPTIONS, VERTICAL AND OTHER DIMENSIONS SHOWN ON ONE BUILDING ELEVATION APPLY TO APPLY TO OTHER BUILDING ELEVATIONS UNLESS NOTED OTHERWISE.
- B. LINES REPRESENTING PAVING AND FINISH GRADES ARE APPROXIMATE AND ARE SHOWN FOR REFERENCE PURPOSES ONLY. REFER TO SITE PLANS FOR SPECIFIC GRADE AND SPOT ELEVATIONS AT EACH RESPECTIVELY.
- C. REFER TO FLOOR PLANS FOR LOCATION AND DOOR SCHEDULE FOR FULL EXTENT AND COMPLETE DESCRIPTION OF DOOR AND FRAME TYPES. PORTIONS OF DOORS, WINDOWS STOREFRONTS, AND CURTAIN WALLS MAY BE CONCEALED BY OTHER BUILDING FEATURES SHOWN.
- D. REFER TO FLOOR PLANS FOR SPECIFIC ALUMINUM WINDOW TYPES AND WINDOW ELEVATIONS.
- E. LOCATIONS OF CONTROL JOINTS (CJ) IN MASONRY WALLS ARE SHOWN ON THIS DRAWING. SEE REFERENCED DETAILS FOR SPECIFIC REQUIREMENTS AT RESPECTIVE LOCATIONS.
- F. ALL EXPOSED NEW EXTERIOR MASONRY SHALL RECEIVE APPLICATION OF SPECIFIED WATER REPELLENT.
- G. ALL EXPOSED EXTERIOR METAL SUCH AS FLASHINGS, COPINGS GUTTERS DOWNSPOUTS AND LADDERS SHALL RECEIVE THE SPECIFIED FIELD OR SHOP APPLIED FINISH COATING.

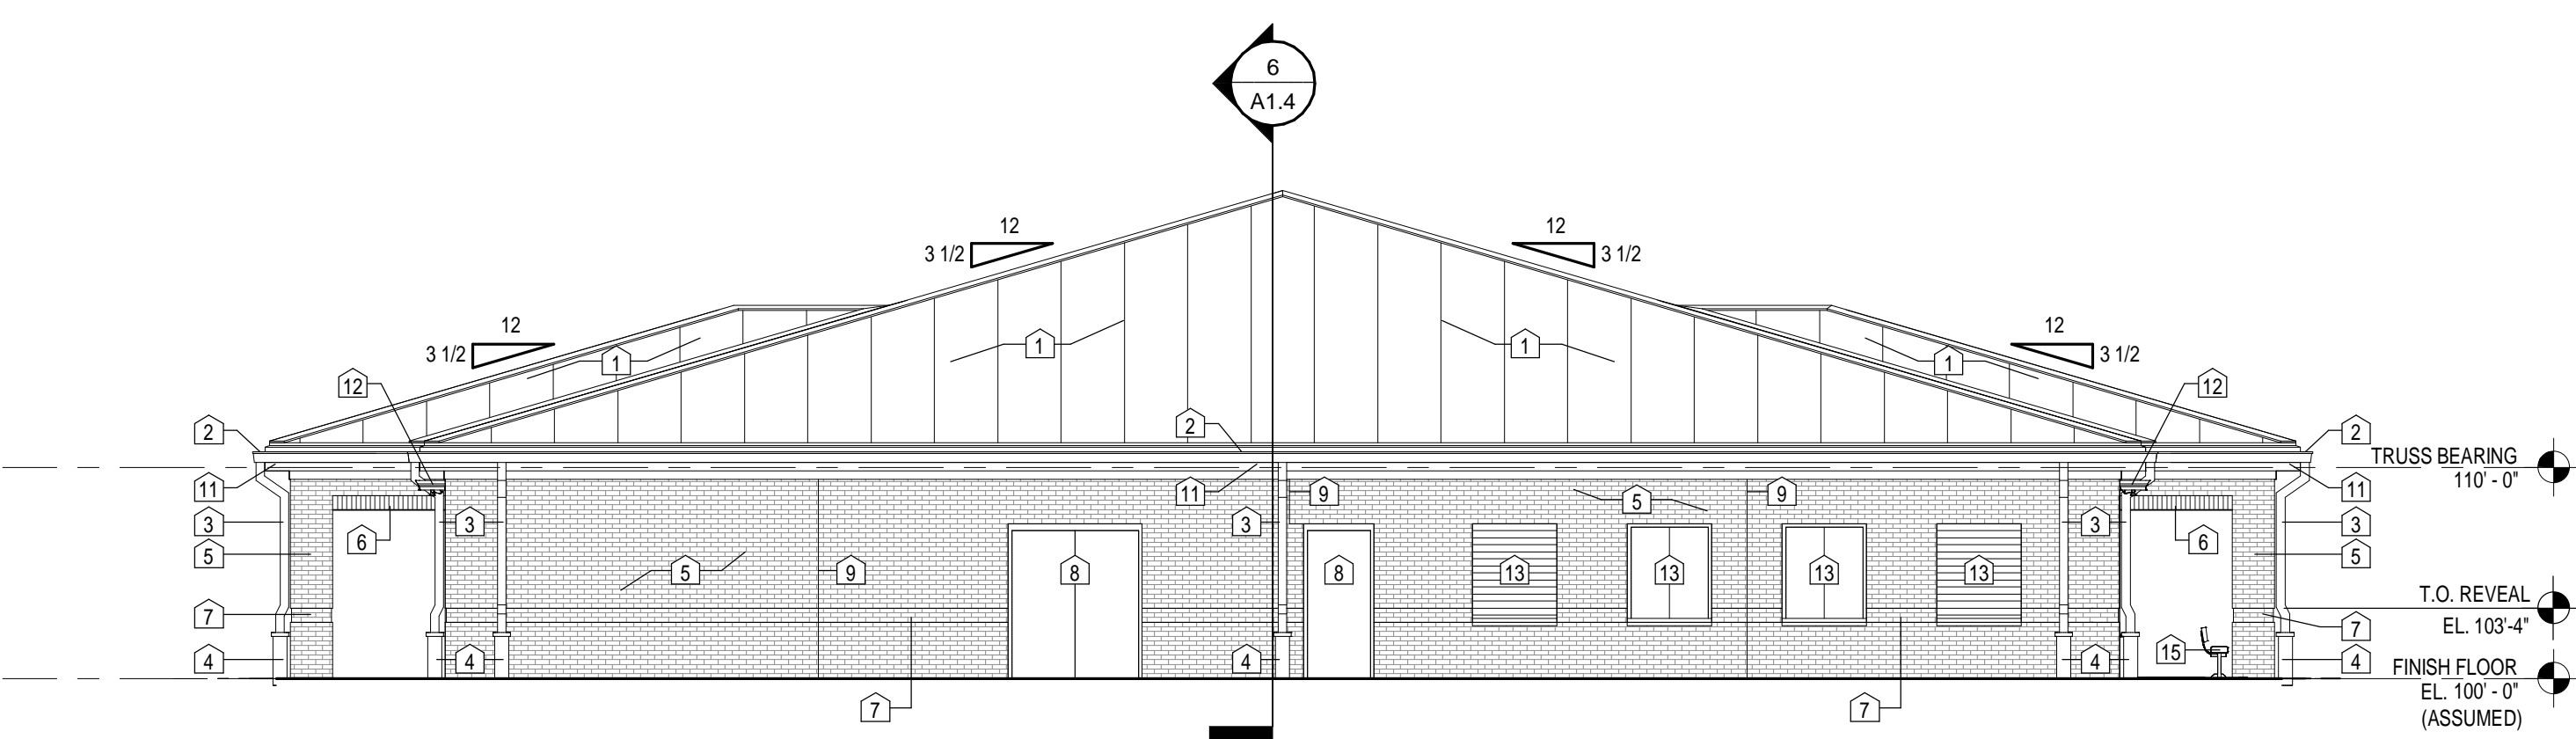


2 SOUTH ELEVATION

1/8" = 1'-0"

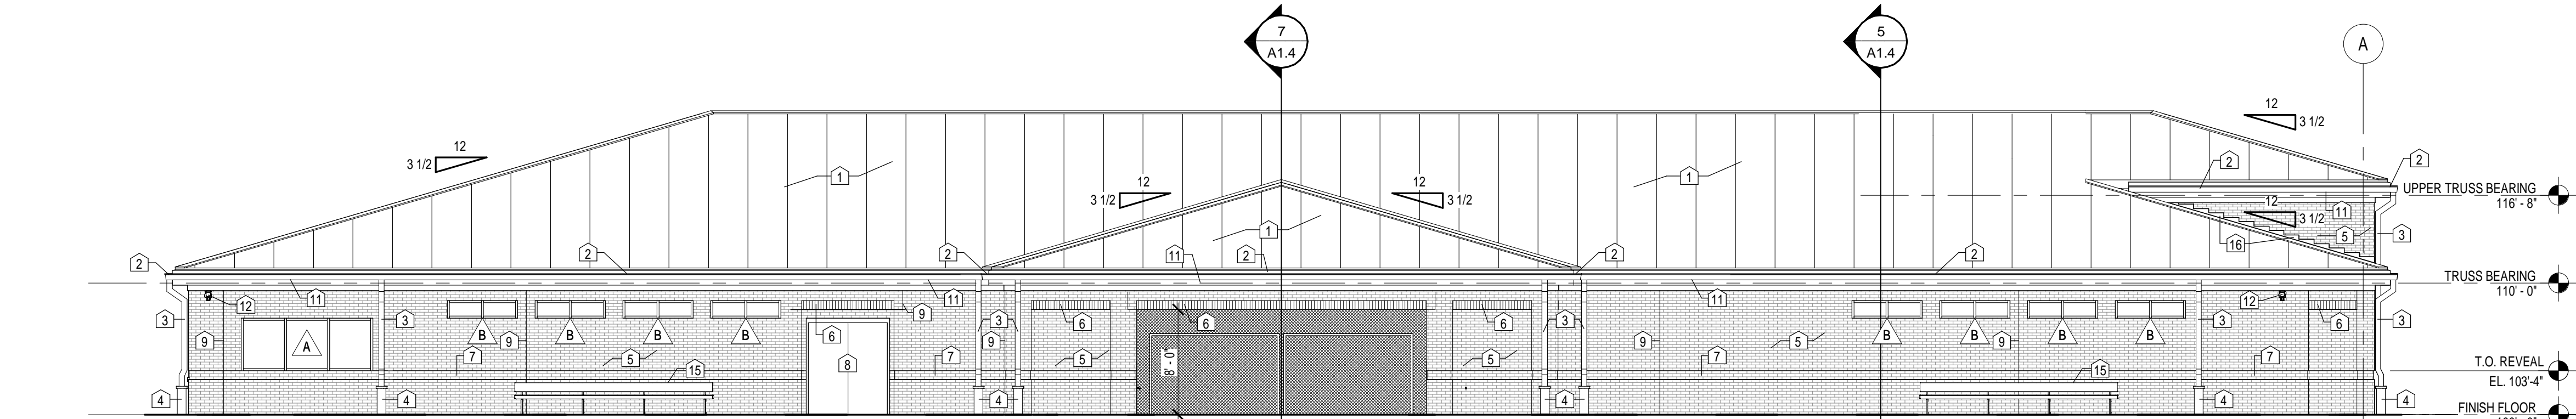


1 NORTH ELEVATION

1/8" = 1'-0"

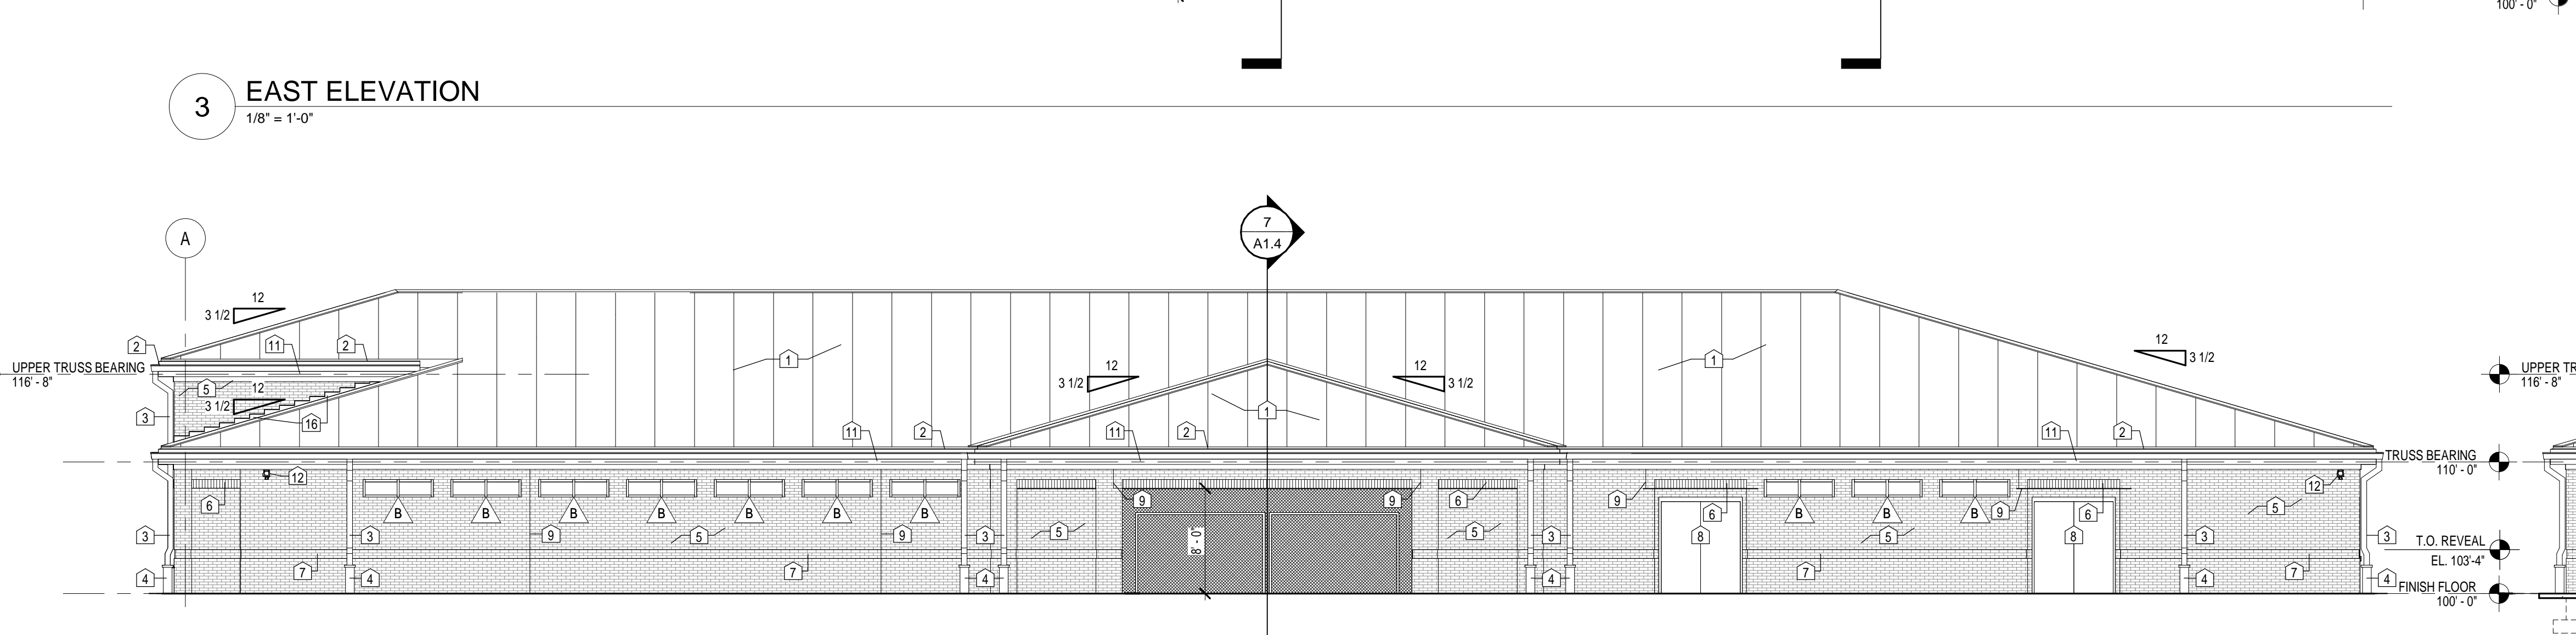

3 EAST ELEVATION

1/8" = 1'-0"

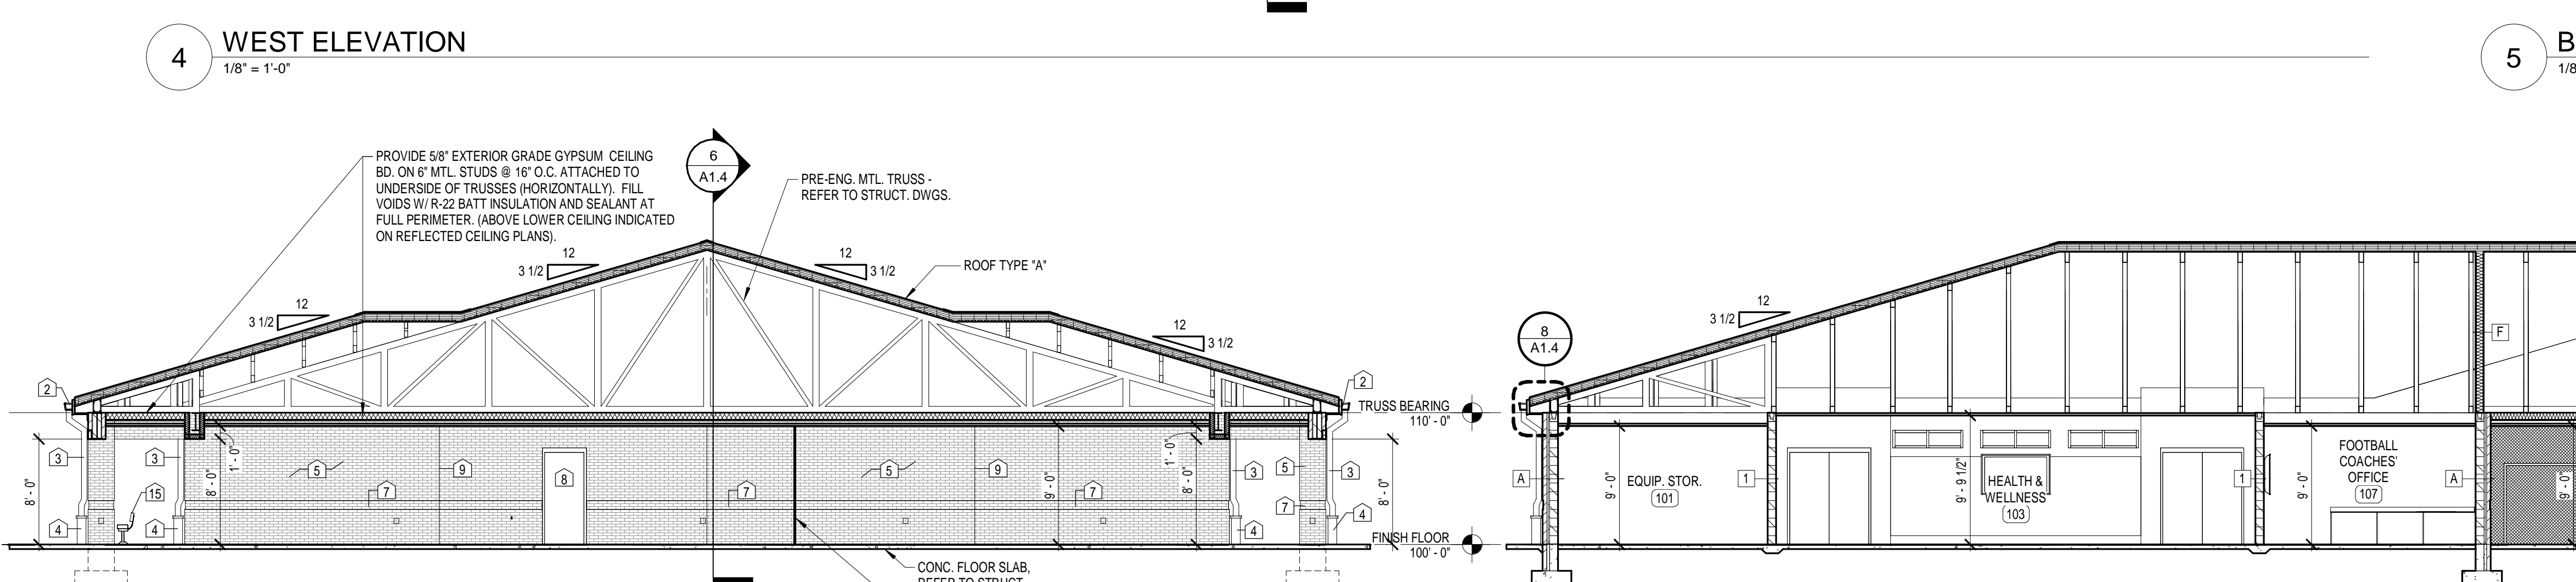

4 WEST ELEVATION

1/8" = 1'-0"



7 BUILDING SECTION


1/8" = 1'-0"

5 BUILDING SECTION

1/8" = 1'-0"


6 BUILDING SECTION

1/8" = 1'-0"

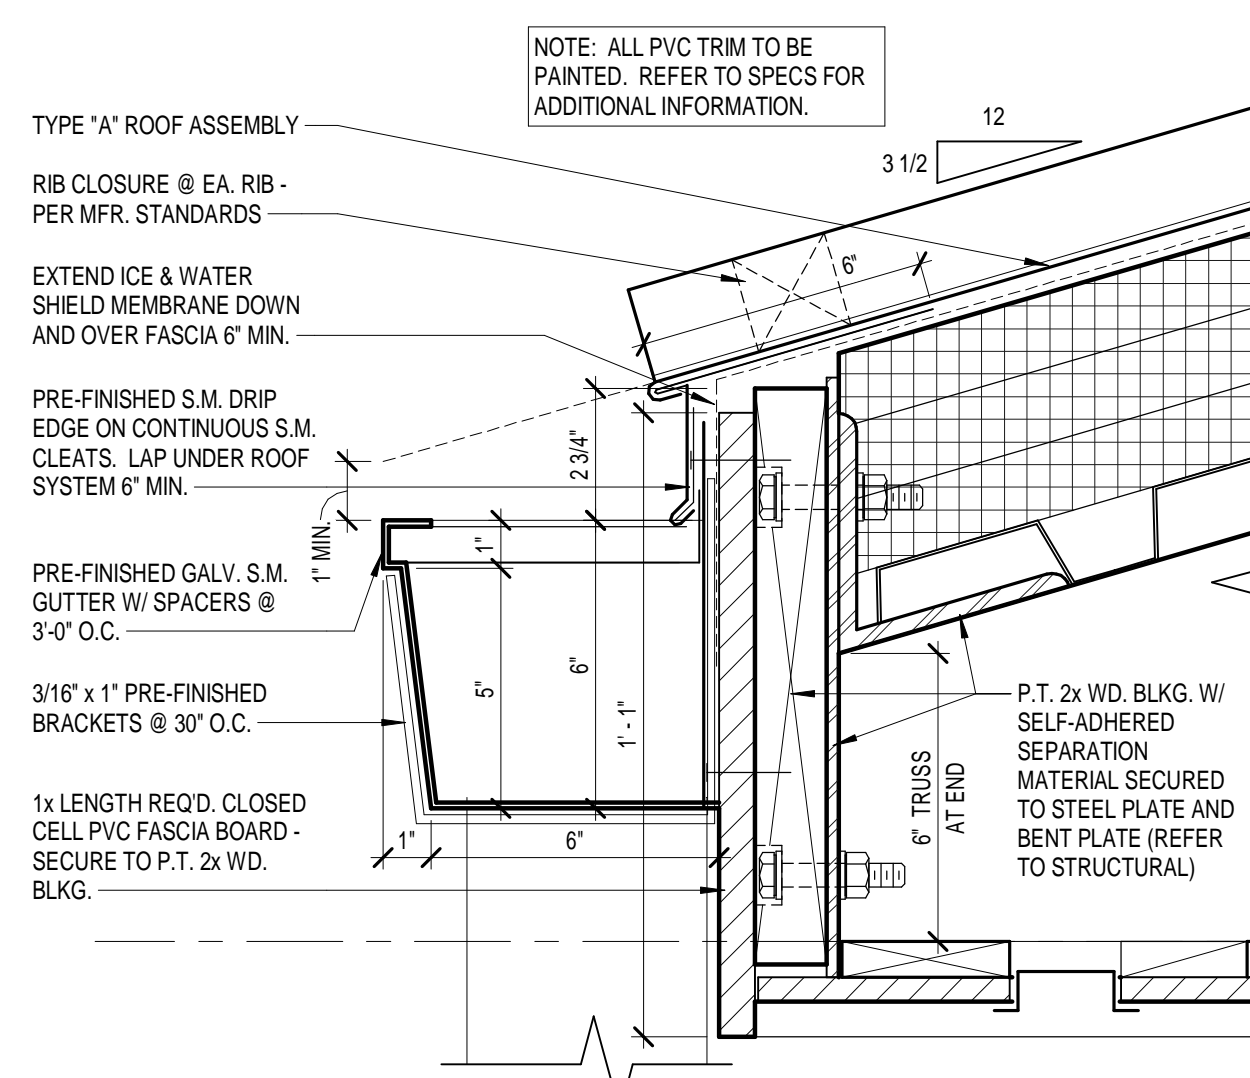


9 TYPICAL GUTTER DETAIL

3" = 1'-0"

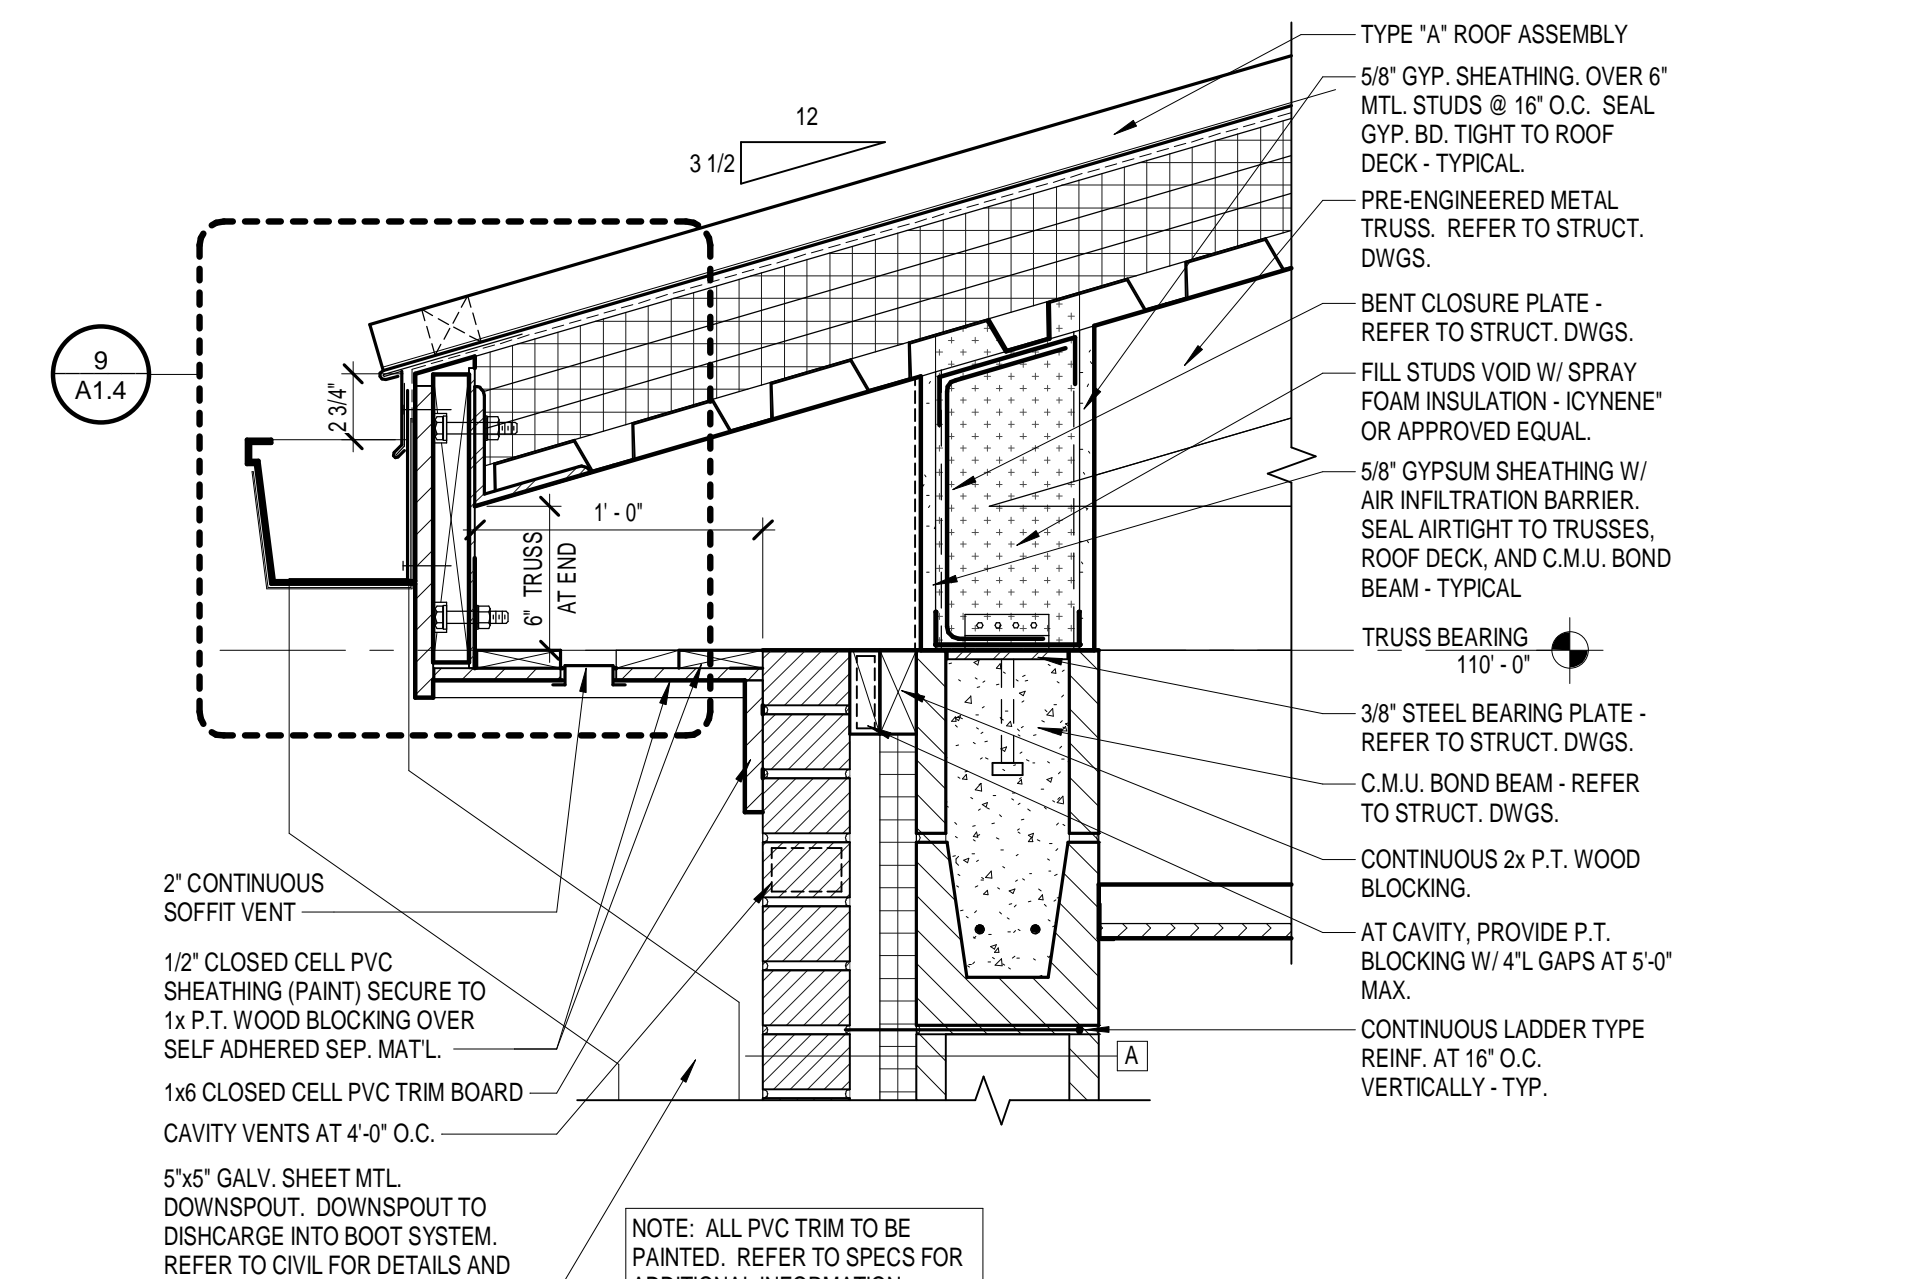


8 SECTION DETAIL

1 1/2" = 1'-0"

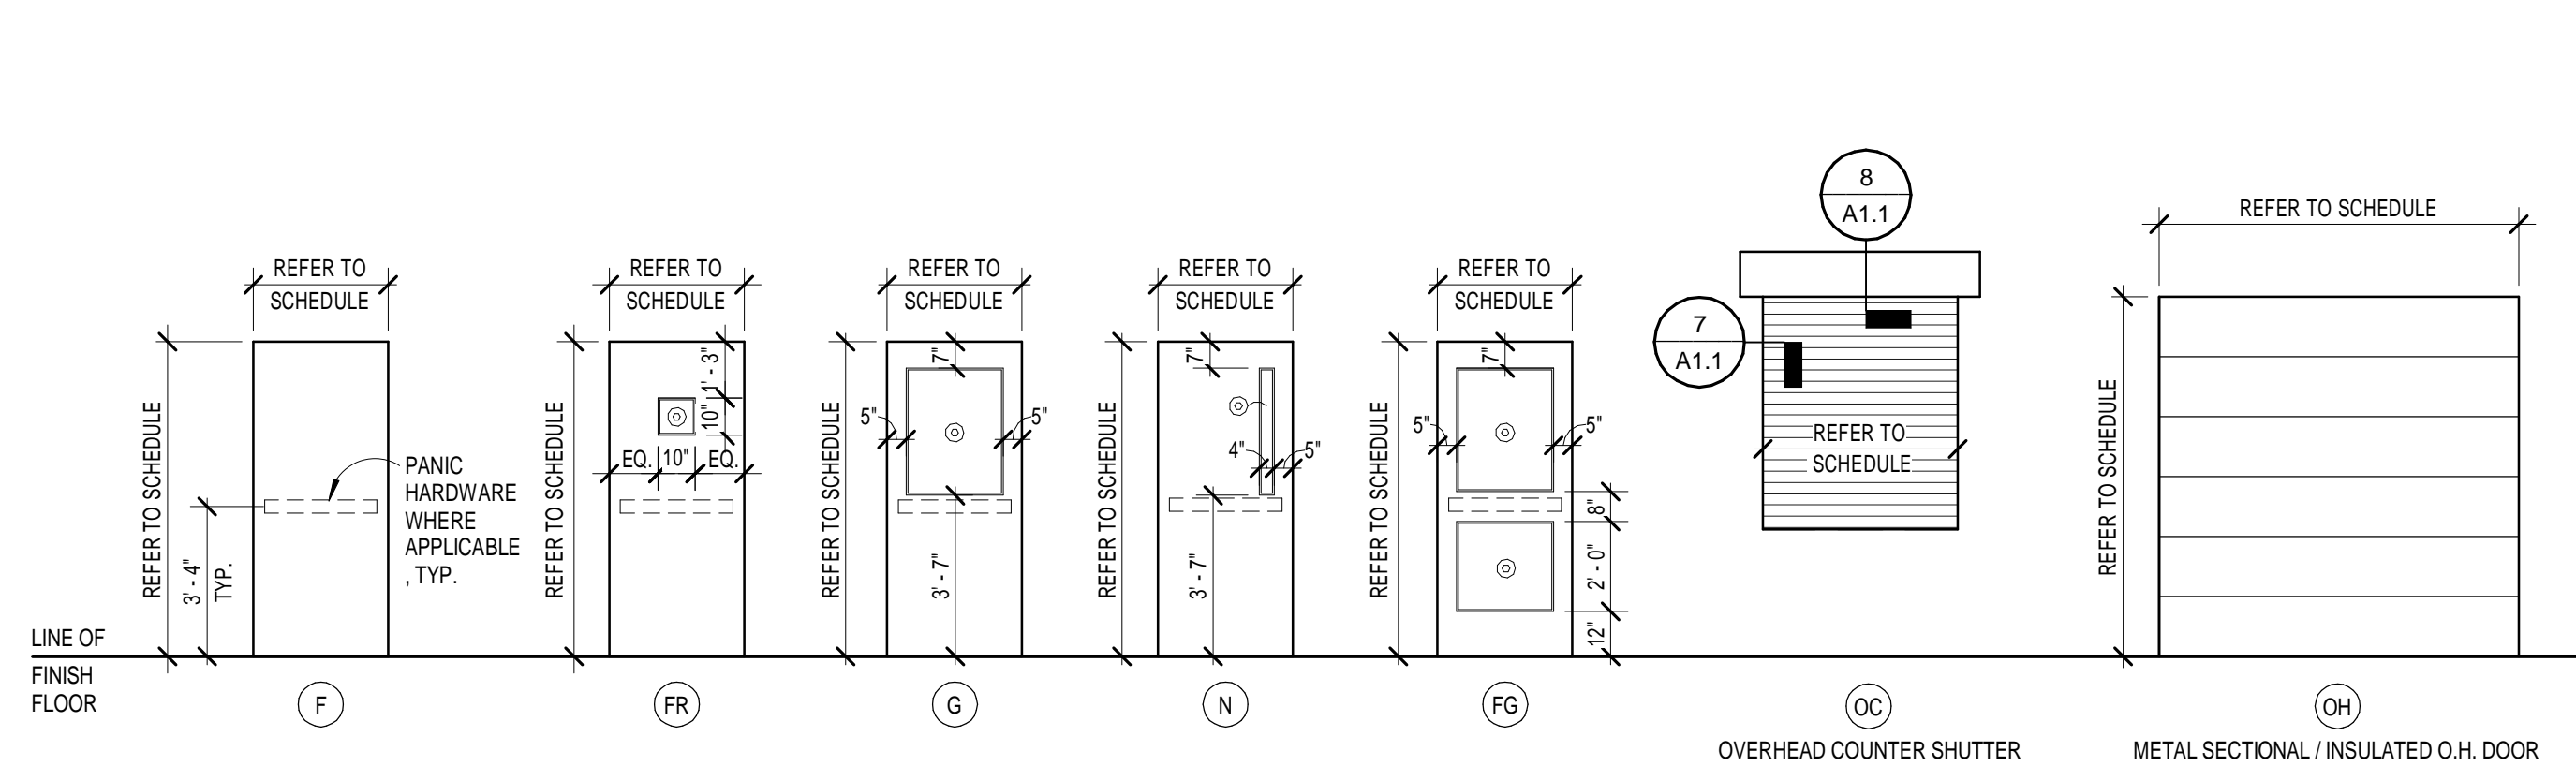


DOOR TYPES

◎ DENOTES TEMPERED GLASS

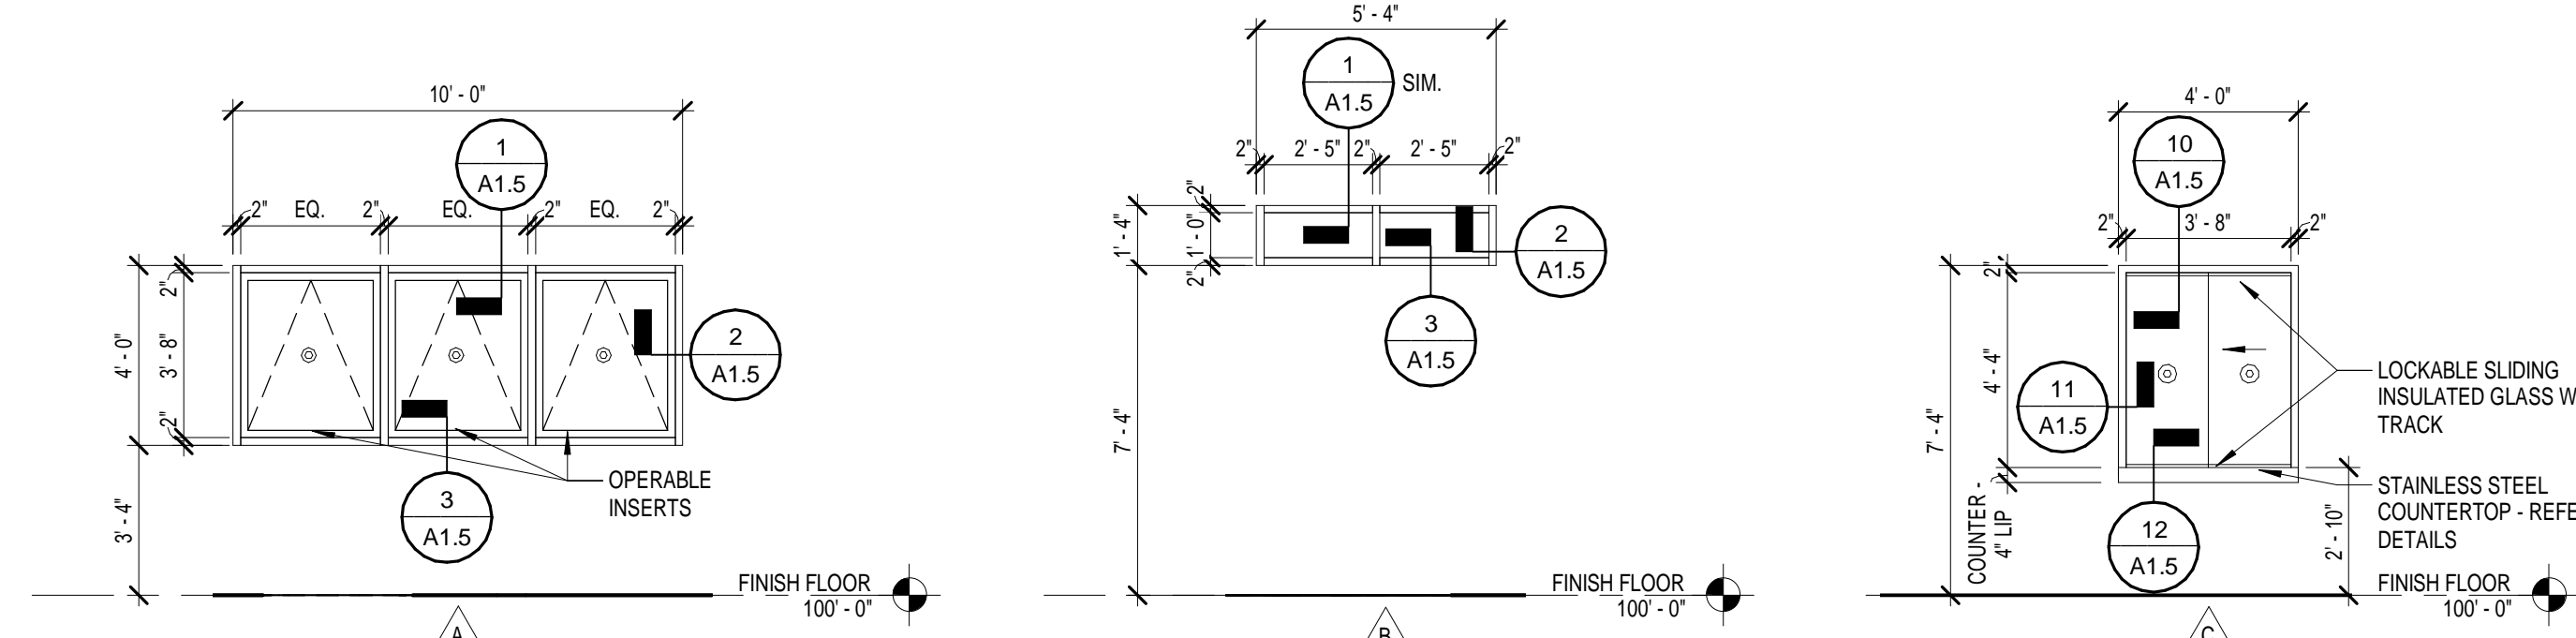


ALUMINUM FRAME TYPES




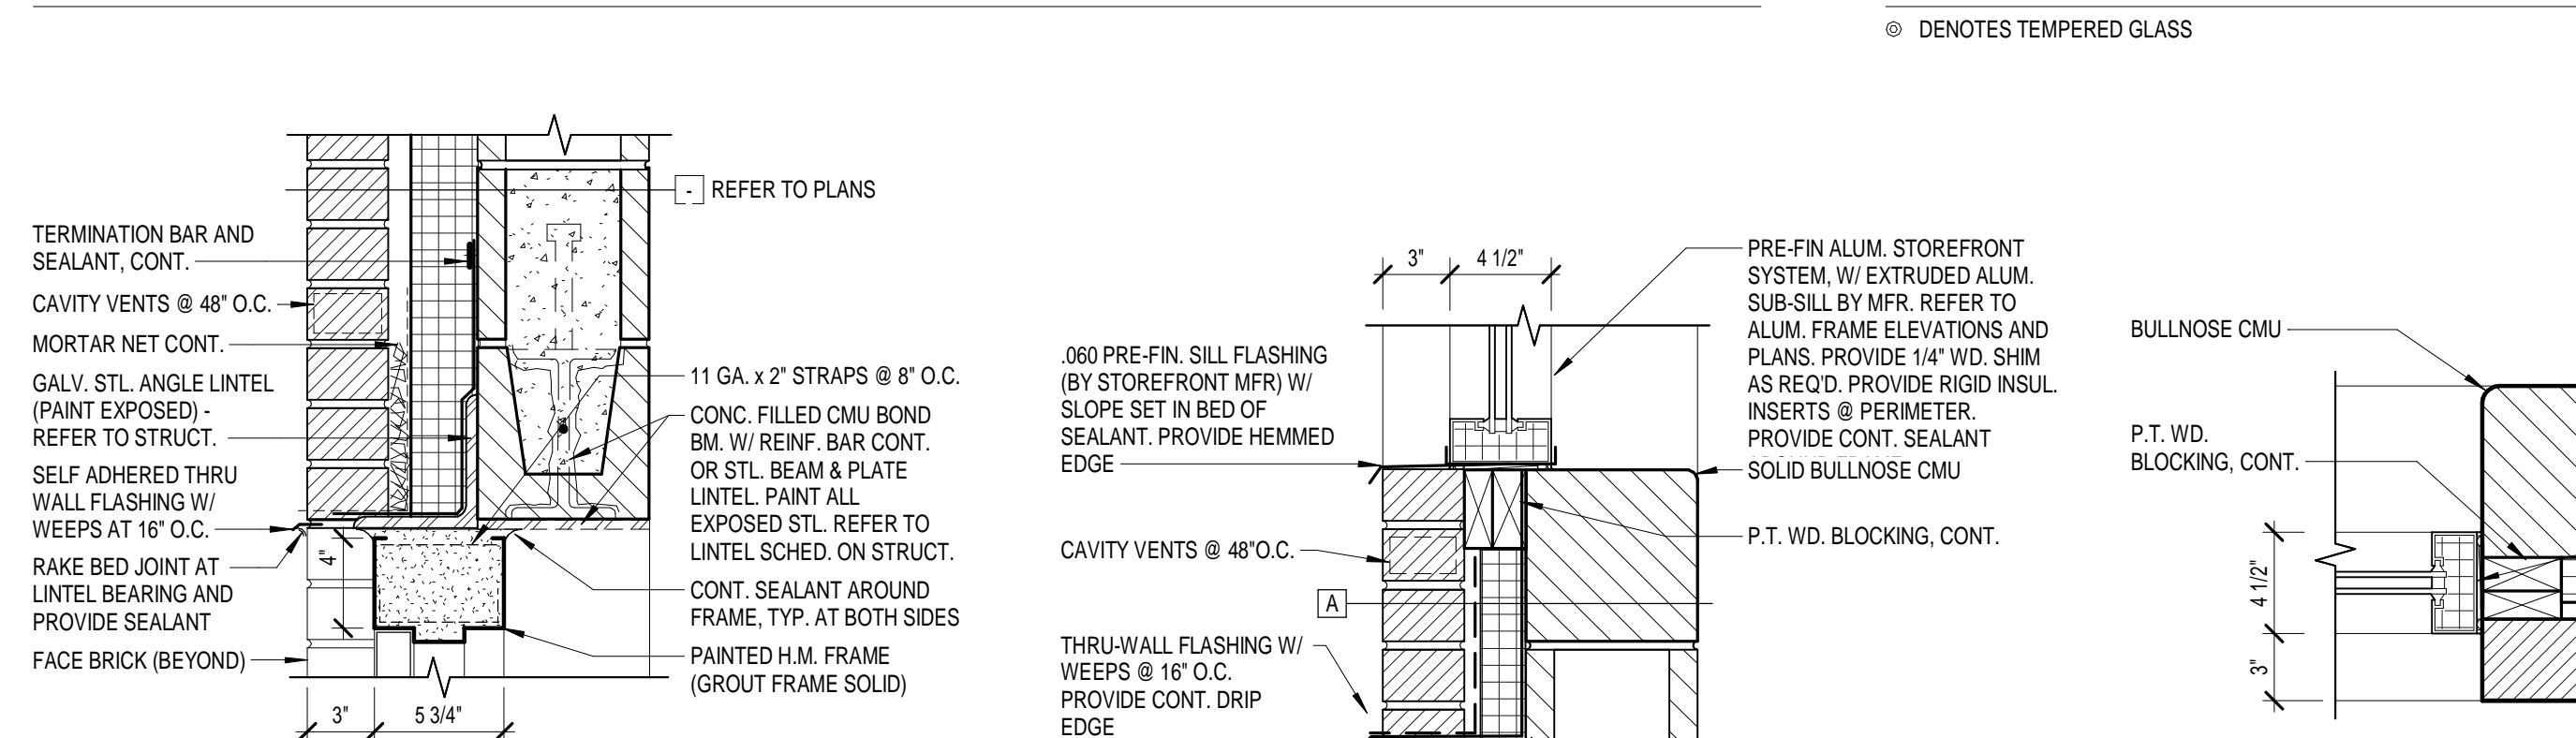


HOLLOW METAL FRAME TYPE - SLIDER WINDOW

◎ DENOTES TEMPERED GLASS

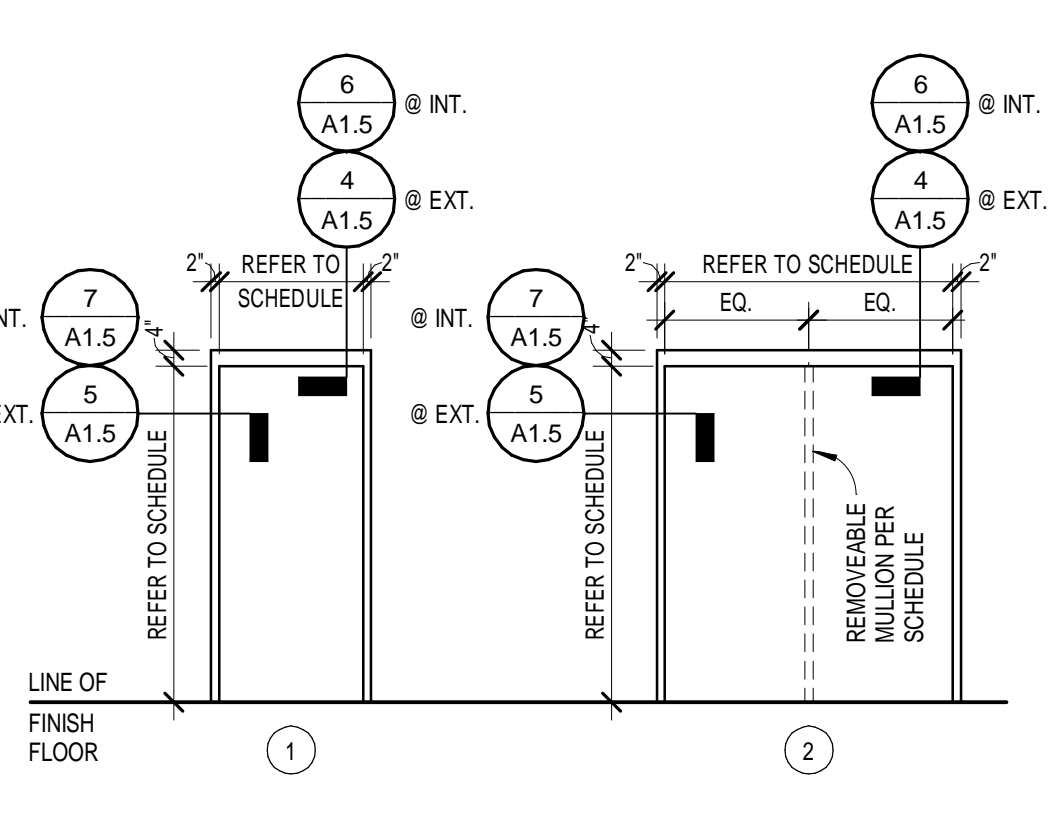

HOLLOW METAL DOOR FRAME TYPES

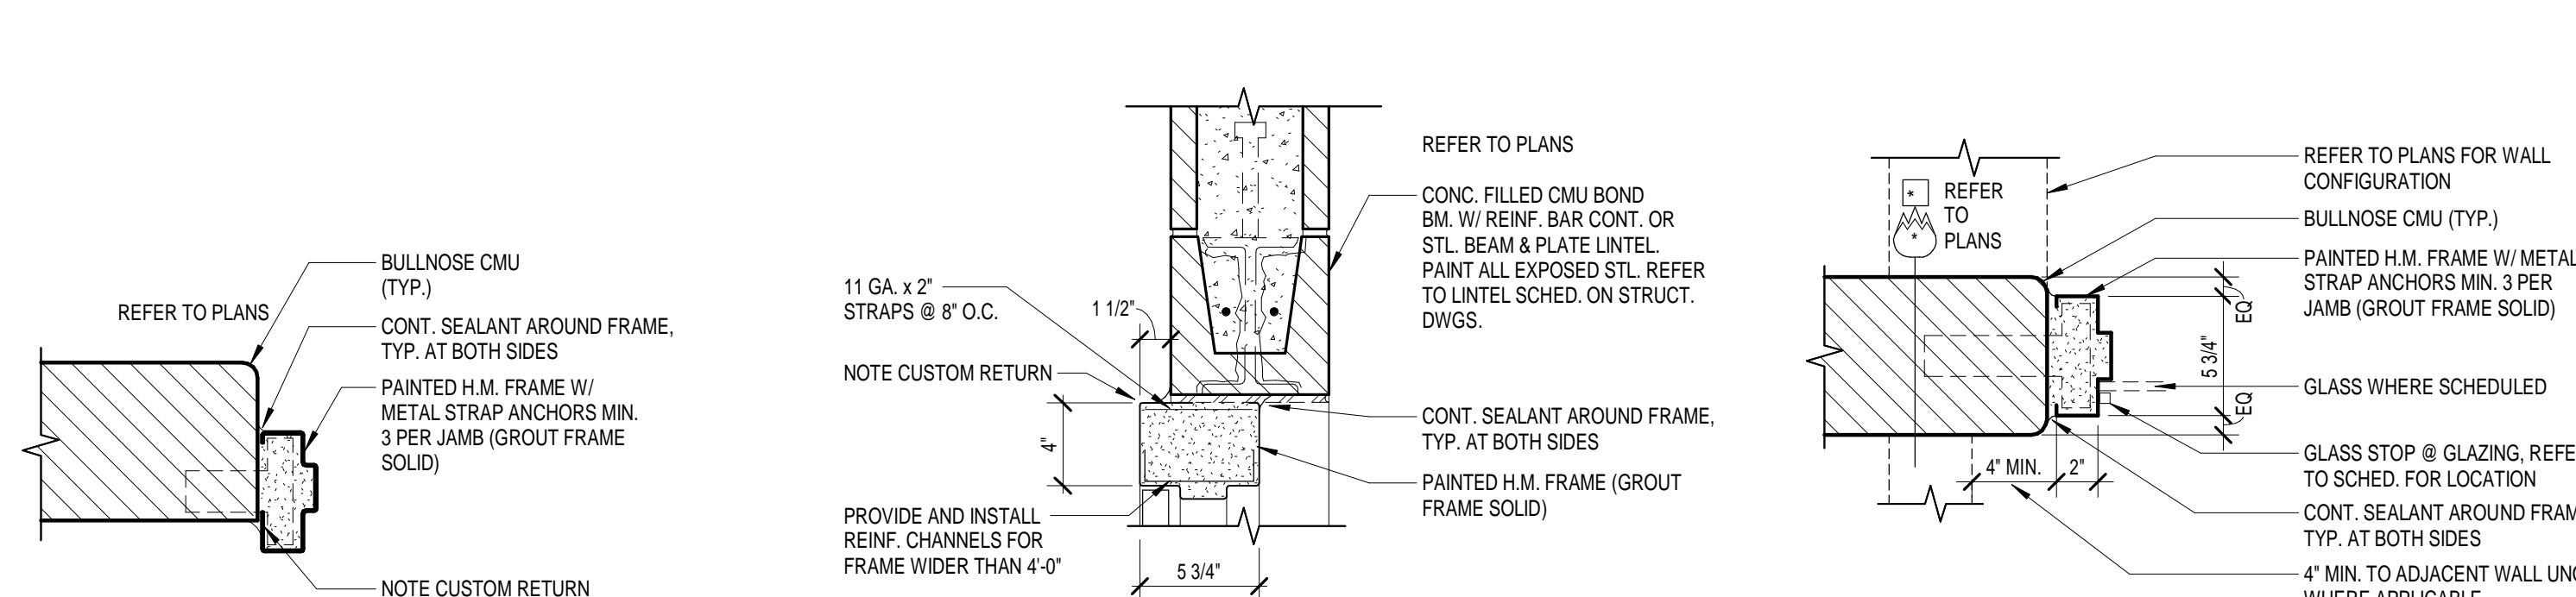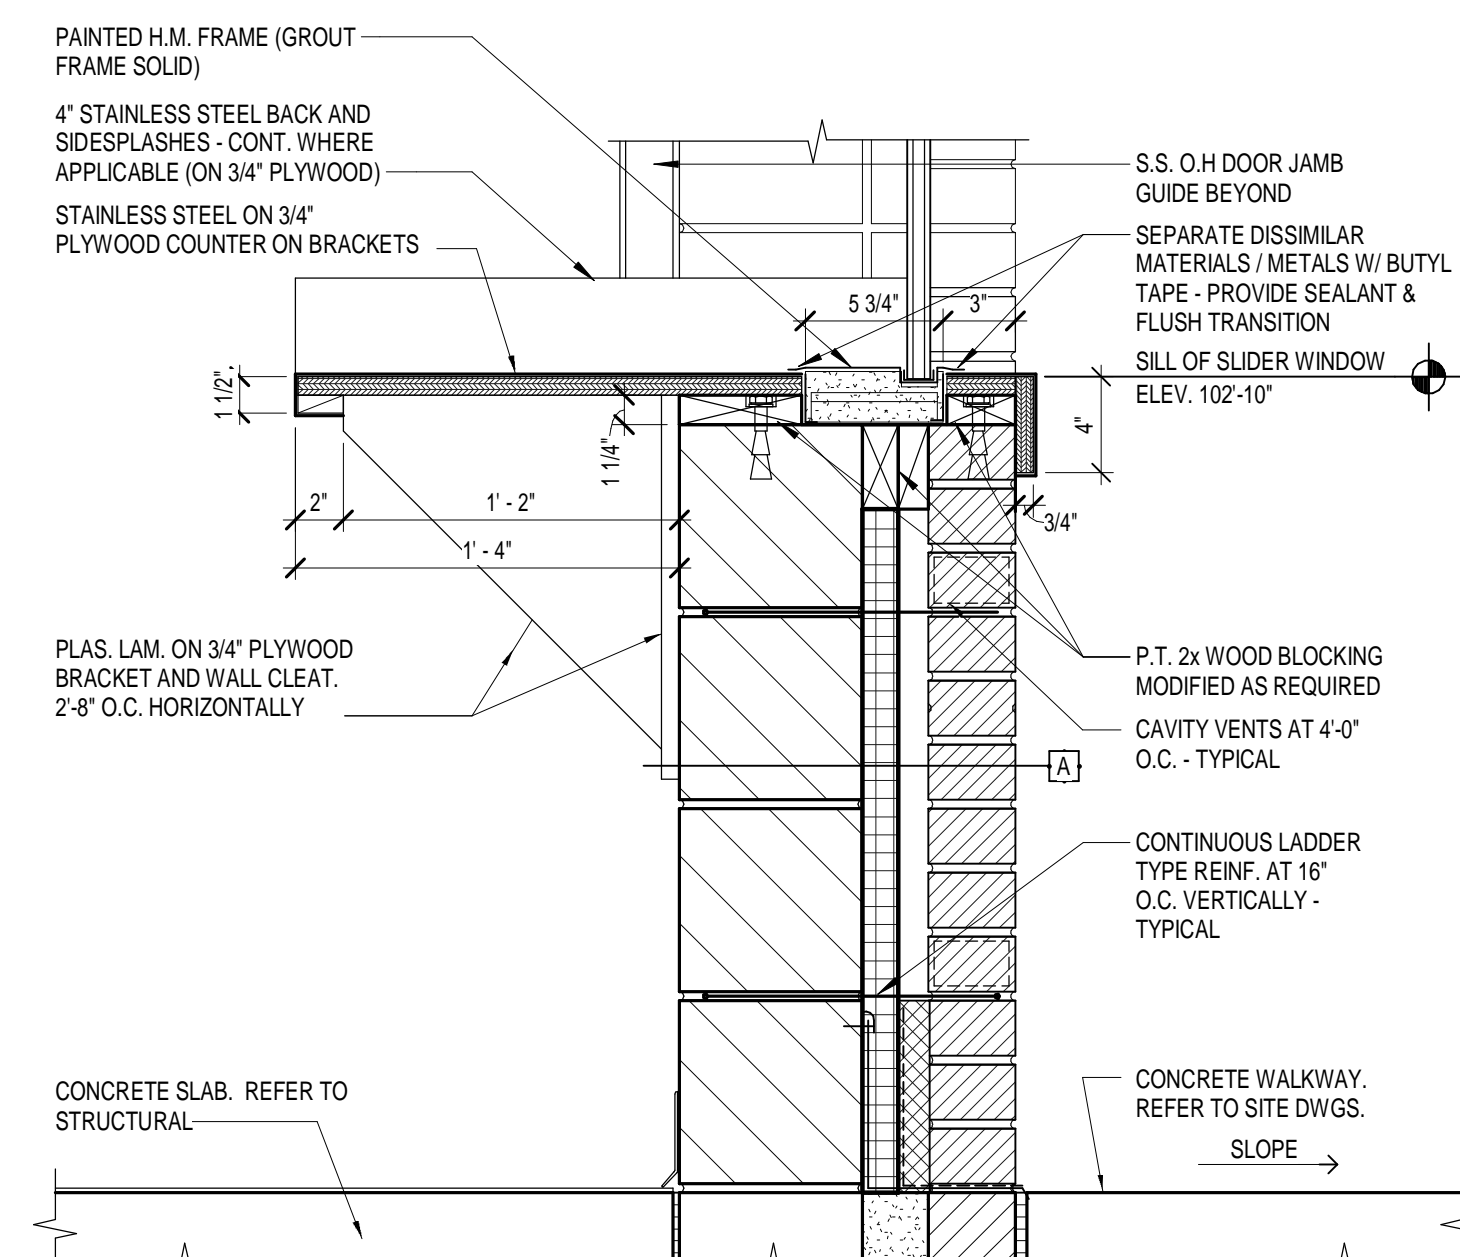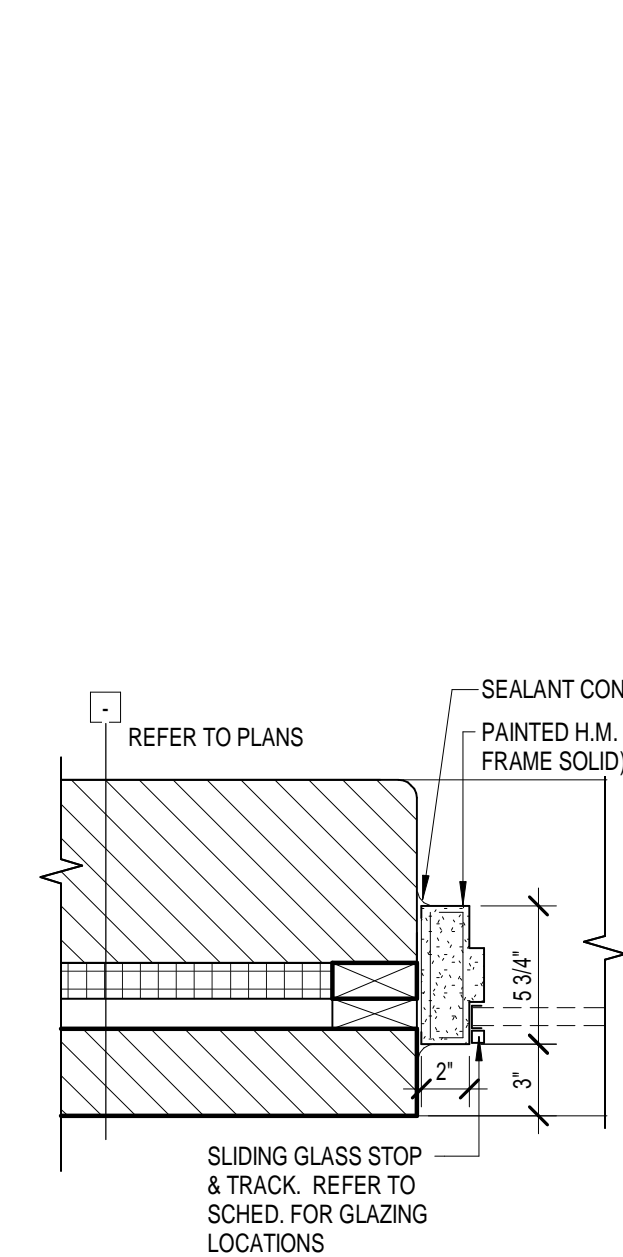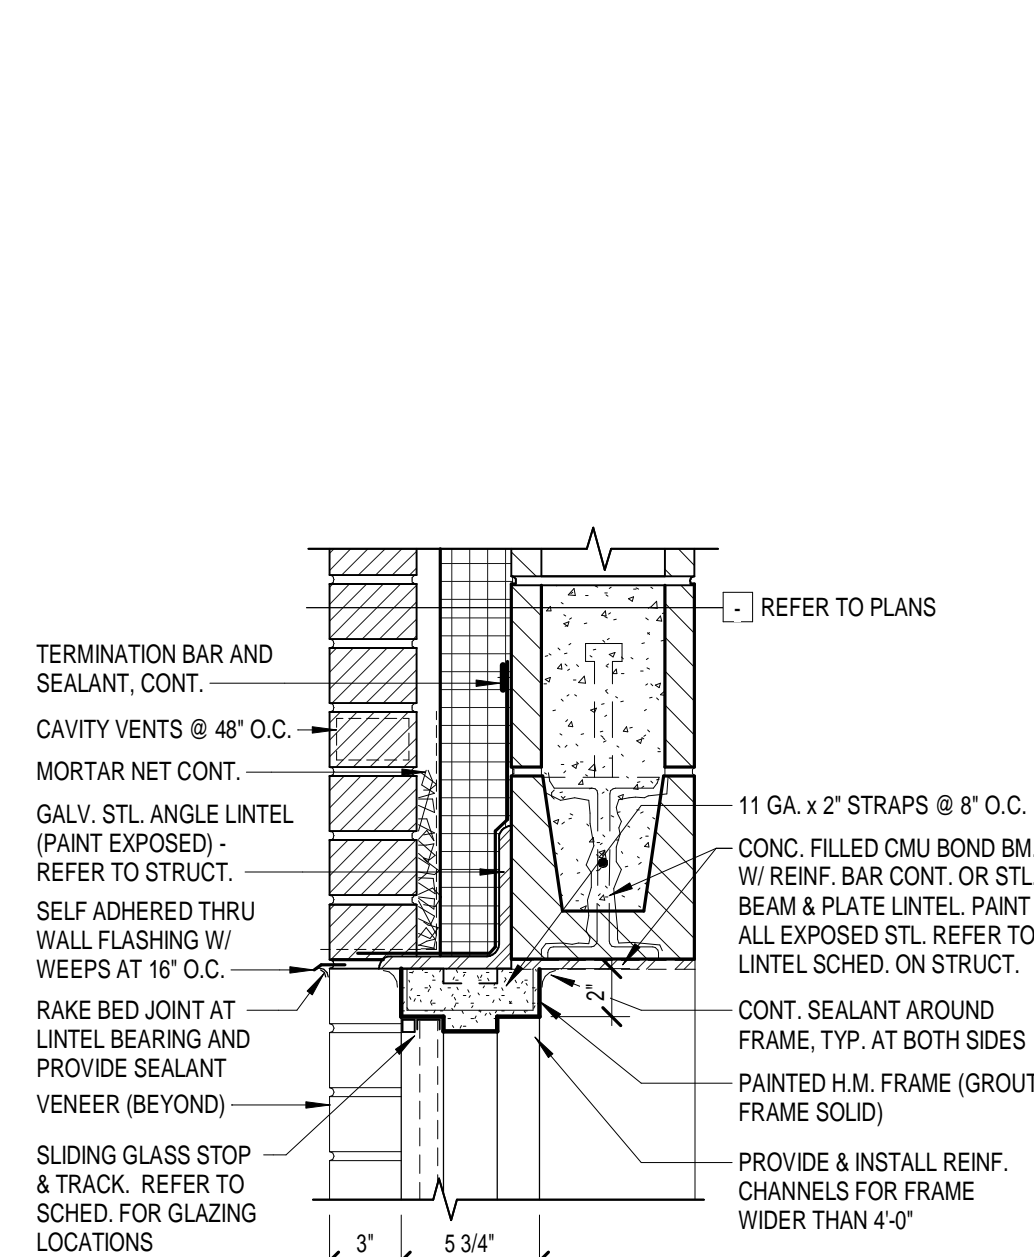4 H.M. HEAD @ CMU / CMU VENEER
1 1/2" = 1'-0"3 S.F. SILL @ CMU / CMU VENEER
1 1/2" = 1'-0"2 S.F. JAMB @ CMU / CMU VENEER
1 1/2" = 1'-0"1 S.F. HEAD @ CMU / CMU VENEER
1 1/2" = 1'-0"9 H.M. JAMB @ CMU 180 SWING
1 1/2" = 1'-0"8 H.M. HEAD @ CMU 180 SWING
1 1/2" = 1'-0"7 H.M. JAMB DTL. @ CMU
1 1/2" = 1'-0"6 H.M. HEAD DTL. @ CMU
1 1/2" = 1'-0"5 H.M. JAMB DETAIL @ CMU / CMU VENEER
1 1/2" = 1'-0"12 H.M. SLIDER WIN. SILL / COUNTERTOP DTL.
1 1/2" = 1'-0"11 H.M. SLIDER WIN. JAMB @ CMU / CMU VENEER
1 1/2" = 1'-0"10 H.M. SLIDER WIN. HEAD @ CMU / CMU VENEER
1 1/2" = 1'-0"

DOOR SCHEDULE - EXTERIOR													
NO.	DOOR				FRAME				FIRE RATING	CLOSER DEG.			Remarks
	LEAVES	LEAF WIDTH	HT.	MATL.	TYPE	GLAZING	MATL.	TYPE	GLAZING				
E101	2	3'-0"	7'-0"	H.M.	F	-	H.M.	2	-	-	105	1, 2, 3, 4, 5, 6	
E102A	1	3'-0"	7'-0"	H.M.	N	1" INSUL.	H.M.	1	-	-	105	1, 2, 4, 5	
E102B	1	4'-0"	4'-8"	STEEL	OC	-	STEEL	-	-	-	-	4, 12, COILING COUNTER SHUTTER	
E102C	1	4'-0"	4'-8"	STEEL	OC	-	STEEL	-	-	-	-	4, 12, COILING COUNTER SHUTTER	
E102D	1	9'-2"	7'-1"	-	-	-	-	-	-	-	-	-	
E103A	2	3'-0"	7'-0"	H.M.	FG	1" INSUL.	H.M.	2	-	-	90	1, 2, 3, 4, 5, 6, 7	
E103B	2	3'-0"	7'-0"	H.M.	FG	1" INSUL.	H.M.	2	-	-	90	1, 2, 3, 4, 5, 6, 7	
E104	2	3'-0"	7'-0"	H.M.	F	-	H.M.	2	-	-	90	1, 2, 3, 4, 5, 6, 7, 8	
E108	1	3'-0"	7'-0"	H.M.	F	-	H.M.	1	-	-	105	1, 2, 5, 8	
E111A	1	3'-0"	7'-0"	H.M.	FG	1" INSUL.	H.M.	1	-	-	105	1, 2, 5	
E111B	1	3'-0"	7'-0"	H.M.	FG	1" INSUL.	H.M.	1	-	-	105	1, 2, 5	
E113	1	3'-0"	7'-0"	H.M.	F	-	H.M.	1	-	-	105	1, 2, 5	
E115	1	3'-0"	7'-0"	H.M.	F	-	H.M.	1	-	-	105	1, 2, 5	
E116	1	3'-0"	7'-0"	H.M.	N	1" INSUL.	H.M.	1	-	-	105	1, 2, 5, 8	
E123A	1	8'-0"	7'-4"	STEEL	OH	1" INSUL.	STEEL	-	-	-	-	4, 12, 13, MTL. INSULATED OVERHEAD DOOR	
E123B	1	8'-0"	7'-4"	STEEL	OH	1" INSUL.	STEEL	-	-	-	-	4, 12, 13, MTL. INSULATED OVERHEAD DOOR	
E129	1	3'-0"	7'-0"	H.M.	N	1" INSUL.	H.M.	1	-	-	105	1, 2, 5, 8	

DOOR SCHEDULE - INTERIOR													
NO.	DOOR				FRAME				FIRE RATING	CLOSER DEG.			Remarks
	LEAVES	LEAF WIDTH	HT.	MATL.	TYPE	GLAZING	MATL.	TYPE	GLAZING				
		3'-0"	7'-0"										
		3'-0"	7'-0"										
100	1	3'-0"	7'-0"	H.M.	G	1/4"	H.M.	1	-	-	-		
104	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	105		
105	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
106	2	3'-0"	7'-0"	H.M.	F		H.M.	2	-	-	-	6	
107A	1	3'-0"	7'-0"	H.M.	G	1/4"	H.M.	1	-	-	-		
107B	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
108	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
110	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	90		
112	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
114	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
117	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	105		
118A	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
118B	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
119	1	3'-0"	7'-0"	H.M.	G	1/4"	H.M.	1	-	-	-		
120	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	105		
122	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	45 MIN.		
124	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	105		
126	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
127	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	105		
128A	1	3'-0"	7'-0"	H.M.	F		H.M.	1	-	-	-		
128B	1	3'-0"	7'-0"	H.M.	G	1/4"	H.M.	1	-	-	-		
C1	1	3'-0"	6'-0"	STEEL	-	-	STEEL	-	-	-	-		
C2	1	3'-0"	6'-0"	STEEL	-	-	STEEL	-	-	-	-		
C3	1	3'-0"	6'-0"	STEEL	-	-	STEEL	-	-	-	-		
C4	1	9'-6"	6'-0"	STEEL	-	-	STEEL	-	-	-	-		
C5	1	9'-6"	6'-0"	STEEL	-	-	STEEL	-	-	-	-		

DOOR SCHEDULE - TOILET COMPARTMENT DOORS (REFER TO SHEET A1.3)													
NO.	DOOR				FRAME				FIRE RATING	CLOSER DEG.			Remarks
	LEAVES	LEAF WIDTH	HT.	MATL.	TYPE	GLAZING	MATL.	TYPE	GLAZING				
T1	1	3'-0"	7'-0"	H.M.	T8/A1.3	-	H.M.	T8/A1.3	-	-	-	1, 5, 10, 11 - SEE DTLS. T4, T5, T6 SHEET A1.3	
T2	1	2'-8"	7'-0"	H.M.	T8/A1.3	-	H.M.	T8/A1.3	-	-	-	1, 5, 10, 11 - SEE DTLS. T4, T5, T6 SHEET A1.3	

REMARKS

- GALVANIZED DOOR AND FRAME.
- INSULATED DOOR AND FRAME.
- REMOVABLE MULLION.
- PROVIDE RAIN Drip ABOVE DOOR.
- PROVIDE FLUSH TOP CAP.
- PROVIDE FLUSH BOLTS ON INACTIVE LEAF.
- PROVIDE PANIC DEVICE.
- PROVIDE VIEWING PEEP HOLE AT 60" A.F.F.
- PROVIDE MANUAL HOLD OPEN DEVICES.
- PROVIDE SPRING HINGES.
- CUSTOM LOCATIONS FOR DOOR SILENCERS.
- PROVIDE MFR. STD. DETAILS AT DOORS & FRAME. SEE NOTED DTL. FOR CONDITIONS AT FRAME AND ADJACENT MATERIAL.
- FIELD VERIFY DOOR SIZE NEEDED.
- DOOR TO INCLUDE ASTRAHAL REFER TO DOOR HARDWARE.
- PROVIDE REMOTE PUSH BUTTON HARDWARE. REFER TO HARDWARE SPEC. AND ELEC. DRAWINGS.

DOOR AND FRAME NOTES:

GENERAL NOTES:

- REFER TO TYPICAL HEAD AND JAMB DETAILS ON SHEETS A7.3 UNLESS NOTED OTHERWISE.
 - REFER TO THIS SHEET AND A7.2 FOR ALUM. AND H.M. FRAME ELEVATIONS.
- HOLLOW METAL FRAME NOTES:
- PROVIDE REINFORCING CHANNEL IN FRAME HEAD AT ALL H.M. FRAMES WHERE TOTAL FRAME WIDTH IS GREATER THAN 4 FT.
 - PROVIDE 11-GA. X 2" WIDE STRAPS AT 8" O.C. IN H.M. FRAME HEADS GREATER THAN 2" IN HT., TYPICAL.
 - LINTEL BEAM LENGTH SHALL BE M.O. PLUS 16" LONG (MIN. 8" BEARING AT EACH END UNLESS NOTED OTHERWISE). LINTEL PLATE LENGTH SHALL BE M.O. LESS 1/4" LONG (1/8" AT EACH END) REFER TO STRUCTURAL DRAWINGS FOR LINTEL INFORMATION.
 - WHERE GLAZING IS SHOWN, THE FRAME FABRICATOR SHALL PRE-DRILL STOPS AND FRAME TO RECEIVE MOUNTING SCREWS. VERIFY LOCATIONS AND DEPTH OF GLAZING MATERIAL.

DOOR NOTES:


- UNDERCUT AT NON-RATED H.M. DOORS 1/2" FROM BOTTOM OF DOOR TO SCHEDULED FLOOR FINISH.
- UNDERCUT AT EXTERIOR DOORS 1/8" MAX FROM BOTTOM OF DOOR TO TOP OF THRESHOLD.
- ALL EXTERIOR HOLLOW METAL DOORS TO HAVE FLUSH CLOSURE CAPS TOP AND BOTTOM.
- PROVIDE THRESHOLDS AS REQUIRED AT DOORS. SEE TYPICAL THRESHOLD DETAILS (THIS SHEET) AND ROOM FINISH GROUPS FOR FLOOR FINISHES.

GLASS AND GLAZING NOTES:

- PROVIDE FULLY TEMPERED GLASS WHERE SHOWN ON DOOR AND FRAME TYPES. OR AS REQ'D. BY CODE.
 - ALL GLAZING AND GLAZING STOPS IN H.M. FRAMES ARE TO BE INSTALLED AT SECURE SIDE OF INTERIOR FRAMES AND INTERIOR SIDE OF ALL EXTERIOR FRAMES.
- HARDWARE NOTES:
- PROVIDE AND INSTALL ALL HARDWARE IN ACCORDANCE WITH APPLICABLE ARTICLES OF "THE AMERICANS WITH DISABILITIES ACT (A.D.A.)"
 - REFER TO HARDWARE SPEC. FOR ADDITIONAL HARDWARE REQUIREMENTS SPECIFIC TO INDIVIDUAL DOORS.

TYPICAL THRESHOLD DETAIL CONDITIONS - N.T.S.

NOTE: REFER TO ROOM FINISH GROUPS. IT IS CONTRACTOR'S RESPONSIBILITY TO MAKE SURE PROPER THRESHOLD IS USED.

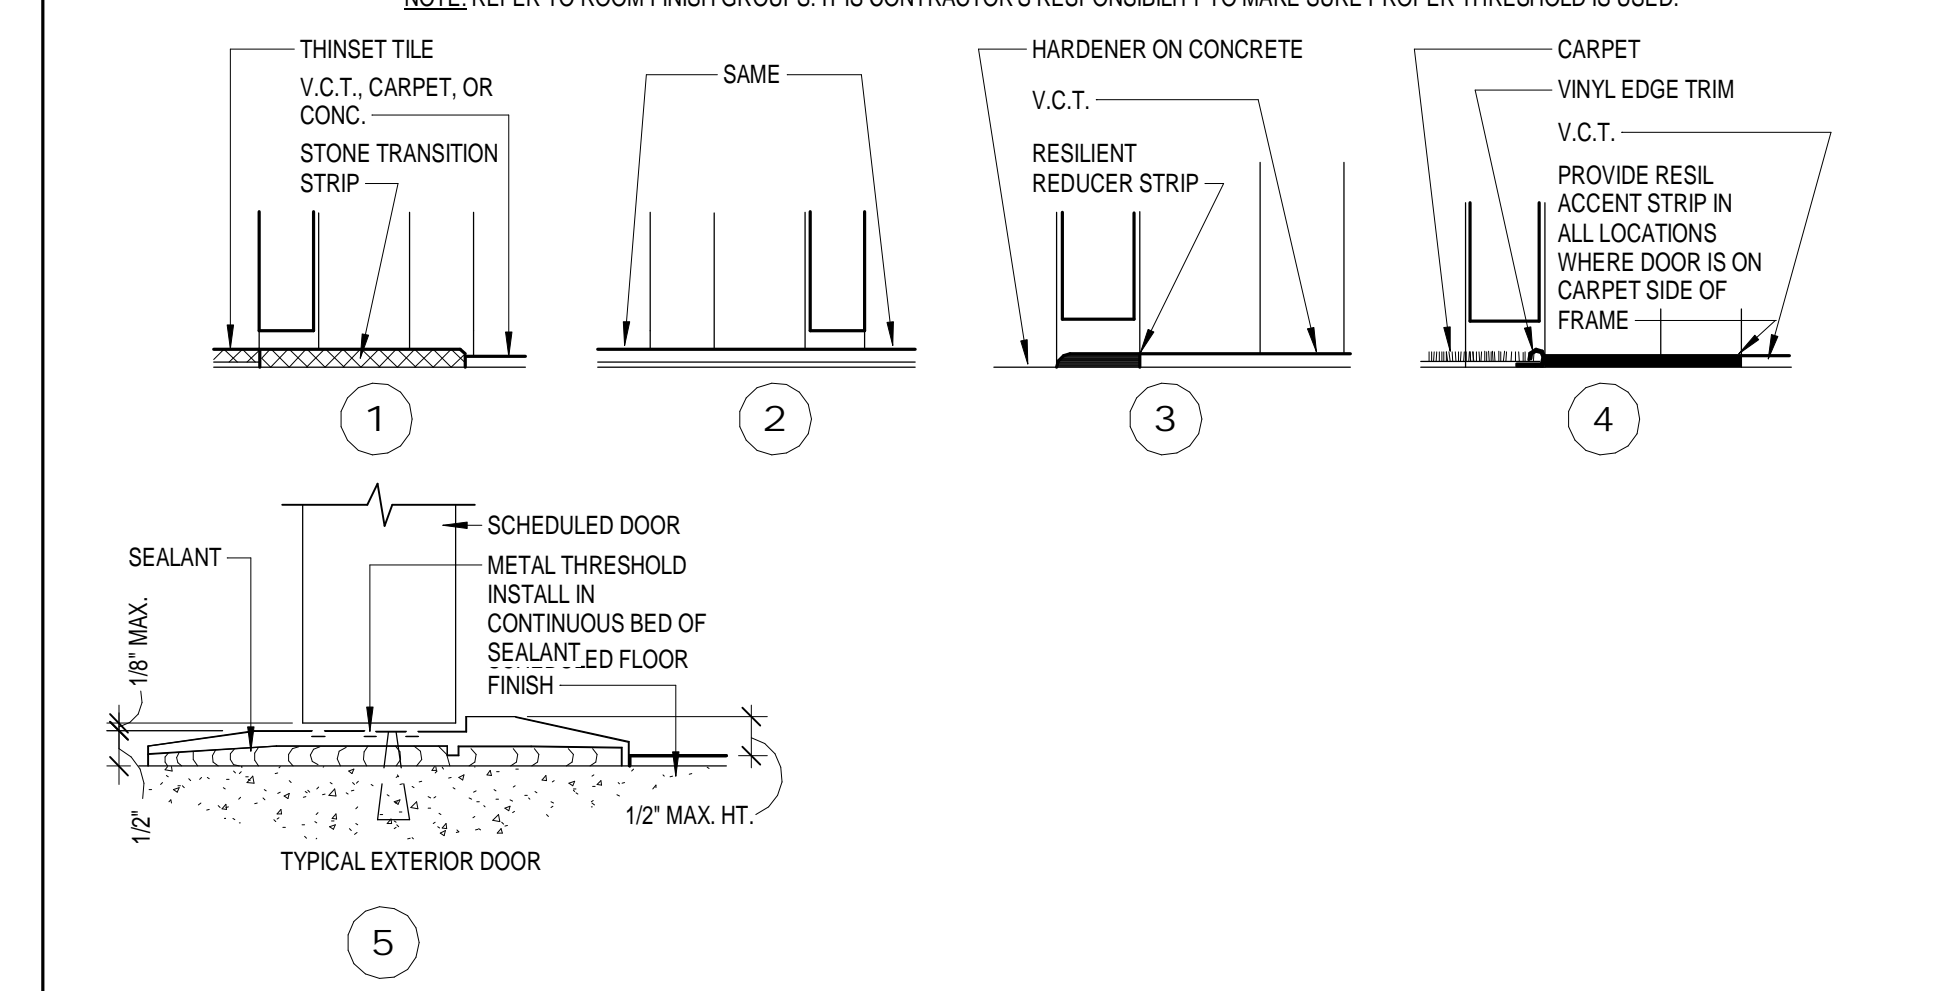

JOB NO. 1744

DATE APR 23, 2018

DRAWN ALC, ASC

CHECKED -

COPYRIGHT © 2016 SHERMAN CARTER BARNHART ARCHITECTS, PLLC

REVISIONS

No.	Description	Date

SHEET

A2.1

GENERAL DEMOLITION NOTES

- DEMOLITION REFERENCE NOTES FOR THIS PROJECT ARE INTENDED TO GENERALLY IDENTIFY THE SELECTIVE REMOVAL OF EXISTING ITEMS AT LOCATIONS WHERE REQUIRED BUT, SHALL IN NO WAY RELIEVE THE CONTRACTOR OF THE FULL RESPONSIBILITY FOR EXAMINING AND VERIFYING THE FULL EXTENT OF EXISTING CONDITIONS PRIOR TO BIDDING THE PROJECT.
 - THE INTENT OF THE DEMOLITION NOTES IS TO PROVIDE A GENERAL OUTLINE FOR THE CONTRACTOR OF ITEMS TO BE REMOVED AND TO ALLOW FOR THE NEW CONSTRUCTION AS OUTLINED ELSEWHERE IN THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMOLITION AND REMOVAL OF ITEMS TO ALLOW FOR NEW CONSTRUCTION SHOWN OR NOT SHOWN ON DEMOLITION PLANS AS MAY BE REQUIRED.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PATCHING AND REPAIRING DUE TO DEMOLITION AND/OR REMOVAL OF EQUIPMENT TO CREATE A FLUSH, SMOOTH SURFACE PROPERLY PREPARED TO RECEIVE NEW FINISHES AS INDICATED. CONTRACTOR SHALL SOAP IN NEW CMU AT HOLES AND VOIDS LARGER THAN 2" DIAM. TO MATCH EXISTING ADJACENT AREAS AND PATTERNS.
 - CAVITY WALLS AND SPACES BEHIND EXTERIOR FINISHES OR PARTIALLY REMOVED WALLS/ROOFS, ETC. SHALL BE PROTECTED FROM EXPOSURE TO WEATHER BY THE CONTRACTOR, WALLS/ROOFS, ETC. SHALL BE PROTECTED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGED WALLS, ROOFS, EQUIPMENT, ETC. CAUSED BY THIS DEMOLITION OR WEATHER EXPOSURE OF ITEMS THAT ARE TO REMAIN.
 - THE OWNER SHALL REMOVE AND ABATE ANY HAZARDOUS MATERIALS ENCOUNTERED. CONTRACTOR TO COORDINATE REMOVAL WITH OWNER.
 - REFER TO MECHANICAL AND/OR ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR SPECIFIC REQUIREMENTS PERTAINING TO THE REMOVAL, RELOCATION AND/OR MODIFICATION OF ITEMS RELATED TO EXISTING MECHANICAL AND ELECTRICAL SYSTEMS.
 - SHOULD THE CONTRACTOR ENCOUNTER ANY MATERIALS DURING SELECTIVE DEMOLITION AND NEW WORK WHICH ARE SUSPECTED BY THE CONTRACTOR TO BE OF AN UNKNOWN OR QUESTIONABLE COMPOSITION WITH RESPECT TO CONTAINING CONTAMINANTS WHICH MAY BE HAZARDOUS TO HUMAN HEALTH, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE OWNER OF SUCH FINDINGS.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER DISPOSAL OF ALL DEMOLISHED MATERIALS. ALL REMOVED MATERIALS SHALL BE DISPOSED OF, UNLESS NOTED AS "RETURNED TO OWNER".
 - INFORMATION AND DRAWINGS INCLUDED IN THESE CONTRACT DOCUMENTS PERTAINING TO EXISTING CONSTRUCTION HAVE BEEN OBTAINED FROM PARTIAL ORIGINAL DRAWINGS. THIS INFORMATION IS INCLUDED HEREIN WITH THE INTENT TO PROVIDE THE CONTRACTOR WITH A BASIC UNDERSTANDING OF EXISTING CONDITIONS. ACTUAL CONDITIONS AND DIMENSIONS MAY VARY FROM THOSE INDICATED ON ORIGINAL DRAWINGS AND REQUIRE FIELD VERIFICATION. THE CONTRACTOR MAY REVIEW THE ENTIRE SET OF ORIGINAL DRAWINGS ON FILE AT THE ARCHITECT'S OFFICE.
 - MULTIPLE AREAS IN THE EXISTING BUILDING WILL HAVE ME WORK AND REQUIRE SELECTIVE DEMOLITION. COORDINATE DEMOLITION WITH ME DOCUMENTS.
 - WHERE AN EXISTING MASONRY WALL IS REMOVED AND NO NEW WALL IS SHOWN TO BE INSTALLED, REMOVE EXISTING WALL TO 8" BELOW ADJACENT FLOOR SLAB. PATCH AND REPAIR SLAB AS REQUIRED FOR INSTALLATION OF NEW FLOOR FINISH. REFER TO NEW WORK PLANS.
 - ALL AREAS LEFT EXPOSED AS A RESULT OF DEMOLITION AND/OR EQUIPMENT REMOVAL SHALL BE PATCHED AND REPAIRED TO RESULT IN A FLUSH SMOOTH SURFACE PREPARED TO RECEIVE NEW FINISHES AS SCHEDULED.
 - ANY AREAS/OPENINGS IN MASONRY WALLS LARGER THAN 2" EXPOSED TO VIEW SHALL BE PATCHED WITH SOAPED IN MASONRY UNITS TOOTHED-IN INTO EXISTING MASONRY TO MATCH IN PATTERN/CURSING AND FINISH.
 - REFER TO MEP DRAWINGS FOR NEW WORK WHICH MAY REQUIRE DEMOLITION WORK IN ADDITION TO ITEMS NOTED ON THE ARCHITECTURAL DRAWINGS ALL SUCH WORK SHALL BE PERFORMED BY THE CONTRACTOR.
 - CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS, MEASURES, ETC. REQUIRED TO COLLECT/DIVERT RAIN WATER FROM BUILDING AND ROOF DURING DEMOLITION AND INSTALLATION OF NEW WORK.
 - GENERAL CONTRACTOR TO DEMOLISH ALL LIGHTS PER ELECTRICAL DRAWINGS. MERCURY LIGHTS AND PCB LADEN BALLAST ARE TO BE DISPOSED OF PROPERLY INTO AN EPA APPROVED LANDFILL.
 - SELECTIVELY DEMOLISH EXISTING CONCRETE SLABS AS REQUIRED FOR INSTALLATION OF NEW WALLS, COLUMNS, SYSTEMS, UTILITIES ETC. REFER TO ARCHITECTURAL, STRUCTURAL AND MEP DRAWINGS.
- DEMOLITION TRENCH EXISTING SLABS AS REQUIRED TO INSTALL NEW WORK. PATCH BACK SLAB FOR FLUSH, CONTINUOUS FINISH WITHOUT HUMPS OR IMPERFECTIONS OUT OF TOLERANCE FOR NEW CONCRETE SLAB. INSTALL NEW LEVELING COMPOUND AS REQUIRED TO ACHIEVE REQUIRED CONCRETE SLAB TOLERANCE PRIOR TO INSTALLATION OF NEW FLOOR FINISHES.

HAZARDOUS MATERIAL NOTES

- IN THE EXISTING BUILDING, IT IS POSSIBLE HAZARDOUS MATERIALS MAY EXIST, INCLUDING, BUT NOT LIMITED TO ASBESTOS PRODUCTS, POLYCHLORINATED BIPHENYL (PCB) AND OTHER TOXIC SUBSTANCES. IF ANY WORK PERSON ENCOUNTERS ANY MATERIAL WHICH THEY SUSPECT MIGHT BE HAZARDOUS OR TOXIC, THEY SHALL IMMEDIATELY ADVISE THE OWNER. THE CONTRACTOR SHALL TAKE IMMEDIATE AND APPROPRIATE ACTION TO PROTECT THE BUILDING USERS AND WORKERS IN ACCORDANCE WITH FEDERAL, STATE AND LOCAL LAWS, CODES AND REGULATIONS. THE ARCHITECT AND ARCHITECT'S CONSULTANTS SHALL HAVE NO RESPONSIBILITY FOR THE DISCOVERY, PRESENCE, HANDLING, REMOVAL OR DISPOSAL OF OR EXPOSURE OF PERSONS TO HAZARDOUS MATERIALS IN ANY FORM AT THE PROJECT SITE, INCLUDING BUT NOT LIMITED TO ASBESTOS, ASBESTOS PRODUCTS, POLYCHLORINATED BIPHENYL (PCB) OR OTHER TOXIC SUBSTANCES.
- THE CONTRACTOR IS HEREBY ADVISED THAT SHERMAN-CARTER-BARNHART, PLLC IS NOT A DESIGN PROFESSIONAL IN THE DETERMINATION OF THE PRESENCE OF HAZARDOUS MATERIALS, NOR IS SHERMAN-CARTER-BARNHART, PLLC A DESIGN PROFESSIONAL INVOLVED IN MAKING RECOMMENDATIONS REGARDING THE TESTING, REMOVAL, ENCAPSULATION OR OTHER CORRECTIVE MEASURES PERTAINING TO HAZARDOUS MATERIALS.
- IF THE WORK WHICH IS TO BE PERFORMED UNDER THE CONTRACT INTERFACES IN ANY WAY WITH THE EXISTING COMPONENTS WHICH CONTAIN HAZARDOUS MATERIALS, IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONTACT THE OWNER'S ENVIRONMENTAL CONSULTANT REGARDING THE PROPER MEANS AND METHODS TO BE UTILIZED IN DEALING WITH HAZARDOUS MATERIALS.
- BY EXECUTION OF THE CONTRACT FOR CONSTRUCTION, THE CONTRACTOR HEREBY AGREES TO BRING NO CLAIM FOR NEGLIGENCE, BREACH OF CONTRACT, INDEMNITY OR OTHERWISE AGAINST THE ARCHITECT, HIS PRINCIPALS, EMPLOYEES, AGENTS OR CONSULTANTS IF SUCH A CLAIM IN ANY WAY WOULD INVOLVE THE INVESTIGATION OF OR REMEDIAL WORK RELATED TO HAZARDOUS MATERIALS IN THE PROJECT.
- BY EXECUTION OF THE CONTRACT FOR CONSTRUCTION, THE CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD THE ARCHITECT, HIS PRINCIPALS, EMPLOYEES, AGENTS AND CONSULTANTS HARMLESS FROM ANY SUCH ASBESTOS OR OTHER HAZARDOUS MATERIALS RELATED CLAIMS THAT MAY BE BROUGHT BY THE CONTRACTOR'S SUBCONTRACTORS, SUPPLIERS OR OTHER THIRD PARTIES WHO MAY BE ACTING UNDER THE DIRECTION OF THE CONTRACTOR PURSUANT TO THIS PROJECT.
- ASBESTOS HAZARDOUS MATERIAL NOTICE - PER OWNERS ABATEMENT CONSULTANT CONTAINING INSULATION IS PRESENT ON THE EXISTING HOT WATER HEAT AND DOMESTIC WATER LINES. UNDER NO CIRCUMSTANCES SHOULD THE CONTRACTOR OR SUBCONTRACTOR DISTURB OR DAMAGE THIS INSULATION MATERIAL. IN THE EVENT OF AN ACCIDENTAL DISTURBANCE OR DAMAGE TO THIS ASBESTOS-CONTAINING INSULATION MATERIAL, THE CONTRACTOR OR SUBCONTRACTOR MUST IMMEDIATELY NOTIFY THE CLIENT AND BUILDING OWNER OF THIS EVENT. IN THE EVENT THAT A CONTRACTOR OR SUBCONTRACTOR DISTURBS OR DAMAGES ASBESTOS-CONTAINING MATERIALS, THE CONTRACTOR OR SUBCONTRACTOR WILL BE HELD RESPONSIBLE FOR APPROPRIATE COSTS ASSOCIATED WITH REMEDIAL ACTIONS.

DEMOLITION KEYNOTES

- REMOVE EXISTING DOOR, HARDWARE AND FRAME IN THEIR ENTIRETY.
- REMOVE EXISTING WINDOW IN ITS ENTIRETY. PREPARE OPENING AS REQUIRED TO SCHEDULED NEW FINISHES OR INFL.
- REFER TO CIVIL DRAWINGS FOR ALL SITE RELATED DEMOLITION WORK, INCLUDING SIDEWALKS, CURBS, ETC. ALSO REFER TO MEP FOR RELATED SITE DEMOLITION WORK.
-

NEW WORK KEYNOTES

NOTE: NOT ALL KEYNOTES MAY APPLY TO THIS SHEET

- CEILING MOUNTED PROJECTOR ABOVE (N.I.C.) REFER TO ELECTRICAL DWGS. FOR ROUGH IN REQUIREMENTS.
- 1" FOAM ROD & SEALANT EXPANSION JOINT
- TOOTH IN NEW C.M.U. AT JAMB AS REQUIRED FOR NEW DOOR AND FRAME INSTALLATION.
- TOOTH IN NEW MASONRY INFL. PATCH AND REPAIR EXISTING ADJACENT MASONRY FOR "LIKE NEW" APPEARANCE (PAINT).
- FURNITURE AND/OR EQUIPMENT - N.I.C.
- LINE OF CANOPY ABOVE, REFER TO DETAIL B42.3.



ROOF PLAN KEYNOTES

- 5' x 5' PRE-FINISHED METAL DOWNSPOUT
- 6' x 6' PRE-FINISHED METAL GUTTER - SEE DETAIL B3A2.1
- PRE-FINISHED MTL COPING - REFER TO DETAILS AND TYP. DTL A2.1
- REWORK EXISTING METAL FASCIA AND PROVIDE NEW TRIM FOR TRANSITION TO NEW CONSTRUCTION AS REQ'D.
- ROOF CRICKET - SEE GENERAL ROOF NOTE NO. 2
- PRE-MANUFACTURED ALUMINUM CANOPY - REFER TO DETAIL B42.1 FOR TYPICAL DEPTH, LENGTH INDICATED ON PLAN.


SYMBOLS LEGEND

CLASSROOM	ROOM FINISH GROUPS (REFER TO SHEET NO.1)
100 1	ROOM NUMBER
X	DOOR NUMBER (DOOR SCHEDULE SHEET A8.1)
◇	NEW WORK KEY NOTES (SHEETS A1.11 THROUGH A2.4)
X	WALL TYPE (SCHEDULE SHEET NO.1)
△	ALUMINUM OR HOLLOW METAL WINDOW OR STOREFRONT TYPE (REFER TO FLOOR PLANS AND SCHEDULE SHEETS A8.1-A8.2)
X	TOILET ACCESSORIES (SCHEDULE SHEET A2.5)
X	ELEVATION KEY NOTE (SHEETS A3.1-A3.3)
X	ROOF KEY NOTE (SHEET A4.1)
X	CEILING PLAN KEY NOTE (SHEETS A7.11-A7.21)
X	SIGNAGE KEY NOTE (SHEET A8.21)
X	ROOM / WALL DESIGNATION EPW2 2 HOUR EXISTING FIRE WALL EPB2 2 HOUR EXISTING FIRE BARRIER


KEY PLAN

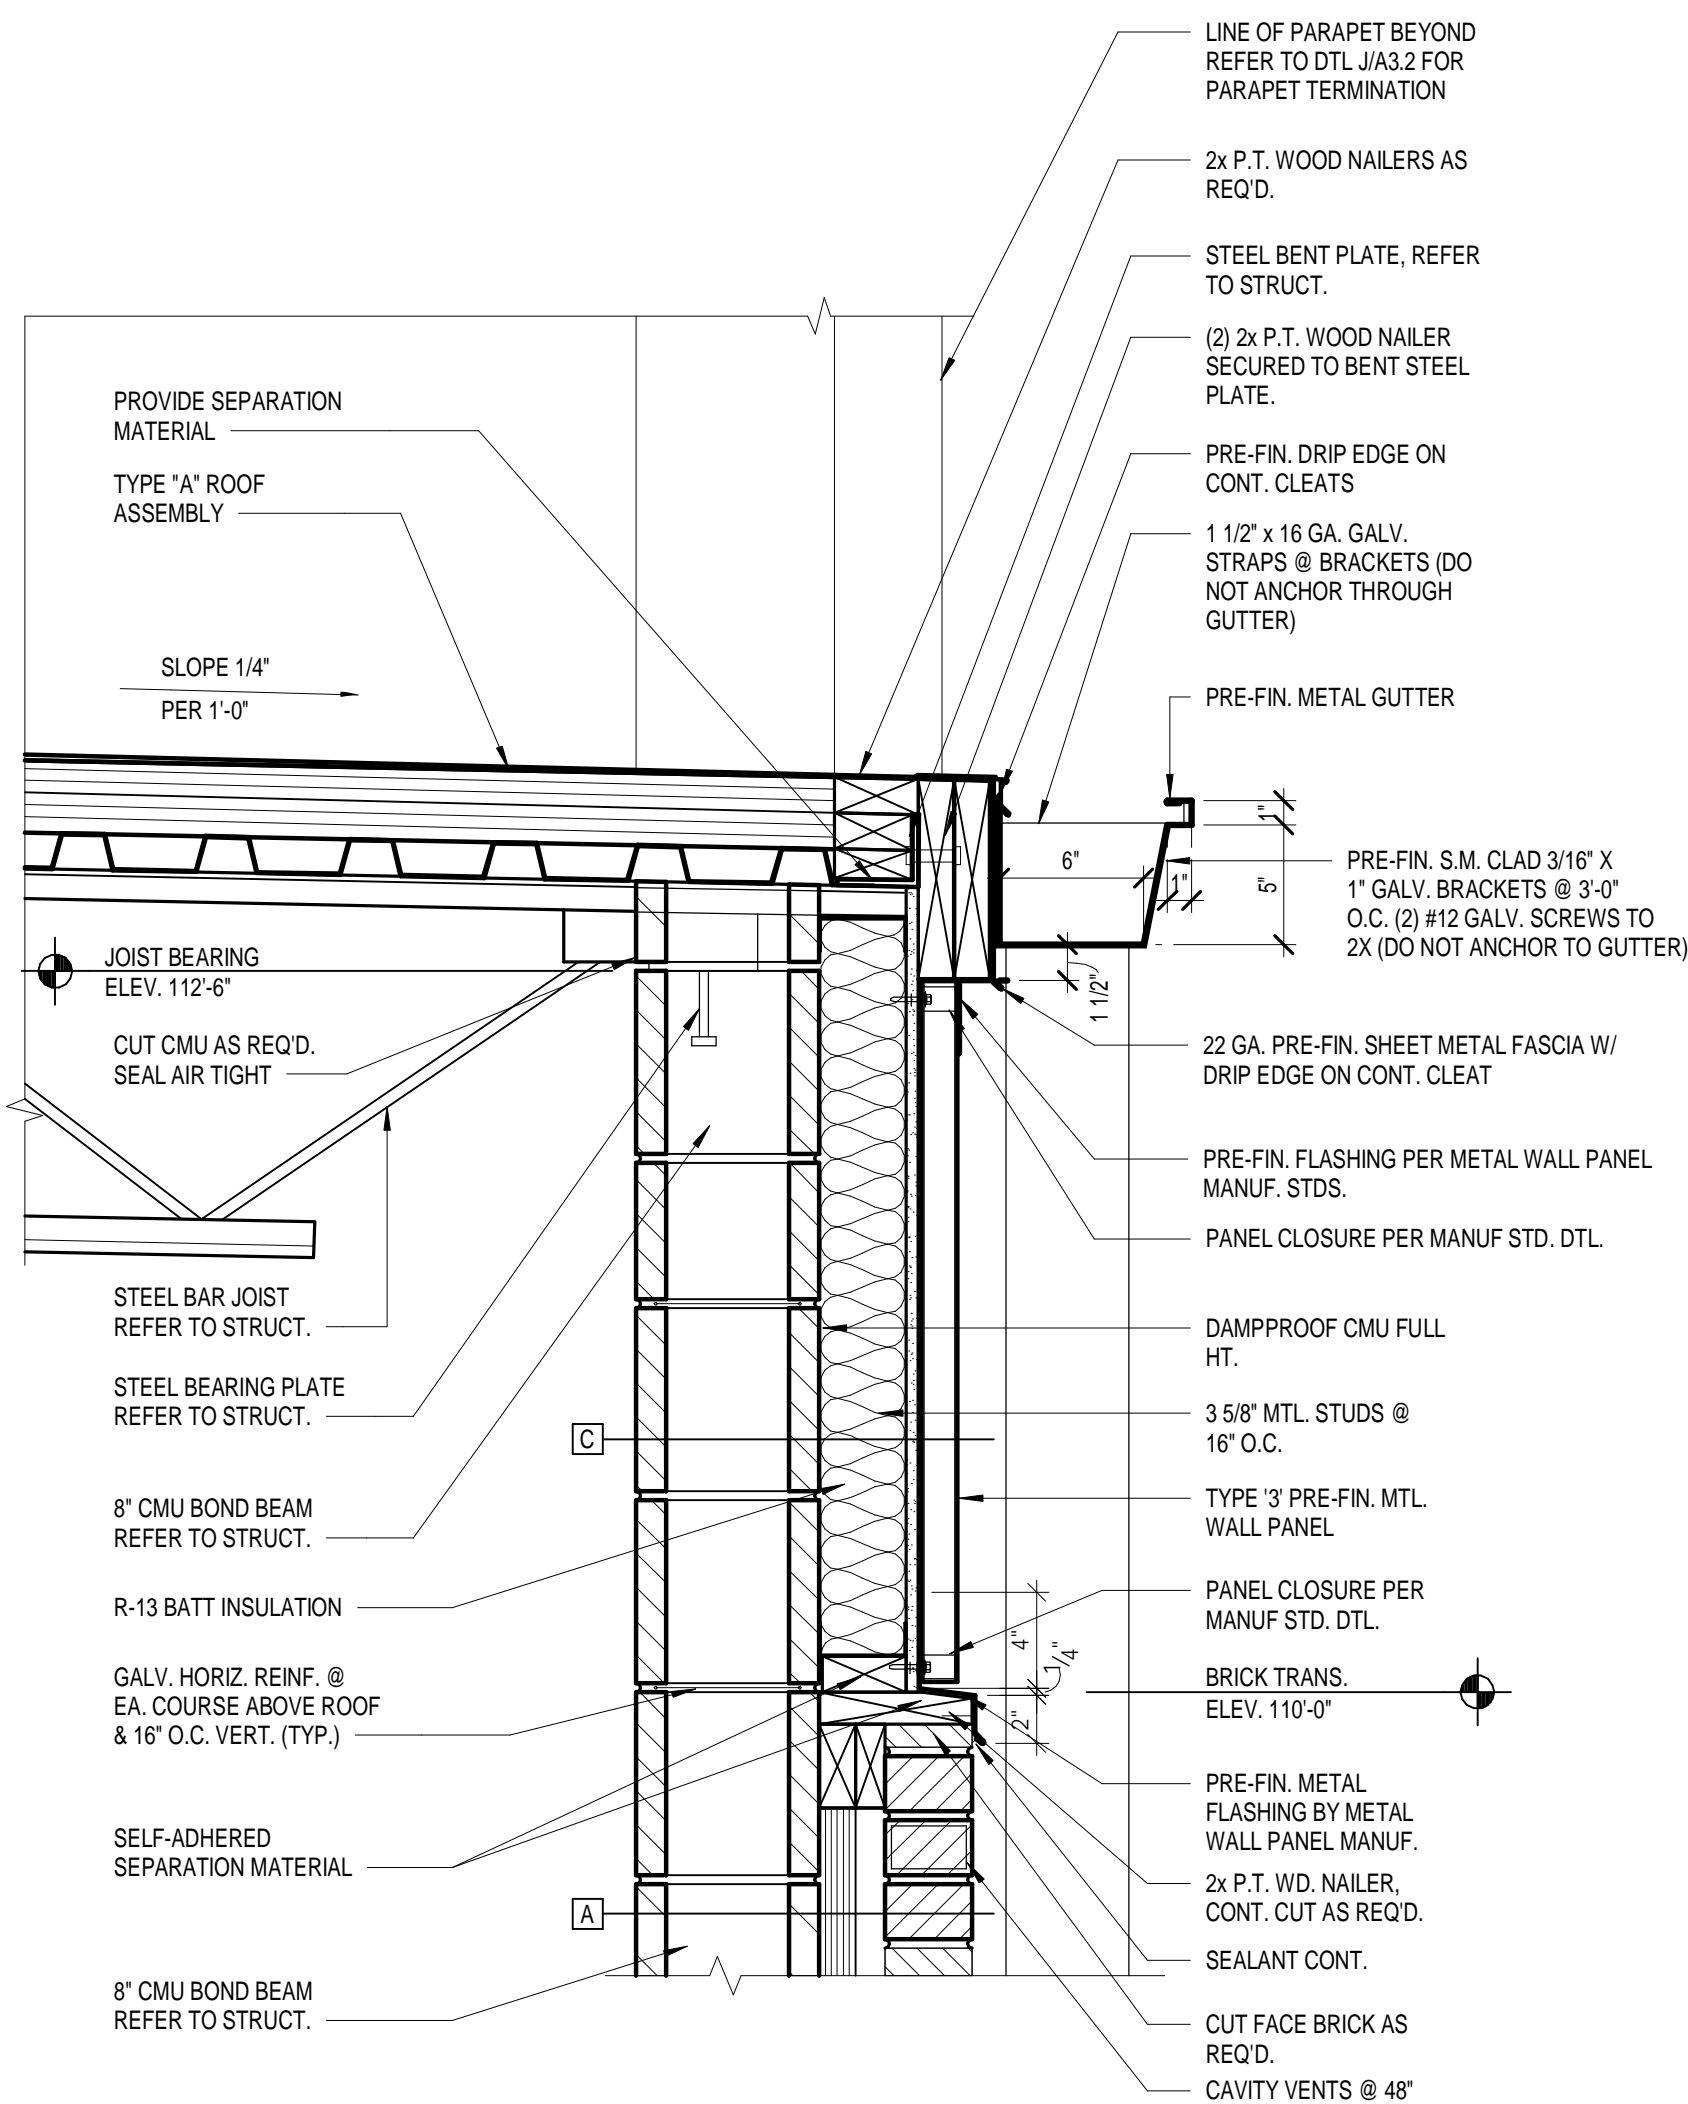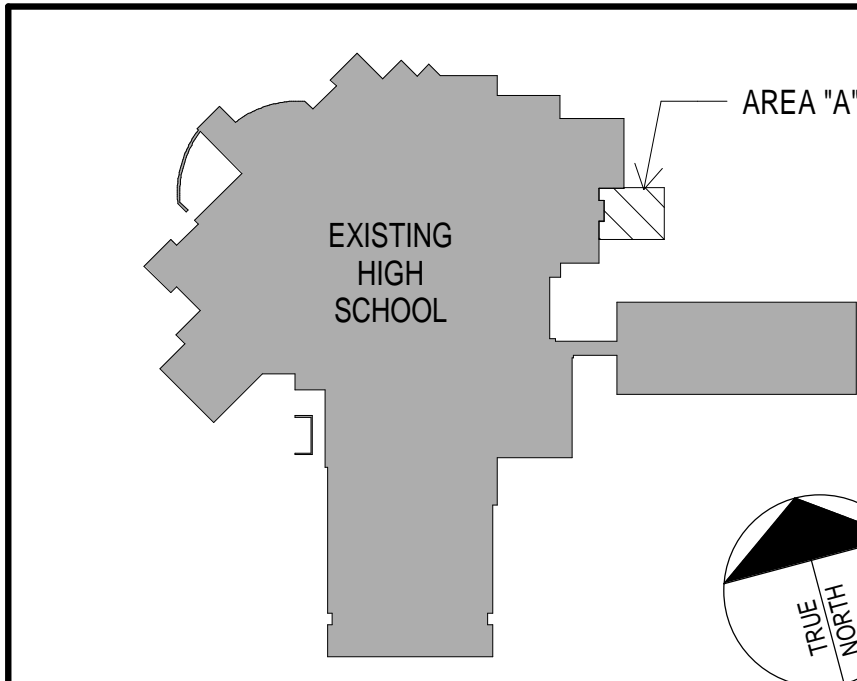



3 SECTION DETAIL
1 1/2" = 1'-0"

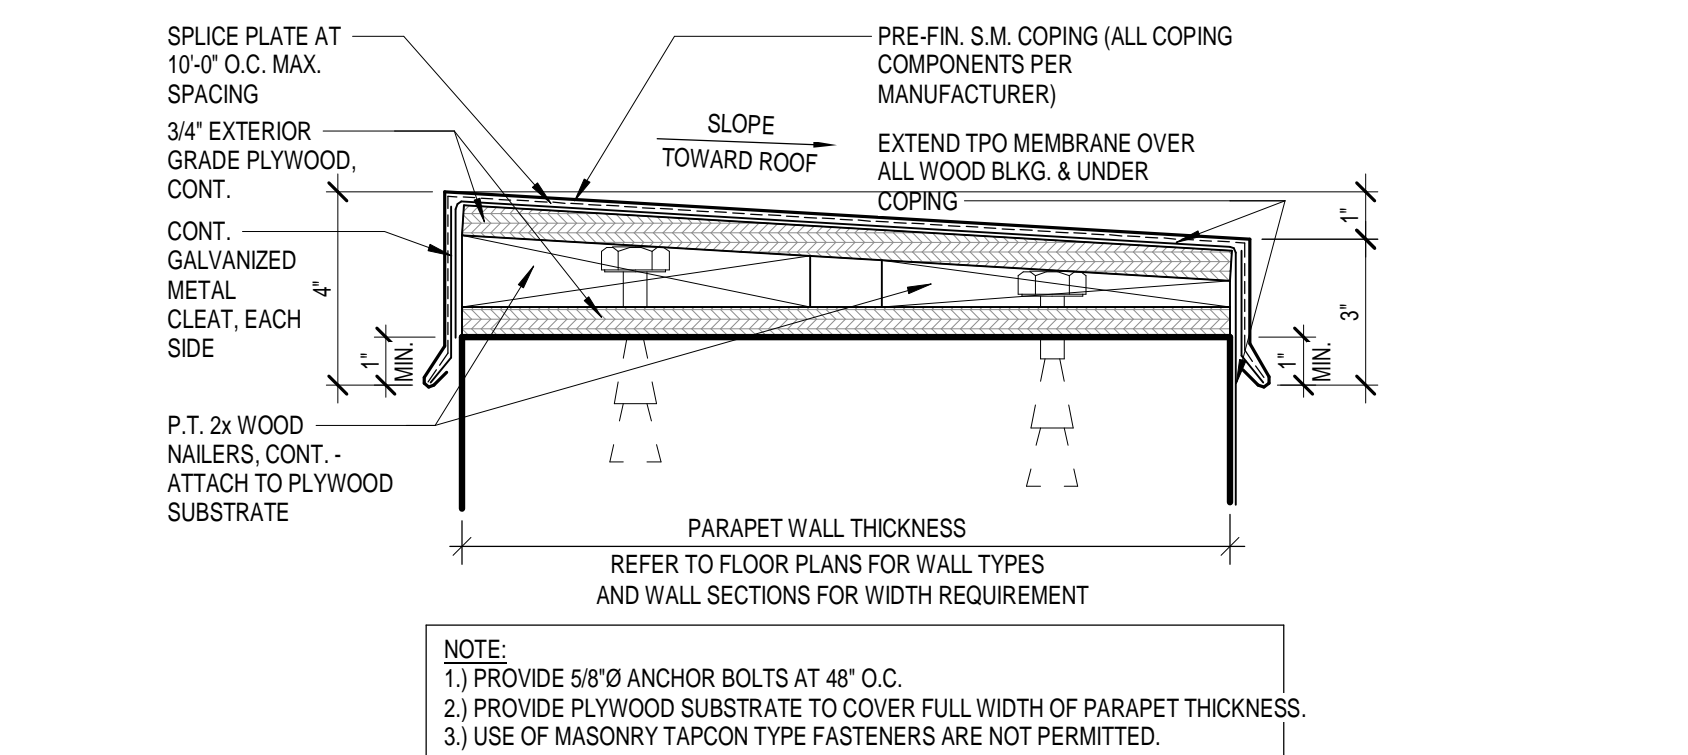

4 TYPICAL COPING DETAIL
3" = 1'-0"

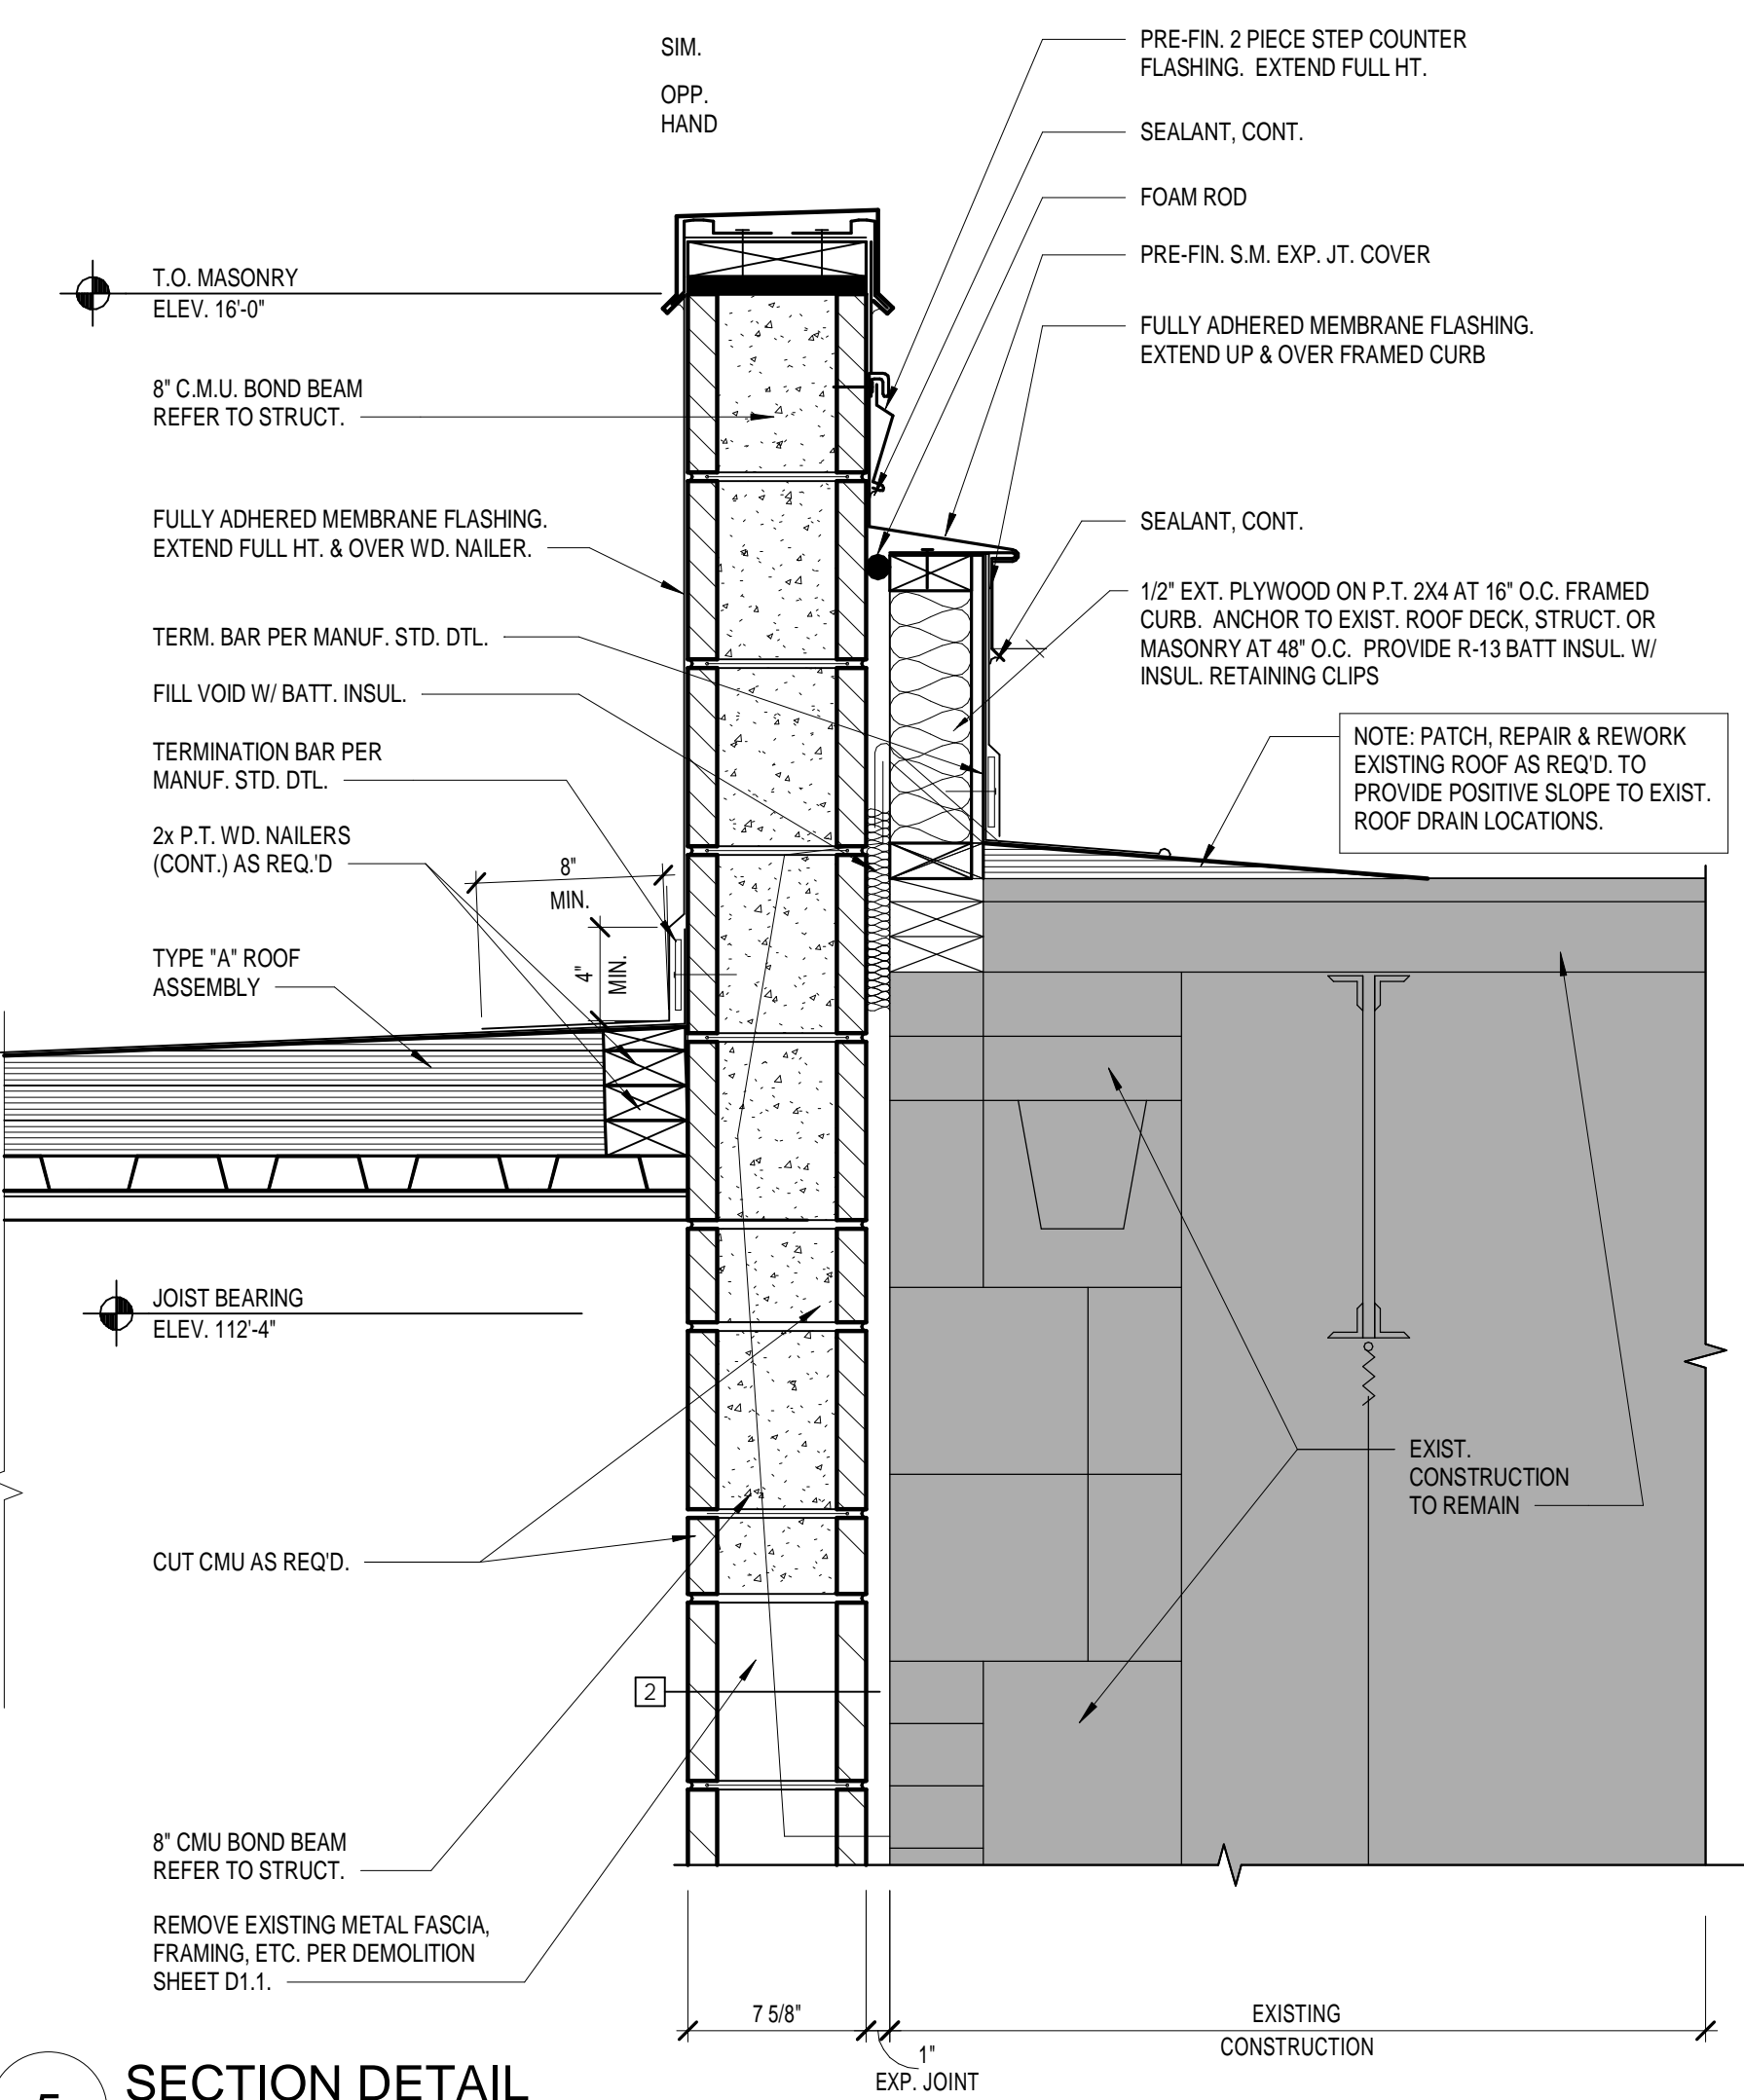

5 SECTION DETAIL
1 1/2" = 1'-0"

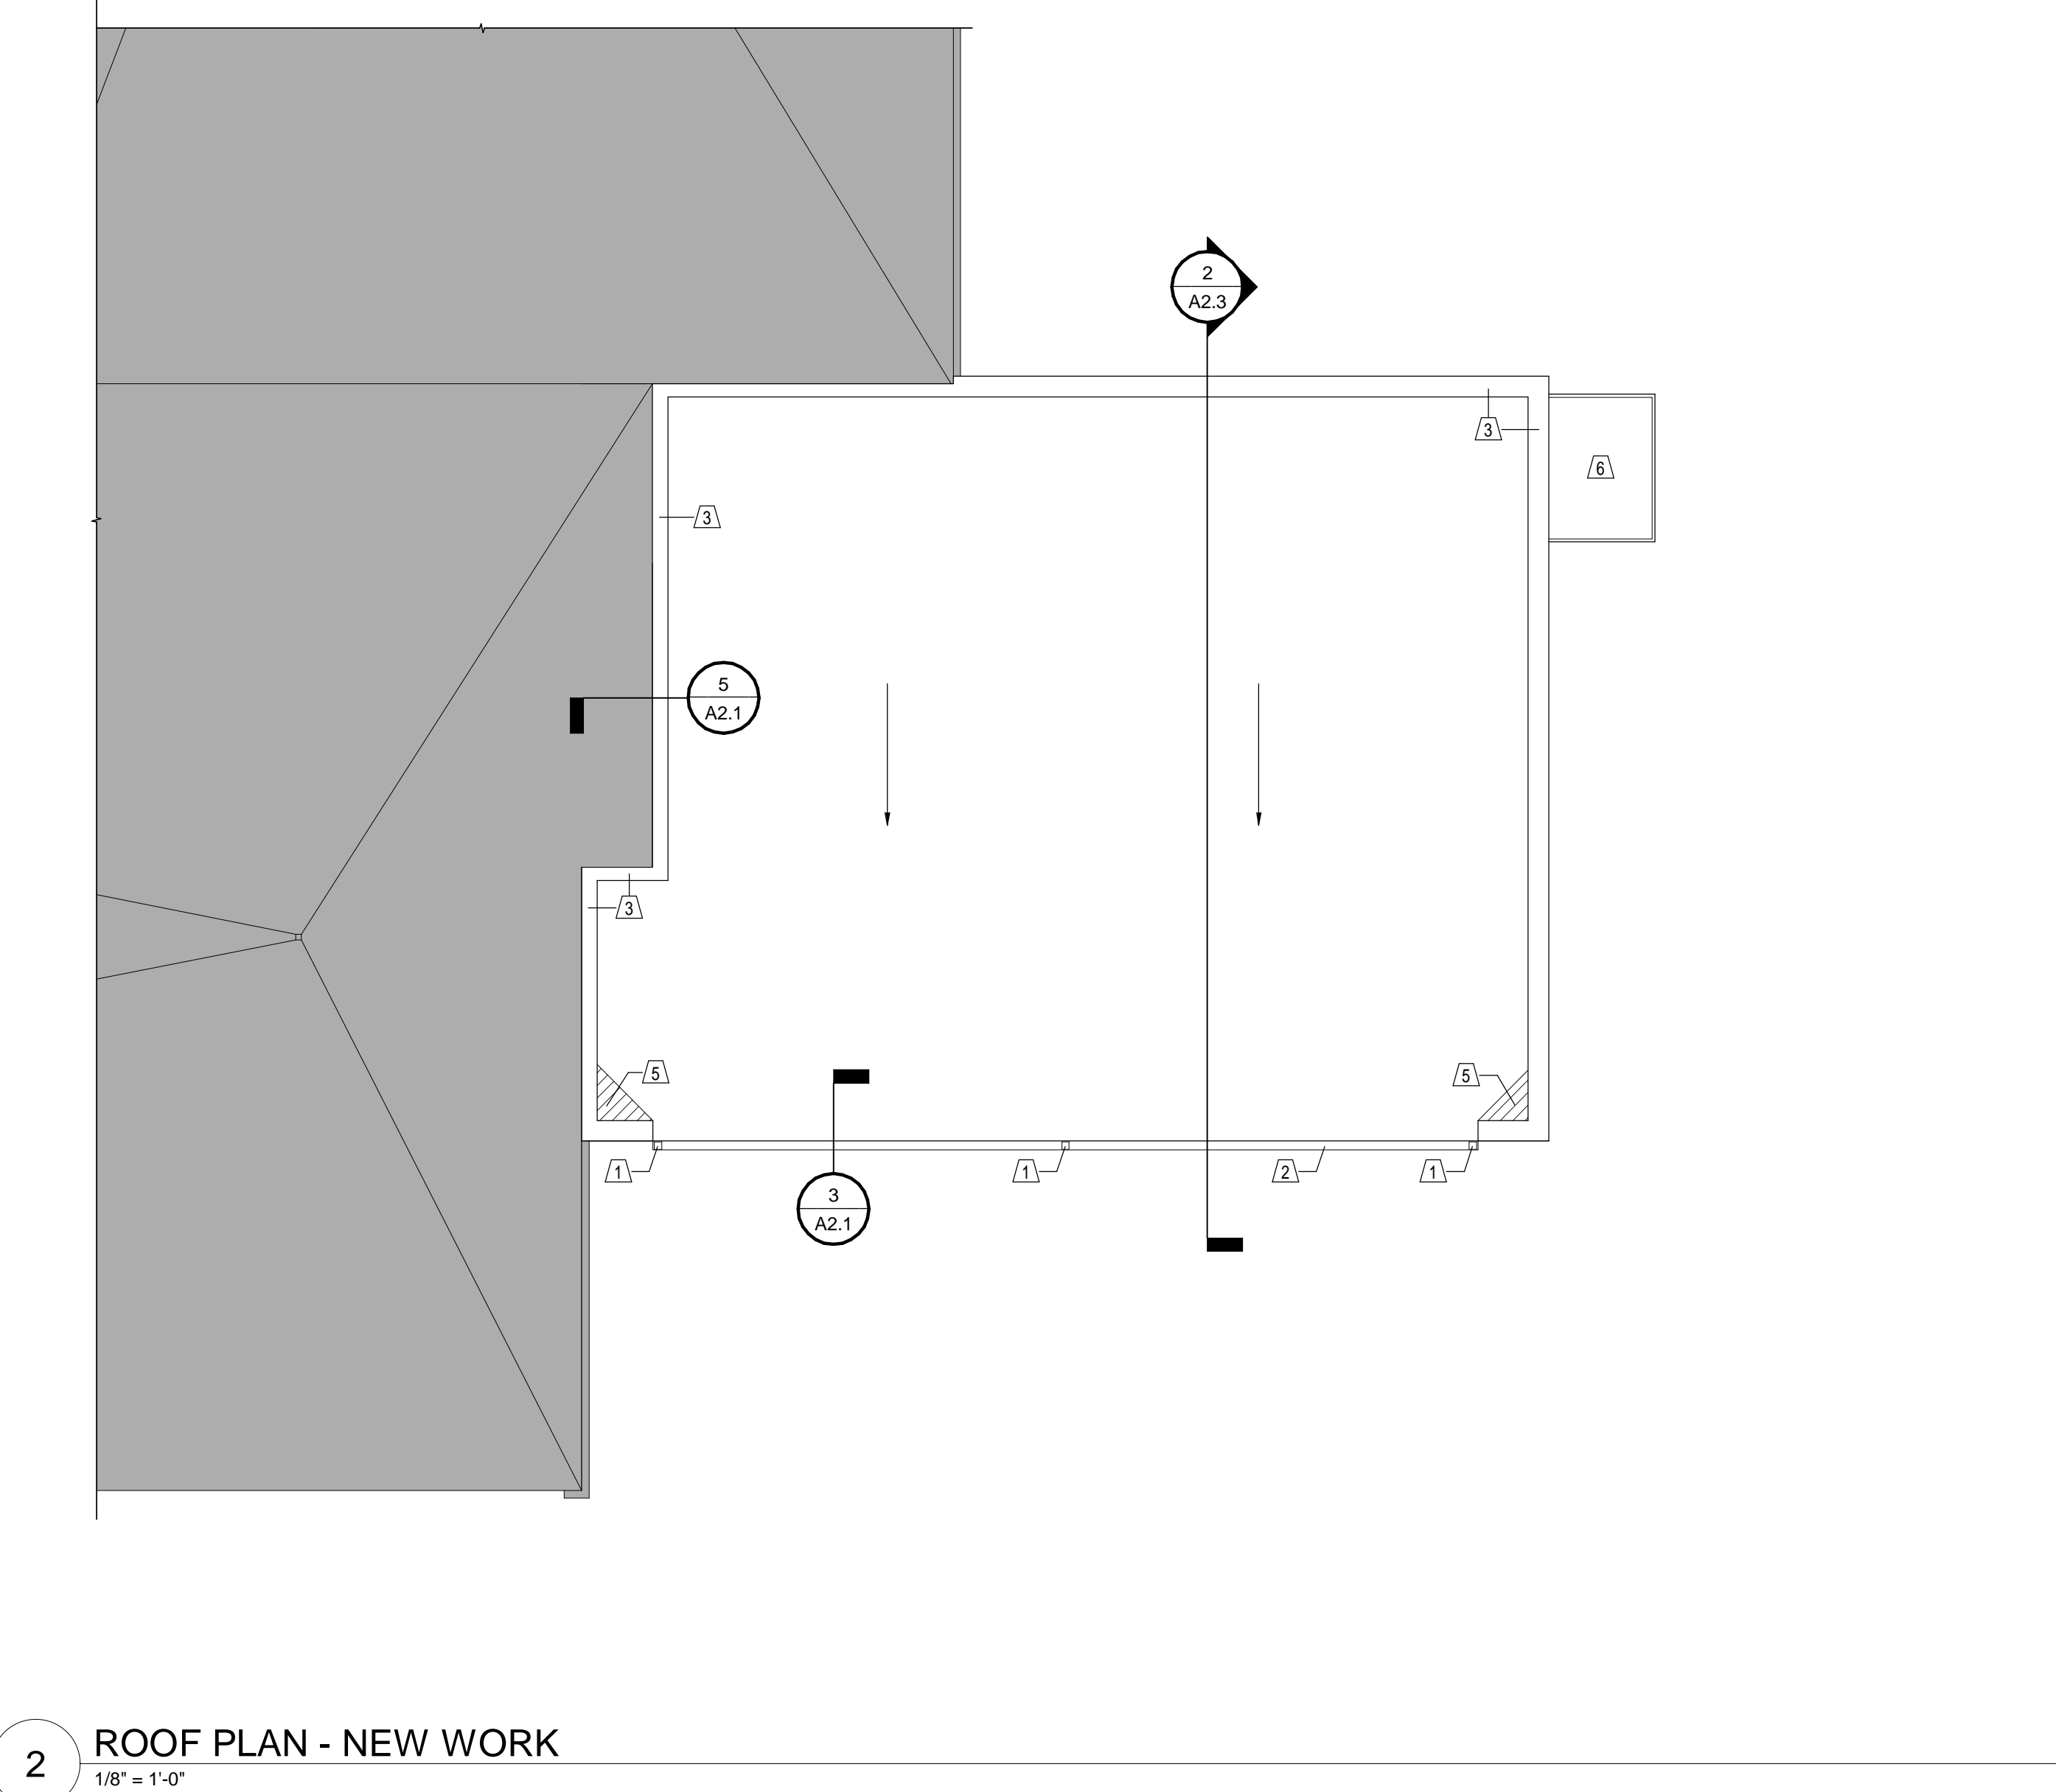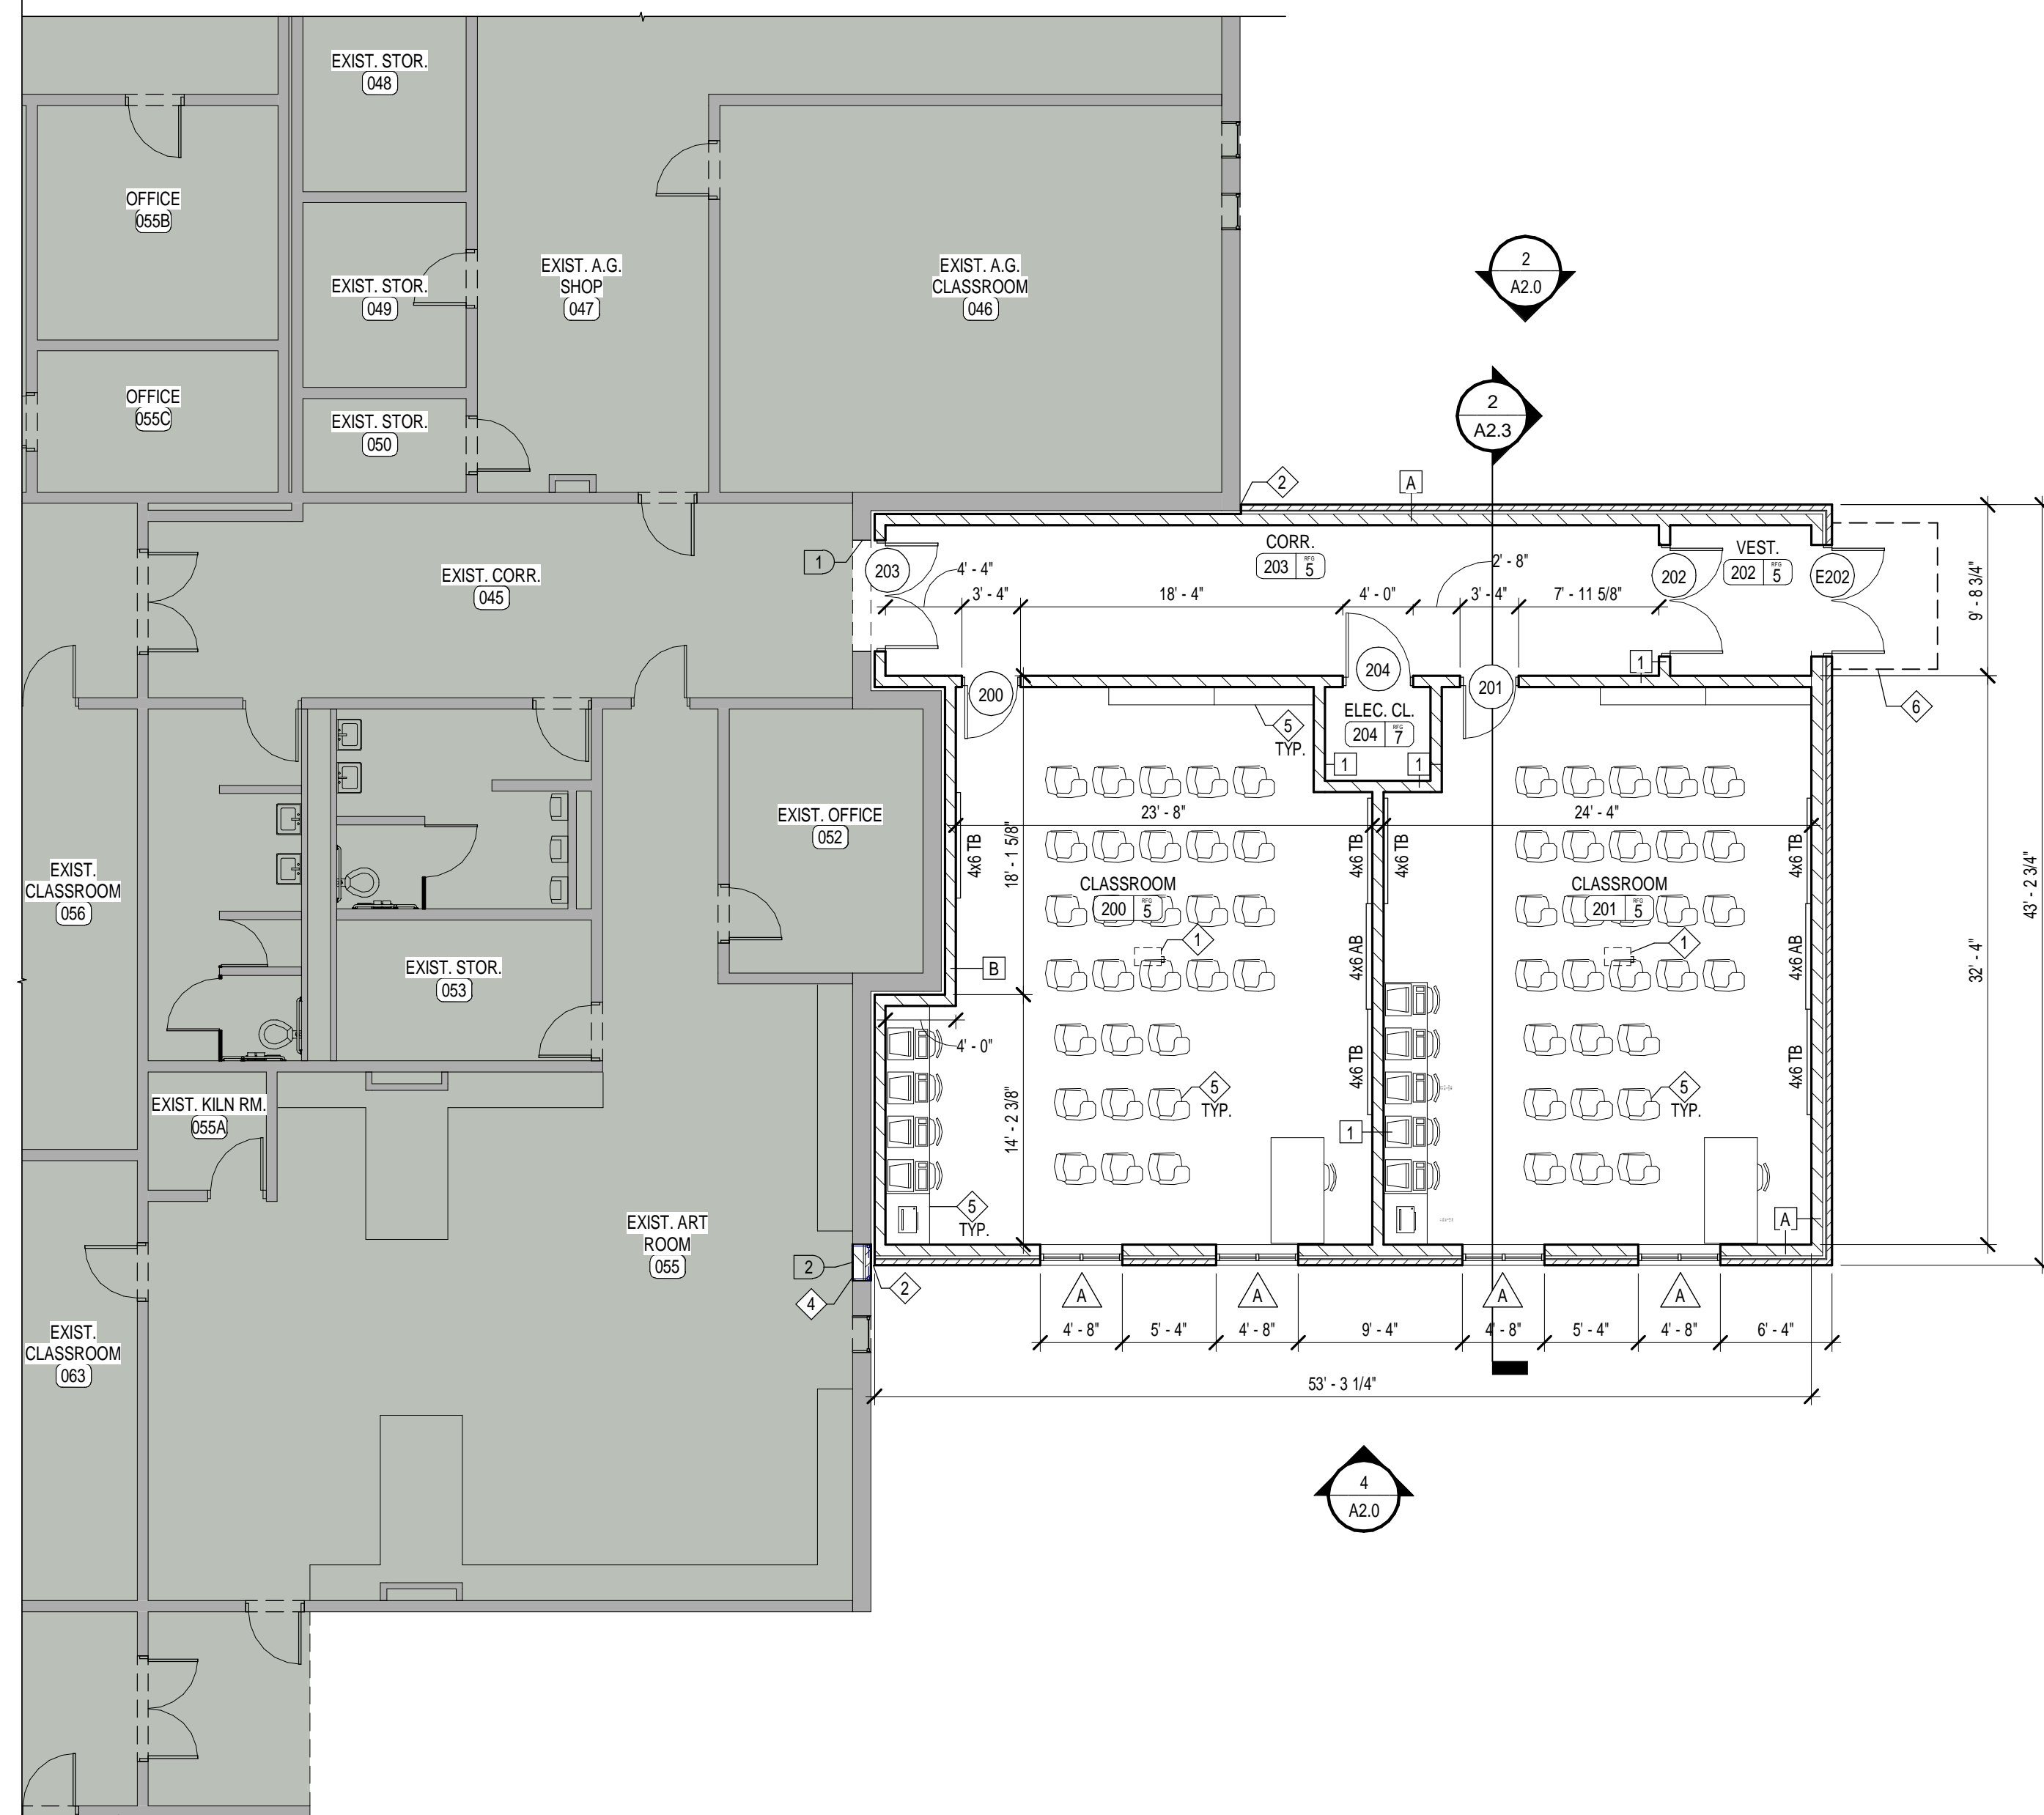

ROOM FINISH GROUPS

- GENERAL NOTES:
- WHERE MORE THAN ONE FINISH IS LISTED REFER TO PLANS, SECTIONS, AND DETAILS.
 - SOFFIT PAINT TO BE ACCENT COLORS UNLESS DIRECTED OTHERWISE BY ARCHITECT.
 - REFER TO TYPICAL FLOOR TRANSITION / THRESHOLD DETAILS, SHEET A7.1.
 - REFER TO REFLECTED CEILING PLAN, SHEET A1.2 FOR CEILING INFORMATION.
 - REFER TO MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION AT CEILINGS.

XXX RFG 1	FLOOR - ATHLETIC RUBBER TILE BASE - RESILIENT BASE WALLS - LATEX PAINT CEILING - REFER TO REFLECTED CEILING PLAN FOR TYPE & FOR SOFFITS / LINTELS
XXX RFG 2	FLOOR - EPOXY PAINT BASE - 4\"/>

JOB NO.	1744
DATE	APR 23, 2018
DRAWN	ALC, ASC
CHECKED	-

COPYRIGHT © 2016
SHERMAN CARTER BARNHART
ARCHITECTS, PLLC

REVISIONS		
No.	Description	Date

SHEET

A2.2

DOOR SCHEDULE

NO.	DOOR					FRAME					THRESHOLD	FIRE RATING	CLOSER DEG.	REMARKS	
	NO. LEAVES	WIDTH	HEIGHT	MATERIAL	TYPE	GLAZING	MATERIAL	TYPE	GLAZING	HEAD					JAMB
EXTERIOR DOORS															
E202	2	3'-0"	7'-0"	H.M.	A	-	H.M.	2	-	3/A2.2	4/A2.2	ADA	-	90	1,2,5,6,8,9
INTERIOR DOORS															
200	1	3'-0"	7'-0"	H.M.	B	-	H.M.	1	-	1/A2.2	2/A2.2	ADA	-	90	1,3,6
201	1	3'-0"	7'-0"	H.M.	B	-	H.M.	1	-	1/A2.2	2/A2.2	ADA	-	90	1,3,6
202	2	3'-0"	7'-0"	H.M.	A	-	H.M.	2	-	1/A2.2	2/A2.2	ADA	-	90	1,2,4,5
203	2	3'-0"	7'-0"	H.M.	B	-	H.M.	2	-	1/A2.2	9/A2.2	ADA	-	105	1,4,7,8
204	1	4'-0"	7'-0"	H.M.	C	-	H.M.	1	-	3/A8.1	4/A8.1	ADA	-	90	1,6

REMARKS

1. GALVANIZED DOOR & FRAME
2. INSULATED DOOR & FRAME
3. MANUAL HOLD OPEN DEVICE(S)
4. ELECTRO-MAGNETIC HOLD OPEN DEVICES
5. EXIT ONLY
6. PROVIDE CYLINDER LOCK
7. FIELD VERIFY EXISTING OPENING AND CONDITIONS
8. PROVIDE MFR. STD. DETAILS AT DOORS & FRAMES. SEE NOTED DTL. FOR CONDITIONS AT FRAME AND ADJ. MATERIAL
9. PROVIDE RAIN DRIP ABV. DOOR(S)

DOOR AND FRAME NOTES:



- GENERAL NOTES:**
1. REFER TO TYPICAL HEAD AND JAMB DETAILS, CMU TYP. DETAILS, AND TYP. H.M. DETAILS THIS SHEET.
- HOLLOW METAL FRAME NOTES:**
1. PROVIDE REINFORCING 12 GA. CHANNEL IN FRAME HEAD AT ALL H.M. FRAMES WHERE TOTAL FRAME WIDTH IS GREATER THAN 4'-0".
 2. PROVIDE 11 - GA X 2" WIDE STRAPS AT 8" O.C. IN H.M. FRAME HEADS GREATER THAN 2" IN HEIGHT. TYPICAL.
 3. LINTEL BEAM LENGTH SHALL BE M.O. PLUS 16" LONG (MIN 8" BEARING AT EACH END UNLESS NOTED OTHERWISE). LINTEL PLATE LENGTH SHALL BE M.O. LESS 1/4" LONG (1/8" AT EACH END MAX.). REFER TO STRUCTURAL DRAWINGS FOR LINTEL INFORMATION.
 4. UNLESS NOTED OTHERWISE, THE HINGE SIDE OF H.M. FRAME SHALL BE INSTALLED 4" FROM ADJ. WALLS.
 6. ALL EXTERIOR HOLLOW METAL FRAMES SHALL BE GALVANIZED, 14 GA.

- DOOR NOTES:**
1. UNDERCUT AT NON-RATED DOORS 1/2" FROM BOTTOM OF DOOR TO SCHEDULED FLOOR FINISH.
 2. UNDERCUT AT EXTERIOR DOORS 1/8" MAX. FROM BOTTOM OF DOOR TO TOP OF THRESHOLD. WEATHER STRIP MUST CLOSE TIGHTLY AGAINST THRESHOLD.
 3. ALL EXTERIOR HOLLOW METAL DOORS BE GALVANIZED AND HAVE FLUSH CLOSURE CAPS 16 GA. WELD CONT. TOP AND BOTTOM.
 4. PROVIDE THRESHOLDS AS REQUIRED AT DOORS. SEE BELOW FOR TYPICAL THRESHOLD DETAILS AND FLOOR FINISHES.

- HARDWARE NOTES:**
1. PROVIDE AND INSTALL ALL HARDWARE IN ACCORDANCE WITH ANSI A117.1 - 2009.


THRESHOLD/TRANSITION DETAIL CONDITIONS

- GENERAL NOTES:**
1. REFER TO ROOM FINISH GROUPS AND FLOOR PLANS FOR FINISHES. IT IS THE CONTRACTOR'S RESPONSIBILITY TO MAKE SURE THE PROPER THRESHOLD IS USED.
 2. PROVIDE RESILIENT TRANSITION STRIPS OR REDUCERS BETWEEN ALL DIFFERING FLOOR FINISH MATERIALS IE CARPET TO TILE.
 3. PROVIDE STRIP OR REDUCER PROFILE AS RECOMMENDED BY MANUFACTURER FOR APPLICATION.

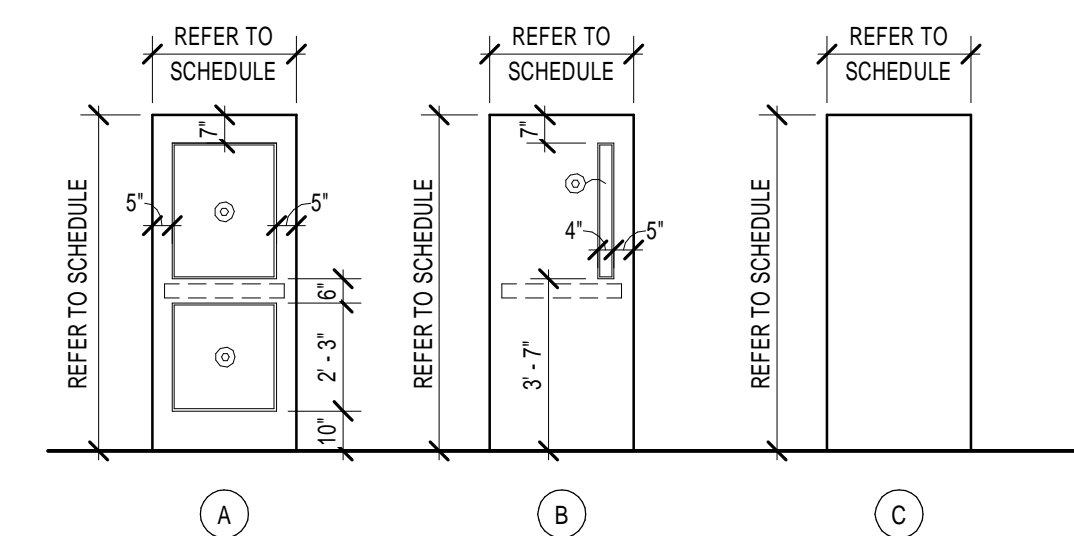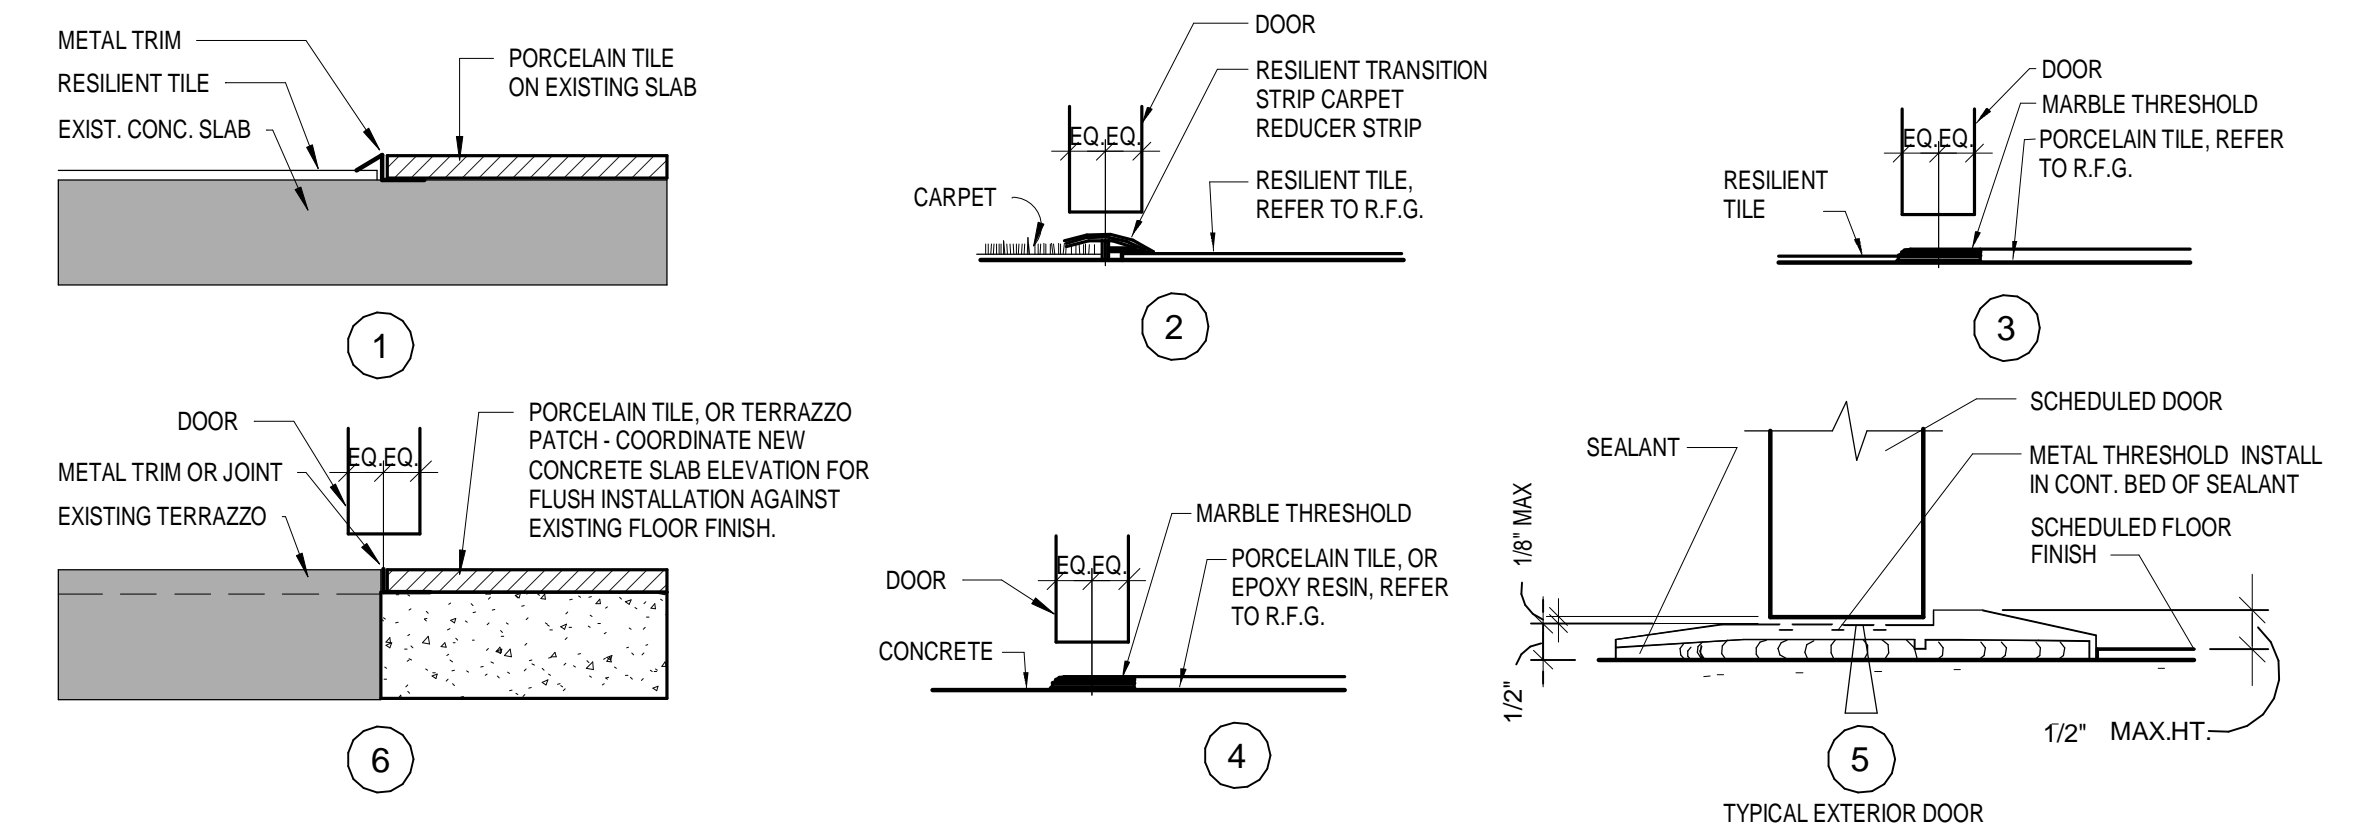

DOOR TYPES

1/4" = 1'-0" ALL EXTERIOR GLAZING SHALL BE 1" INSULATED, U.N.O.
⊗ DENOTES TEMPERED GLASS

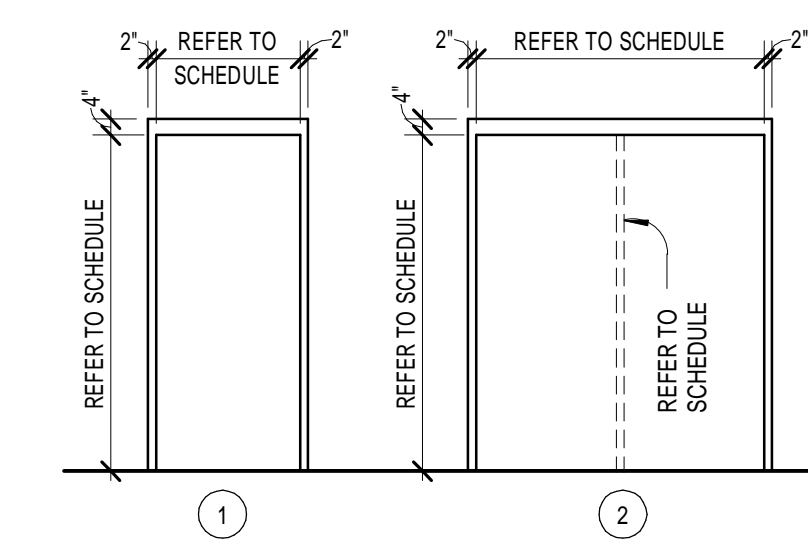






HOLLOW METAL DOOR FRAME TYPES

1/4" = 1'-0" ALL EXTERIOR GLAZING SHALL BE 1" INSULATED, U.N.O.
⊗ DENOTES TEMPERED GLASS
DASHED LINES INDICATE INTERNAL REINFORCING LOCATIONS

SYMBOLS LEGEND

CLASSROOM	ROOM FINISH GROUPS (REFER TO SHEET NO.1)
100 1 1	ROOM NUMBER
X	DOOR NUMBER (DOOR SCHEDULE SHEET A8.1)
◇	NEW WORK KEY NOTES (SHEETS A1.11 THROUGH A2.4)
X	WALL TYPE (SCHEDULE SHEET NO.1)
△	ALUMINUM OR HOLLOW METAL WINDOW OR STOREFRONT TYPE (REFER TO FLOOR PLANS AND SCHEDULE SHEETS A8.1-A8.2)
X	TOILET ACCESSORIES (SCHEDULE SHEET A2.5)
X	ELEVATION KEY NOTE (SHEETS A3.1-A3.3)
X	ROOF KEY NOTE (SHEET A4.1)
X	CEILING PLAN KEY NOTE (SHEETS A7.11-A7.21)
X	SIGNAGE KEY NOTE (SHEET A8.21)
⊗	ROOM / WALL DESIGNATION
⊗	EPW2 2 HOUR EXISTING FIRE WALL
⊗	EPB2 2 HOUR EXISTING FIRE BARRIER

KEY PLAN

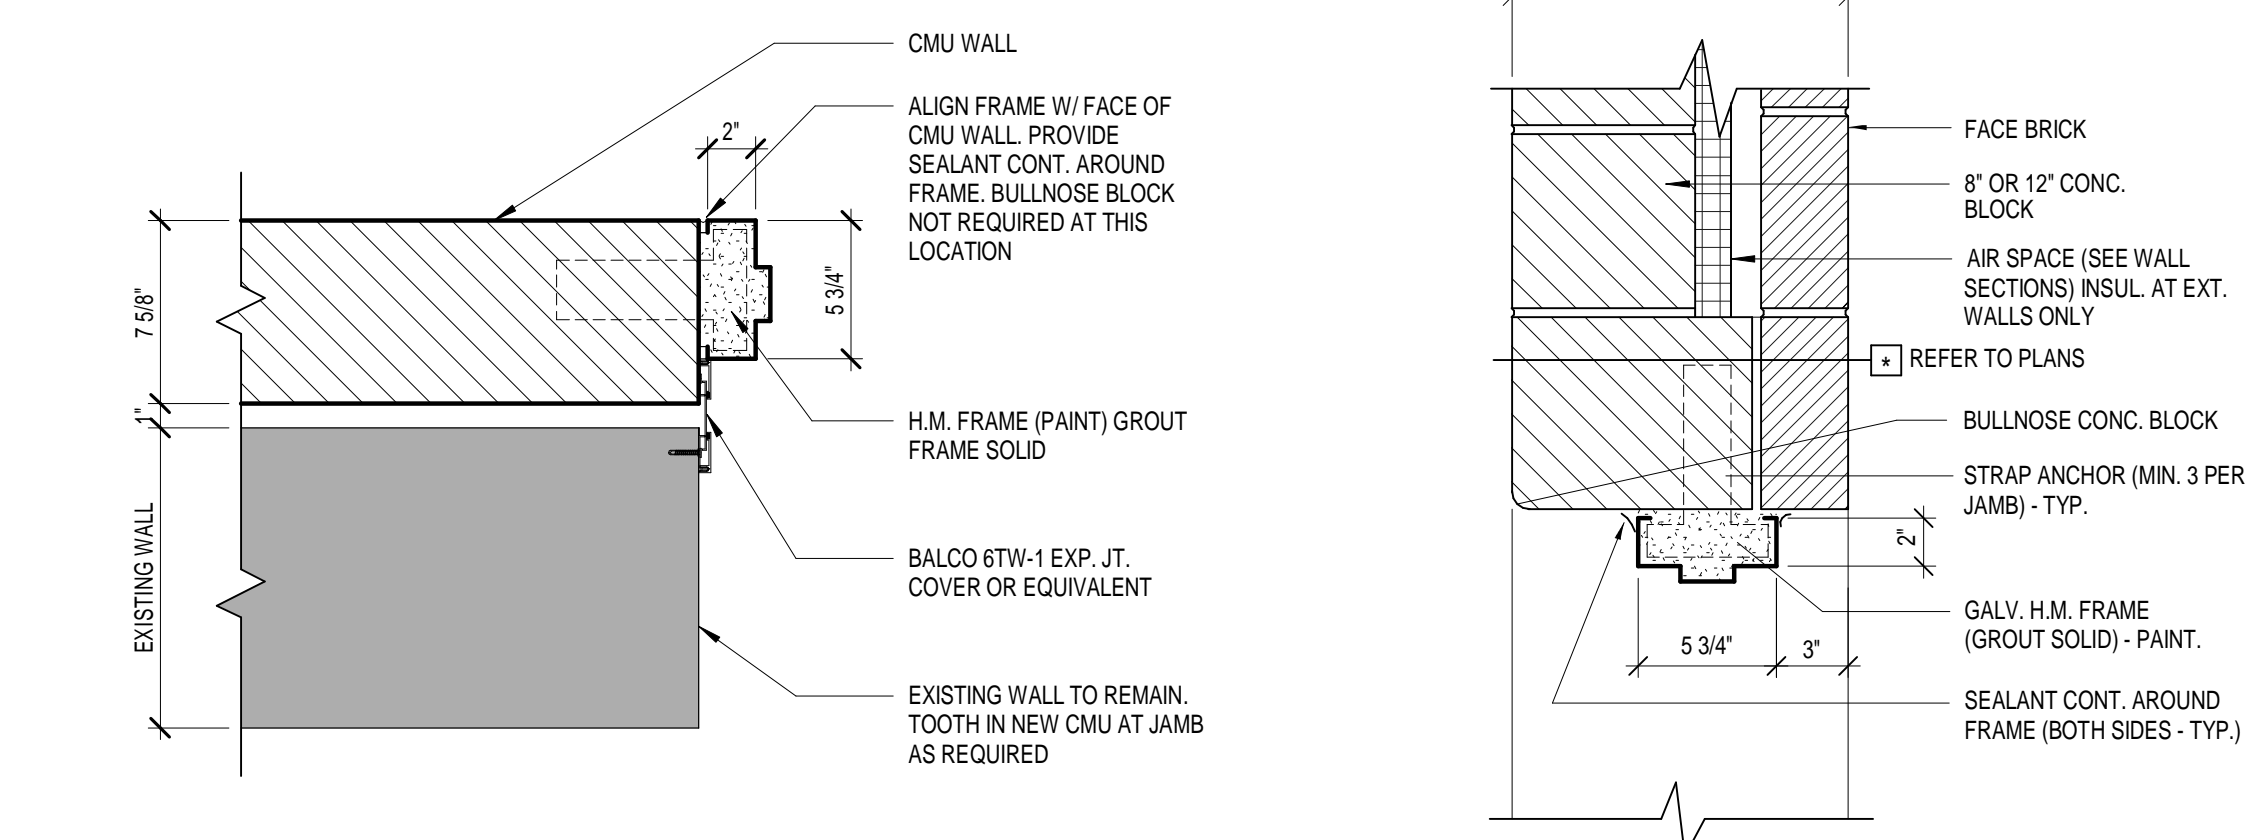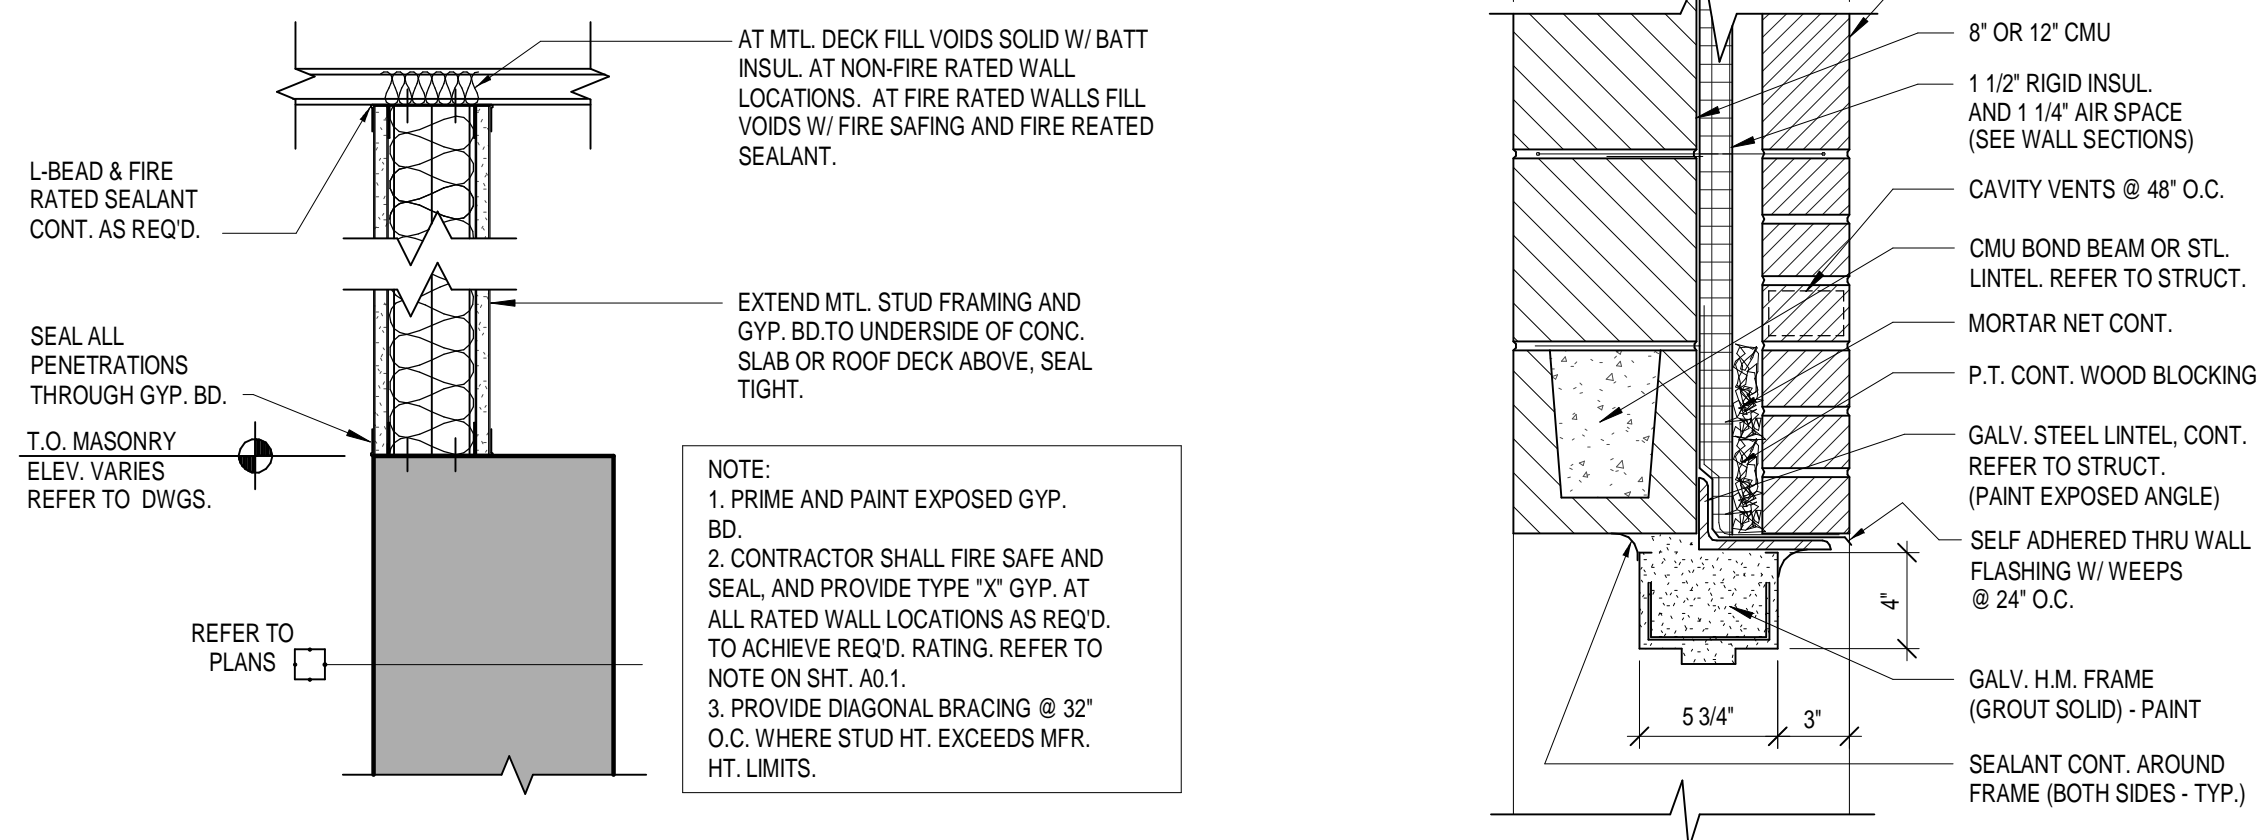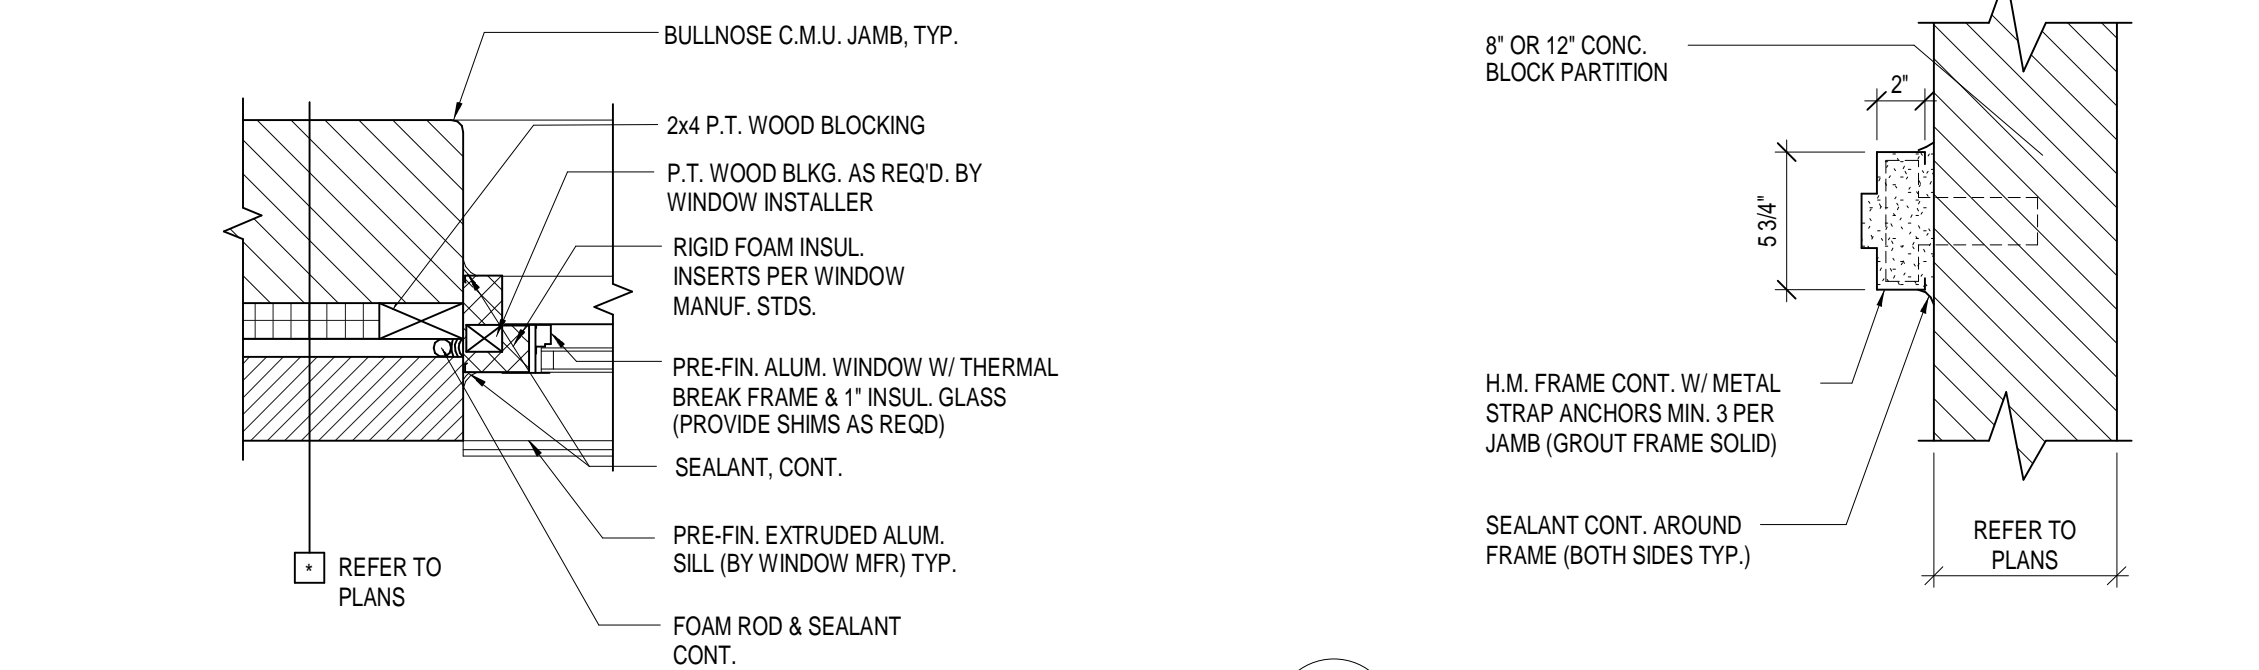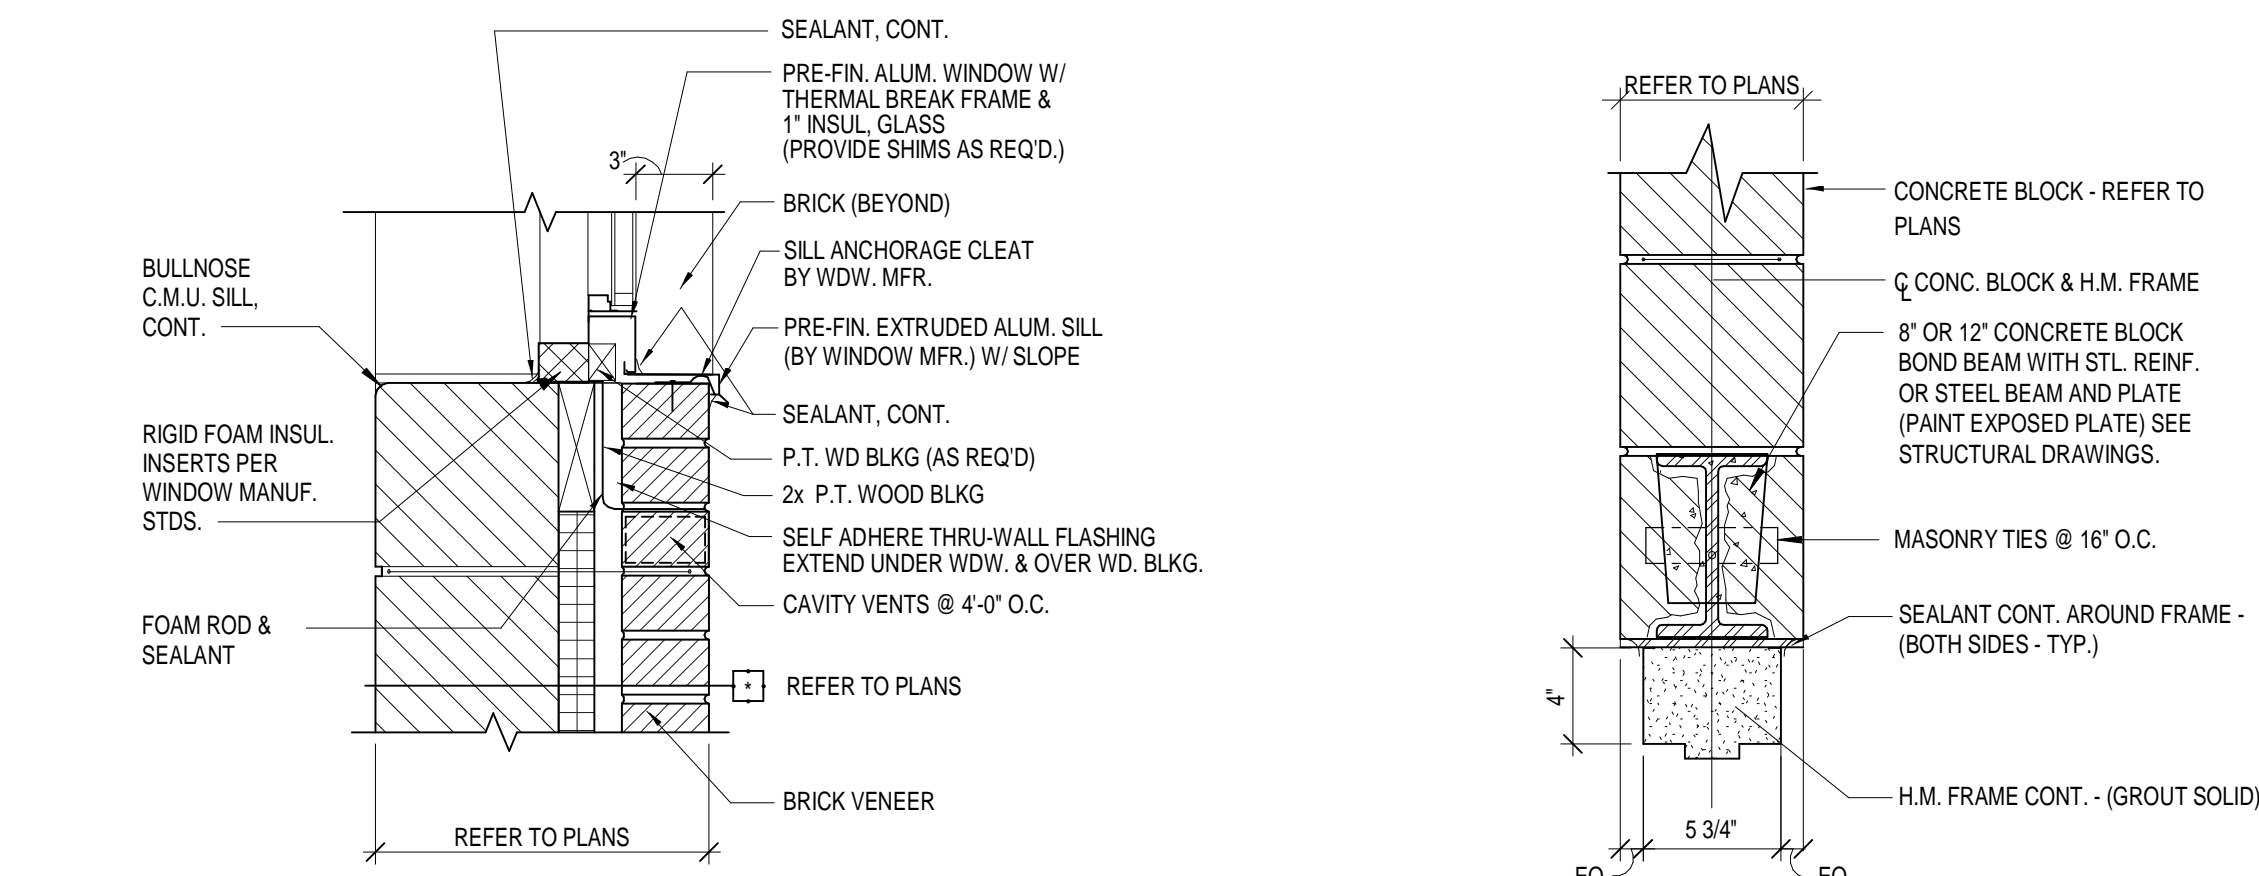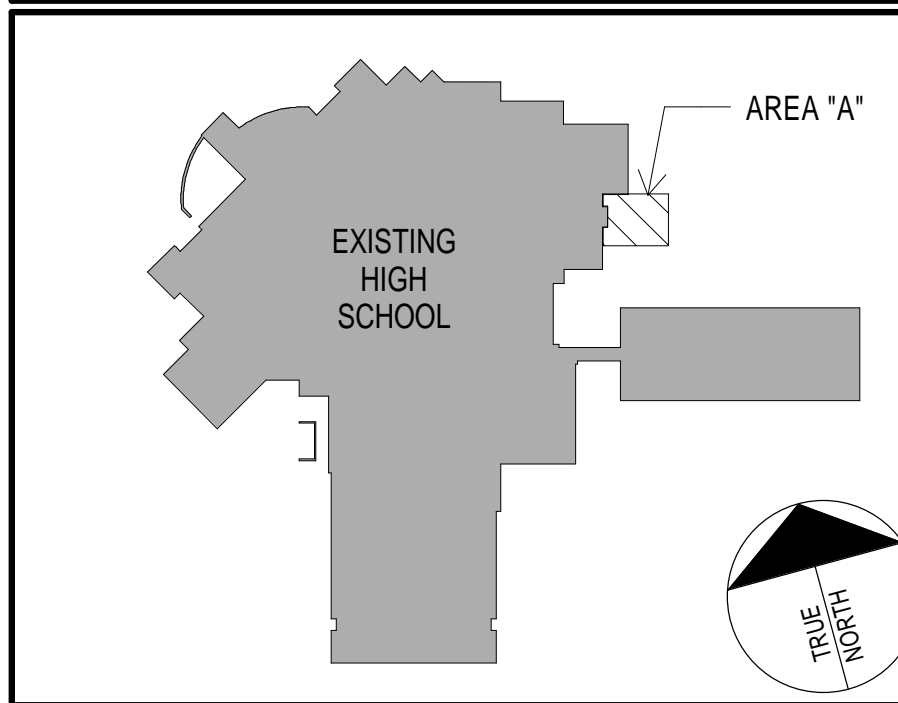

JOB NO.	1744
DATE	APR 23, 2018
DRAWN	ALC, ASC
CHECKED	-

COPYRIGHT © 2018
SHERMAN CARTER BARNHART
ARCHITECTS, PLLC

REVISIONS		
No.	Description	Date


SHEET

A2.3

REFLECTED CEILING PLAN TYPES & KEY NOTES

- A. TYPE "A" - 2'x2' SUSPENDED ACOUSTICAL PANEL CEILING SYSTEM - SEE SPECS.
CLG. AT 9'-0" A.F.F.
J. EXPOSED STRUCTURE - PAINT.

REFLECTED CEILING LEGEND



2'x2' SUSPENDED ACOUSTICAL CEILING (SEE CLG.
TYPES, ABOVE, AND DESCRIPTION IN SPECS.)



OPEN TO STRUCTURE ABOVE

GENERAL CEILING NOTES

- CEILING GRID SHOWN FOR LAYOUT PURPOSES ONLY. REFER TO MECHANICAL AND/OR ELECTRICAL DRAWINGS FOR TYPE, SIZE AND OTHER REQUIREMENTS PERTAINING SPECIFICALLY TO THE REFLECTED CEILING PLANS.
- ALL CEILINGS ARE 2'x2' SUSP. ACOUST. CLG. TYPE 1 AT 9'-0" A.F.F. UNLESS NOTED OTHERWISE.
- REFER TO WALL PARTITION TYPES FOR DESCRIPTION OF WALLS EXTENDING (OR NOT) TO UNDERSIDE OF DECKING AND/OR STRUCTURE ABOVE.
- INSTALL SPRINKLER HEADS IN THE CENTER OF CEILING PANELS.
- INSTALL ALL SPRINKLER HEADS ON SWING ARM NIPPLES. SEE MECHANICAL DRAWINGS FOR MORE SPECIFIC REQUIREMENTS.
- PAIN'T ALL ITEMS EXPOSED TO VIEW INCLUDING UNDERSIDE OF METAL DECK, BAR JOISTS, CONDUIT, & PIPING.
- CONTRACTOR TO SUBMIT FULL COORDINATION DRAWINGS FOR ALL CEILING ITEMS INCLUDING JOIST SPACING, LIGHTING, HVAC LAYOUT AND FIRE PROTECTION SYSTEMS.

ELEVATION KEYNOTES

NOTE: NOT ALL KEYNOTES MAY APPLY TO THIS SHEET.

- FACE BRICK
- EXISTING BUILDING TO REMAIN - NO WORK REQ'D. (U.N.O.)
- CONTROL / BRICK VENEER EXPANSION JOINT. REFER TO DETAIL 4-1
- PRE-FINISHED METAL PANEL - REFER TO SPECIFICATIONS
- PRE-FINISHED METAL COPING - REFER TO DTL. 4/A2.1
- PRE-FINISHED S.M. GUTTER - REFER TO DTL. 3/A2.1
- PRE-FINISHED S.M. DOWNSPOUT. DISCHARGE INTO BOOT AND BELOW GRADE DRAINAGE SYSTEM. REFER TO CIVIL FOR DETAILS AND CONTINUATION.
- PRE-FINISHED CAST IRON DOWNSPOUT BOOT.
- PRE-FINISHED ALUM. WINDOW
- PAINTED, GALVANIZED, HOLLOW METAL INSULATED DOOR AND FRAME
- FIN. GRADE - REFER TO CIVIL DWGS.
- LINE OF ROOF BEYOND
- PRE-FINISHED METAL CANOPY

GENERAL NOTES



GENERAL:
BUILDING ELEVATIONS SHOWN ON THIS DRAWING ARE INTENDED FOR GENERAL REFERENCE PURPOSES ONLY. REFER TO REFERENCED SECTIONS AND DETAILS FOR MORE FULLY DESCRIBED CONDITIONS AND REQUIREMENTS.

- A. MATERIALS INDICATIONS AND DESCRIPTIONS, VERTICAL AND OTHER DIMENSIONS SHOWN ON ONE BUILDING ELEVATION APPLY TO APPLY TO OTHER BUILDING ELEVATIONS WERE SHOWN UNLESS NOTED OTHERWISE
- B. LINES REPRESENTING PAVING AND FINISH GRADES ARE APPROXIMATE AND ARE SHOWN FOR REFERENCE PURPOSES ONLY. REFER TO SITE PLANS FOR SPECIFIC GRADE AND SPOT ELEVATIONS AT EACH RESPECTIVELY.
- C. REFER TO FLOOR PLANS FOR LOCATION AND DOOR SCHEDULE FOR FULL EXTENT AND COMPLETE DESCRIPTION OF DOOR AND FRAME TYPES. PORTIONS OF DOORS, WINDOWS STOREFRONTS, AND CURTAIN WALLS MAY BE CONCEALED BY OTHER BUILDING FEATURES SHOWN.
- D. REFER TO FLOOR PLANS FOR SPECIFIC ALUMINUM WINDOW TYPES AND WINDOW ELEVATIONS.
- E. LOCATIONS OF CONTROL JOINTS (CJ) IN MASONRY WALLS ARE SHOWN ON THIS DRAWING. SEE REFERENCED DETAILS FOR SPECIFIC REQUIREMENTS AT RESPECTIVE LOCATIONS.
- F. ALL EXPOSED NEW EXTERIOR MASONRY SHALL RECEIVE APPLICATION OF SPECIFIED WATER REPELLENT.
- G. ALL EXPOSED EXTERIOR METAL SUCH AS FLASHINGS, COPINGS GUTTERS DOWNSPOUTS AND LADDERS SHALL RECEIVE THE SPECIFIED FIELD OR SHOP APPLIED FINISH COATING.


SYMBOLS LEGEND

CLASSROOM	ROOM FINISH GROUPS (REFER TO SHEET NO.1)
100	ROOM NUMBER
X	DOOR NUMBER (DOOR SCHEDULE SHEET A8.1)
X	NEW WORK KEY NOTES (SHEETS A1.11 THROUGH A2.4)
X	WALL TYPE (SCHEDULE SHEET NO.1)
X	ALUMINUM OR HOLLOW METAL WINDOW OR STOREFRONT TYPE (REFER TO FLOOR PLANS AND SCHEDULE SHEETS A8.1-A8.2)
X	TOILET ACCESSORIES (SCHEDULE SHEET A2.5)
X	ELEVATION KEY NOTE (SHEETS A3.1-A3.3)
X	ROOF KEY NOTE (SHEET A4.1)
X	CEILING PLAN KEY NOTE (SHEETS A7.11-A7.21)
X	SIGNAGE KEY NOTE (SHEET A9.21)
X	ROOM / WALL DESIGNATION
X	EW2: 2 HOUR EXISTING FIRE WALL
X	EFB2: 2 HOUR EXISTING FIRE BARRIER


KEY PLAN

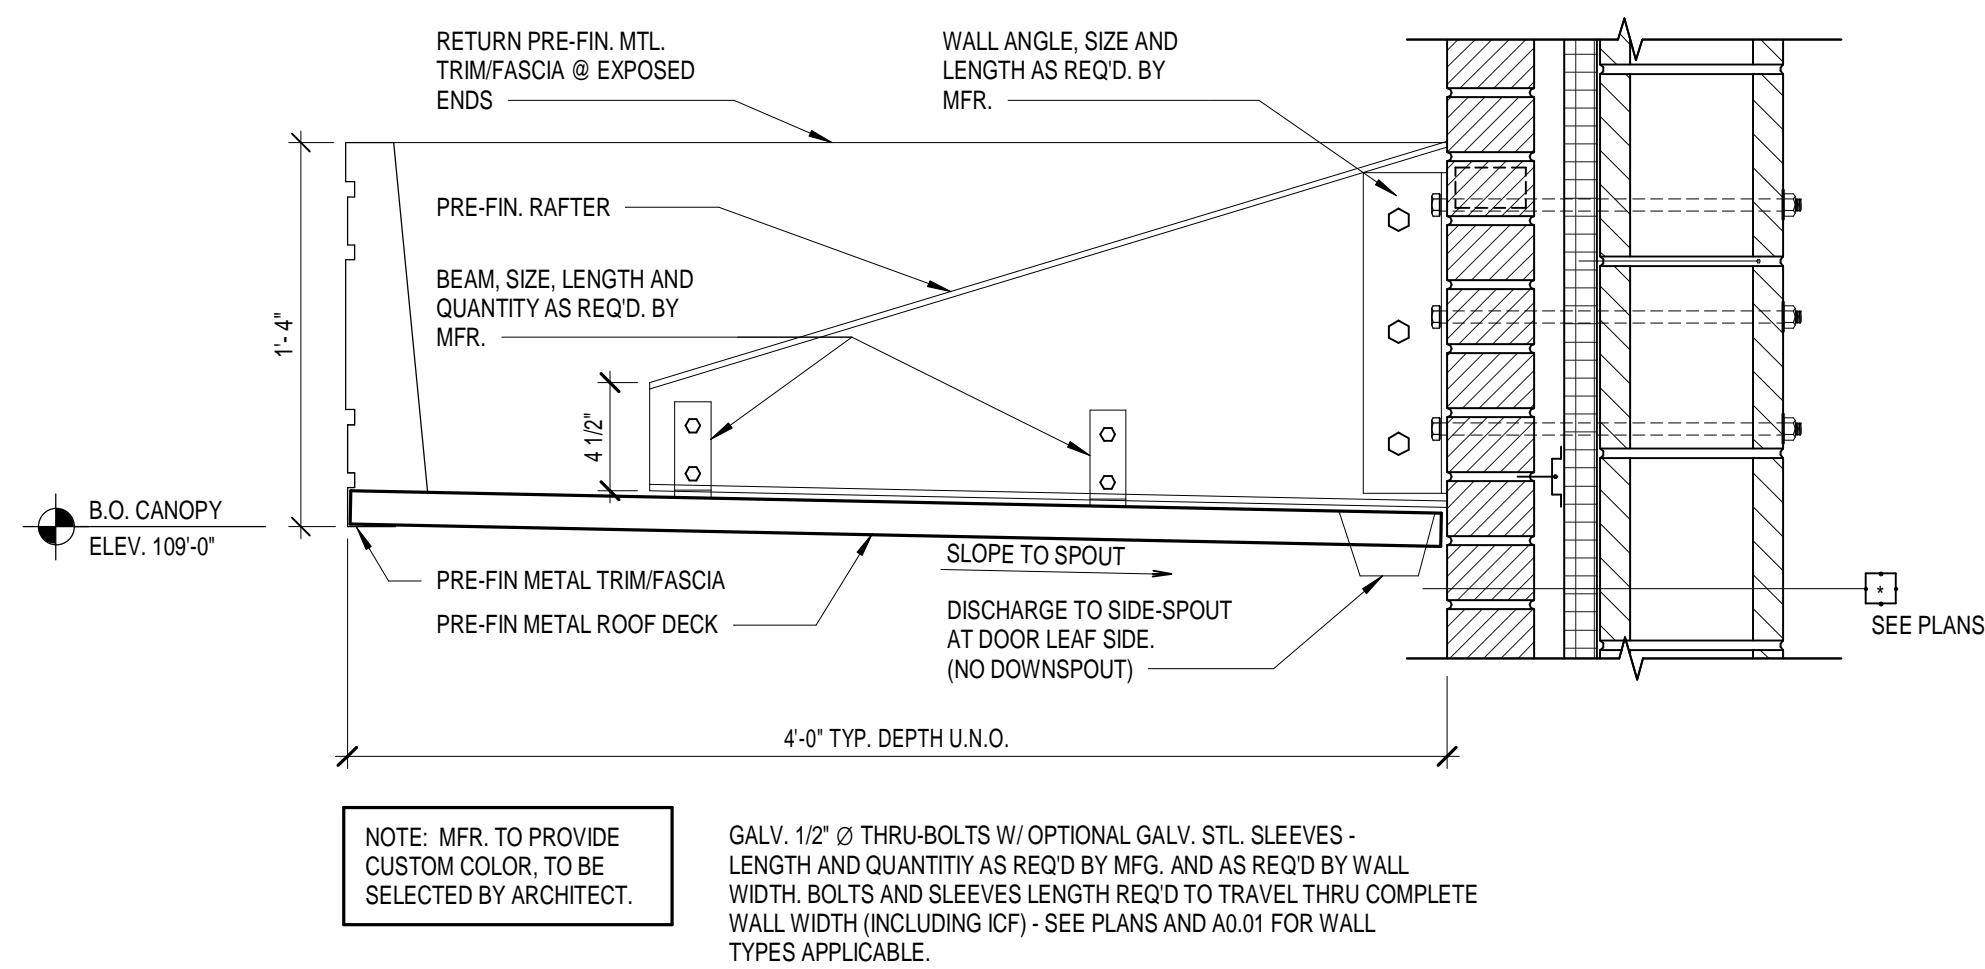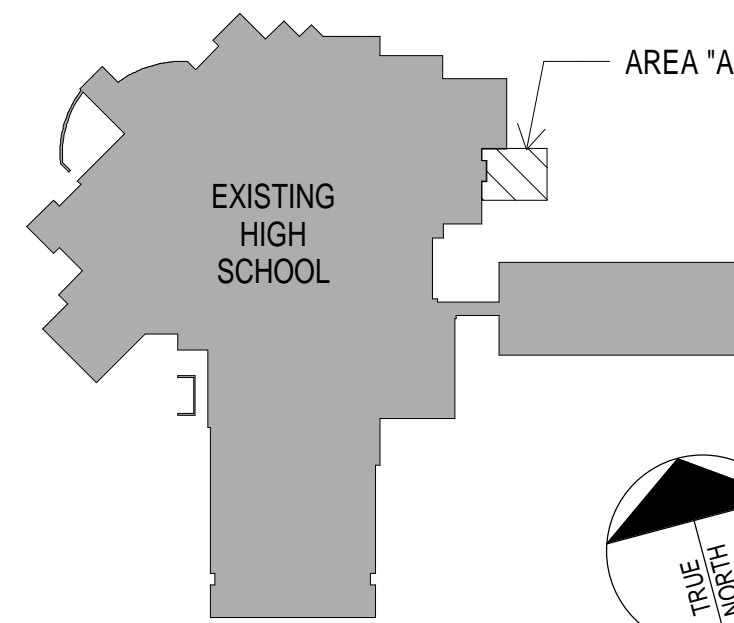


6 SECTION DETAIL
1 1/2" = 1'-0"

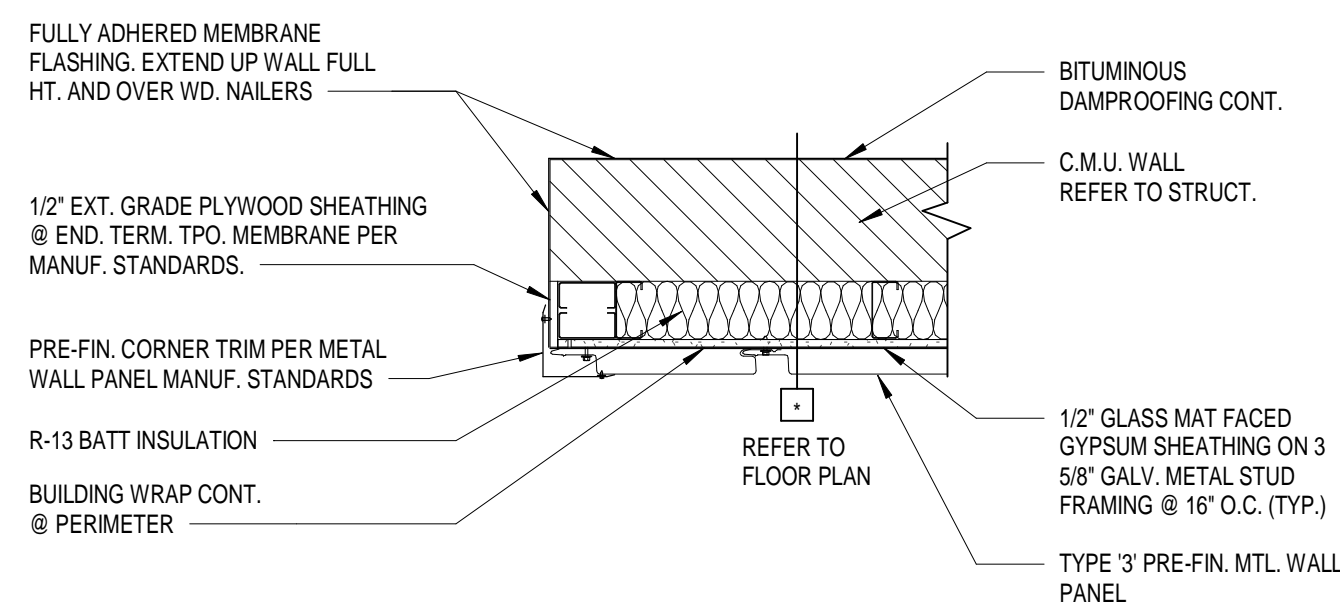


7 SECTION DETAIL
1" = 1'-0"

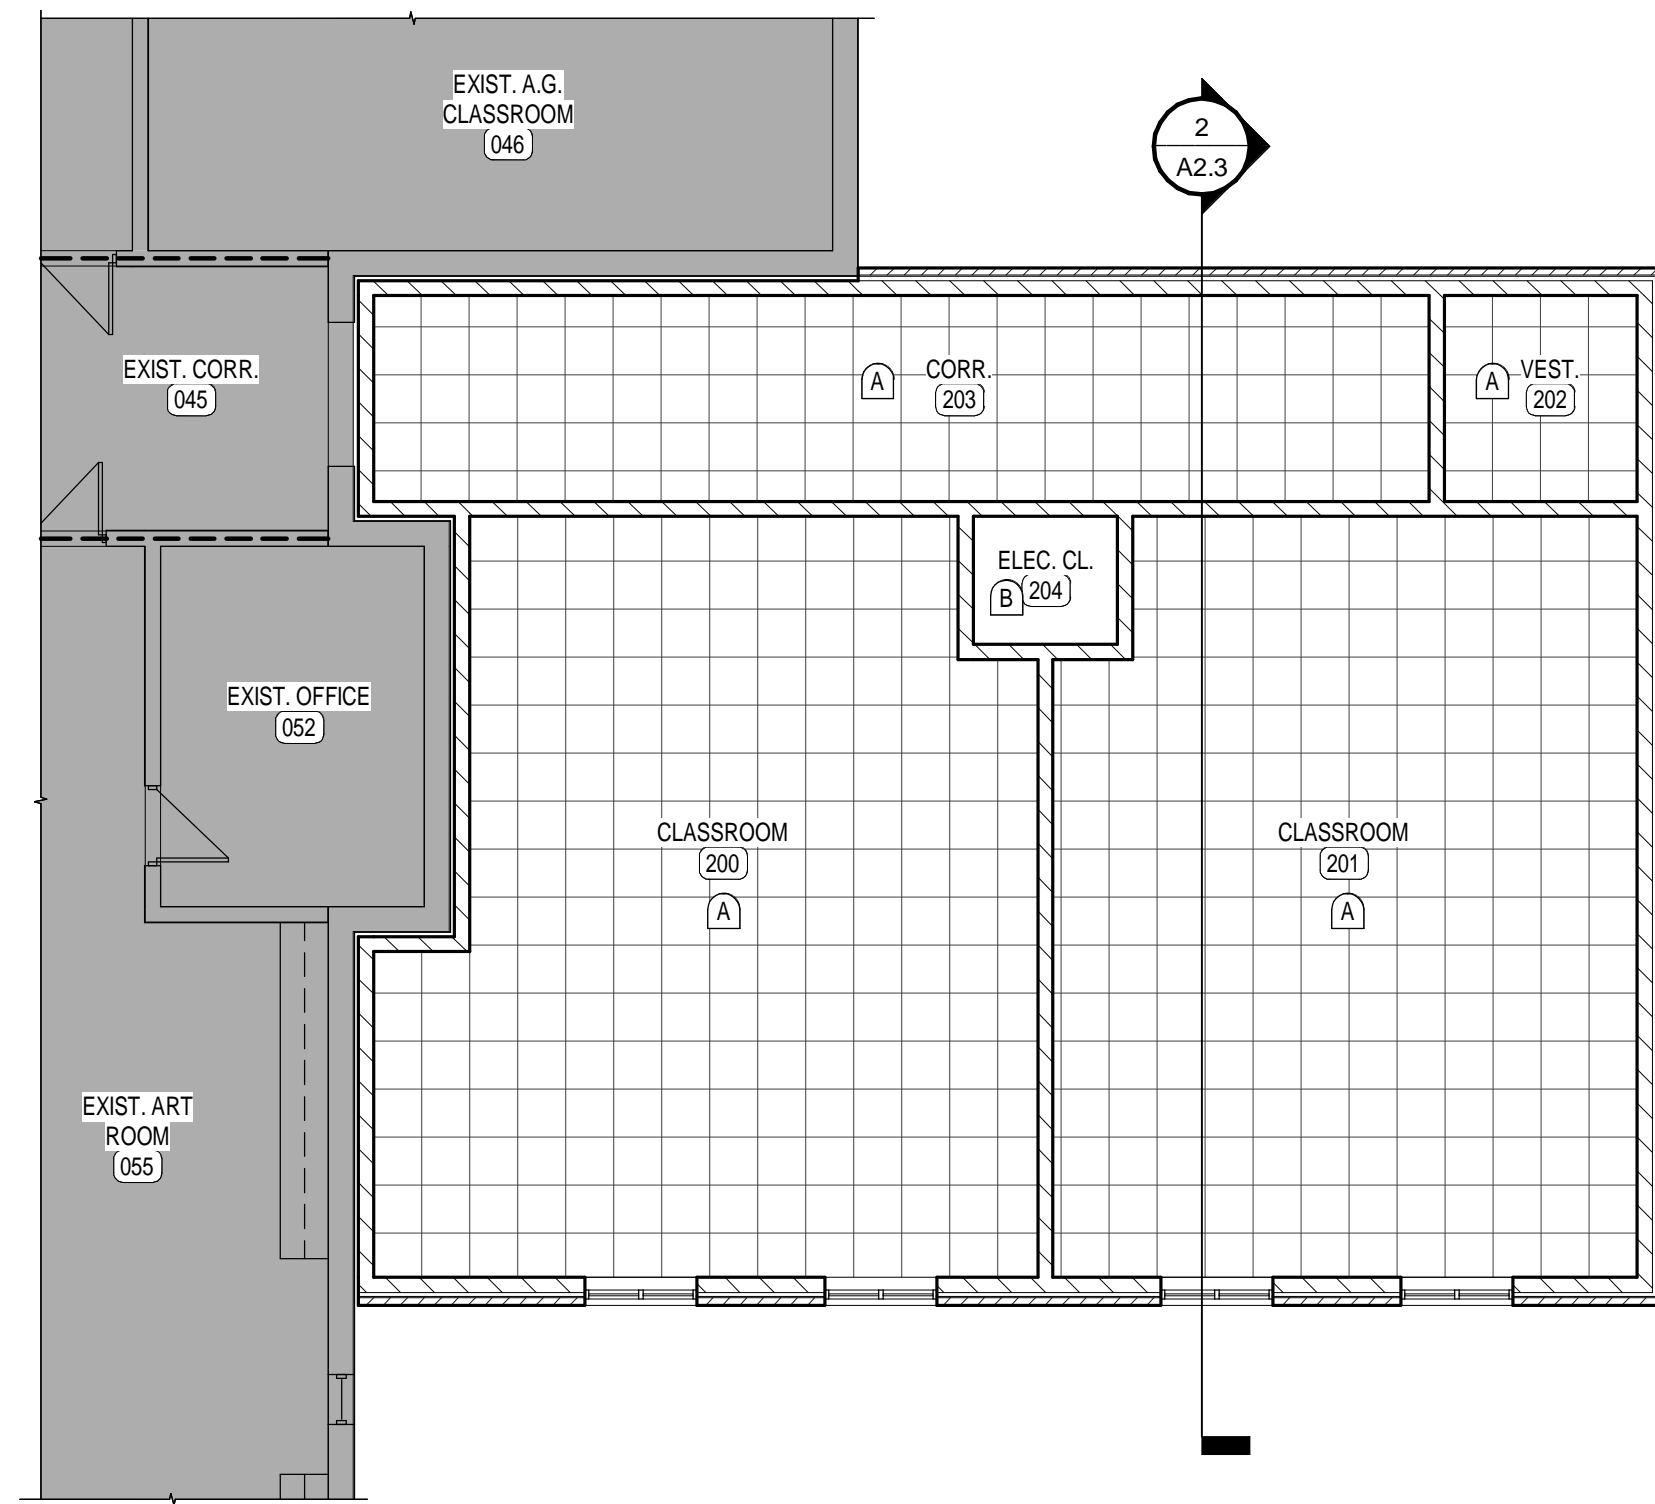


1 REFLECTED CEILING PLAN
1/8" = 1'-0"

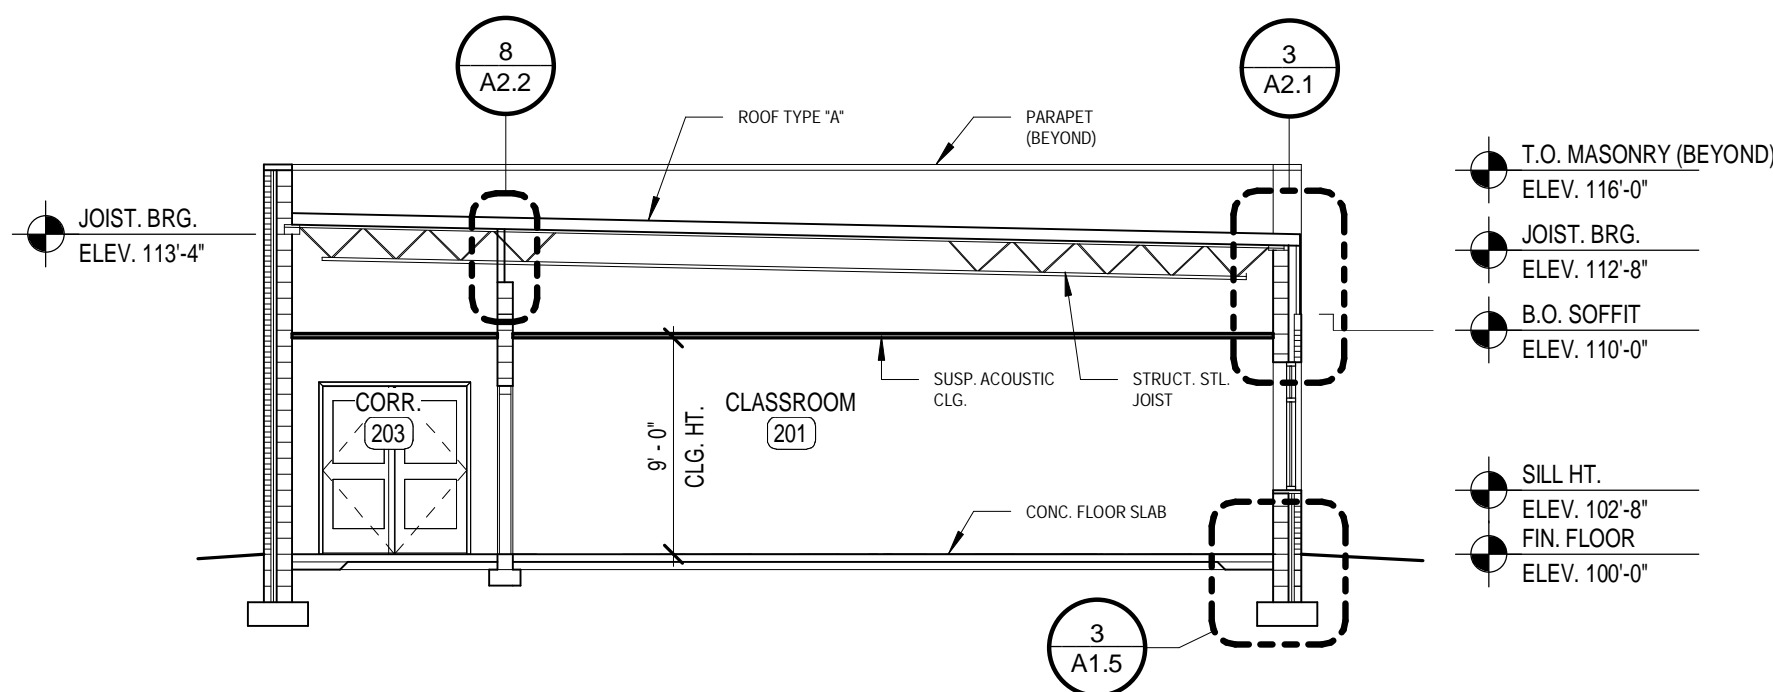


2 BUILDING SECTION
1/8" = 1'-0"

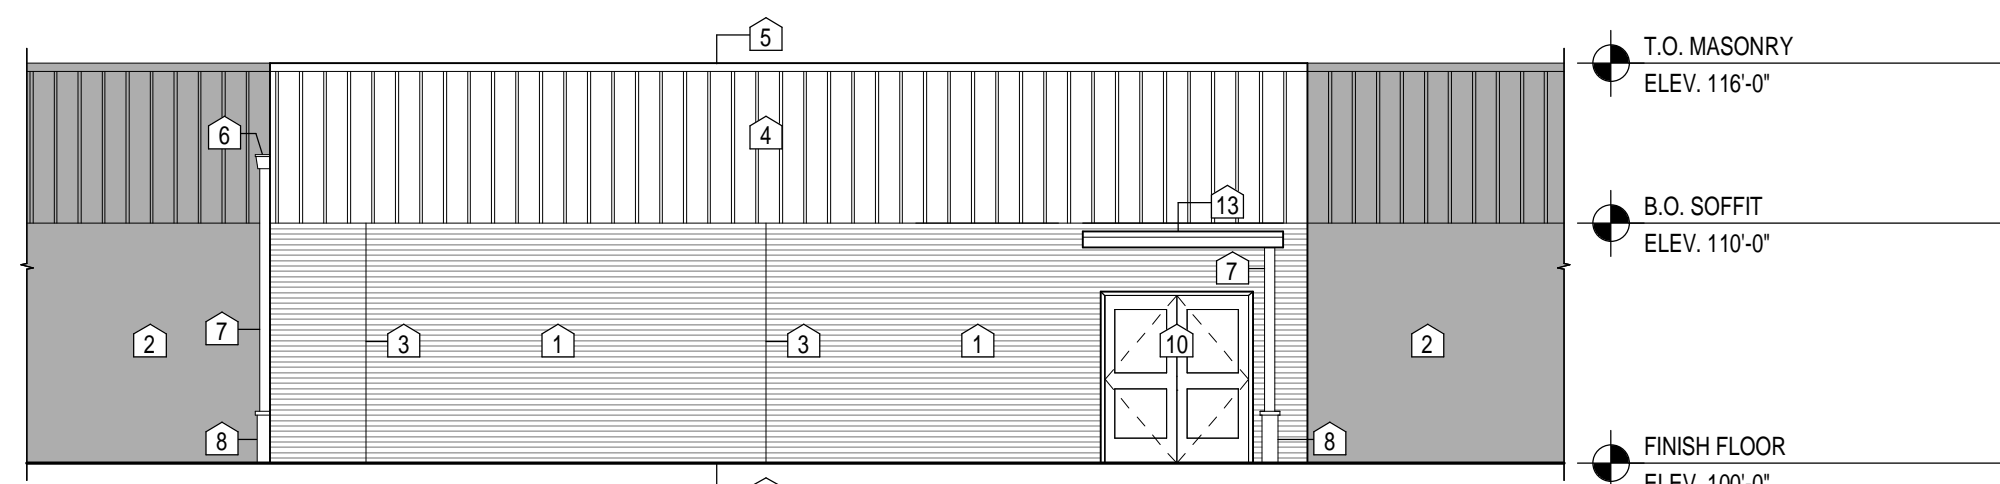

3 EAST ELEVATION
1/8" = 1'-0"

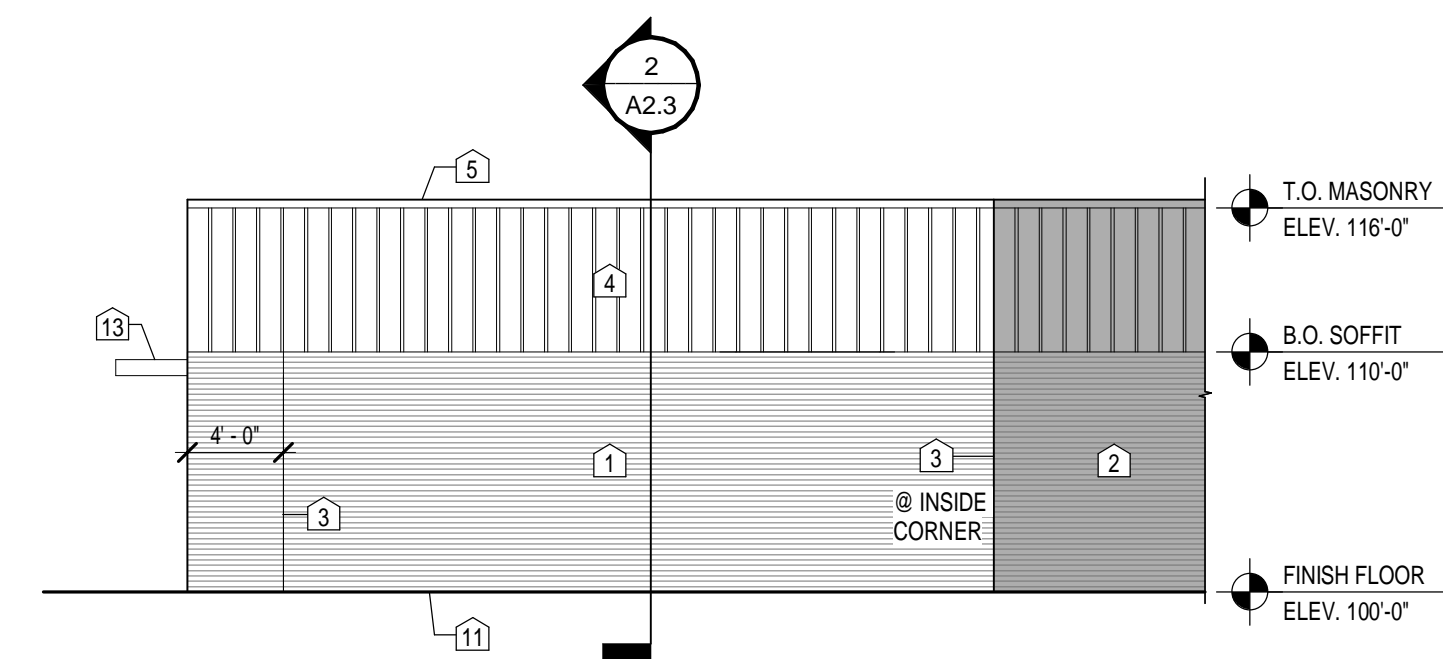

4 NORTH ELEVATION
1/8" = 1'-0"

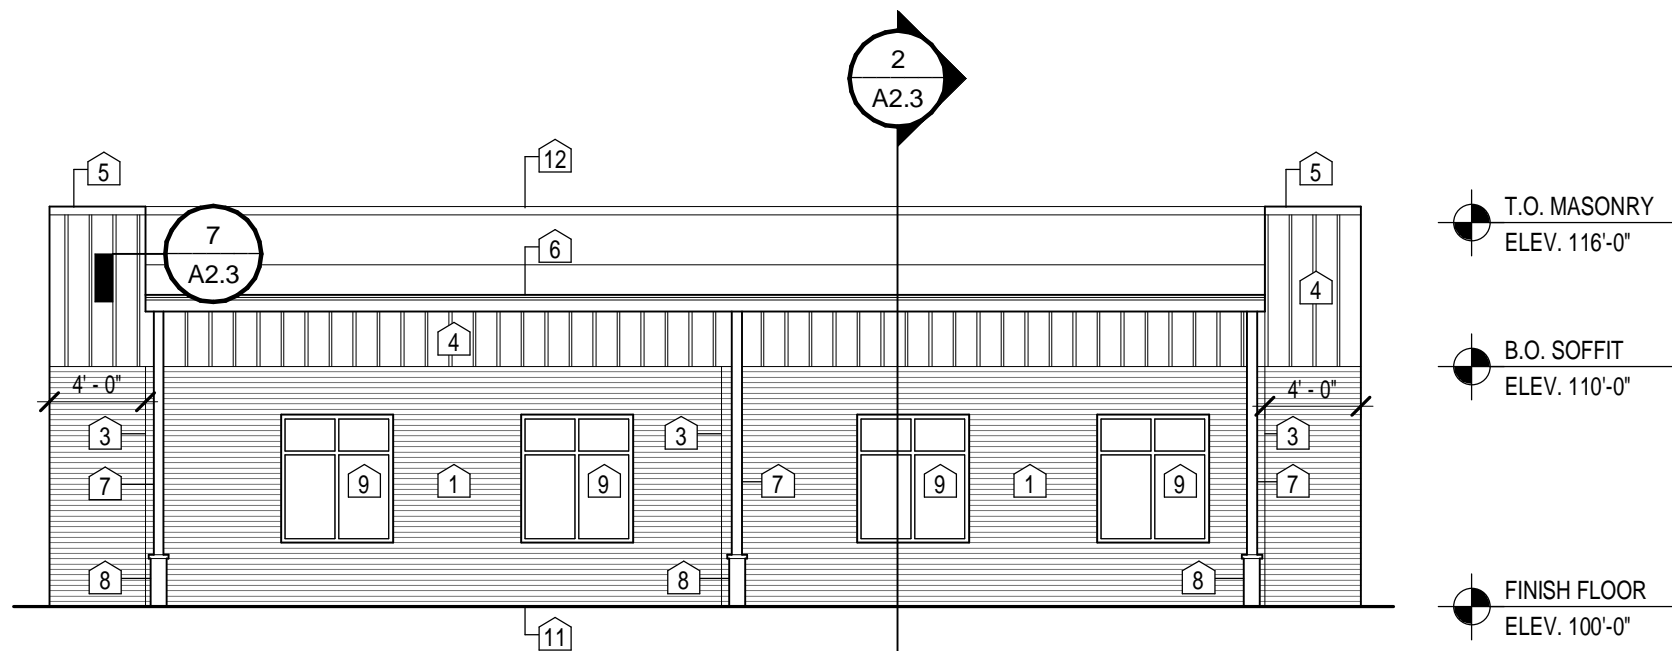

5 SOUTH ELEVATION
1/8" = 1'-0"


JOB NO.	1744, BGR17-236
DATE	APR 23, 2018
DRAWN	Author
CHECKED	Checker

COPYRIGHT © 2018
SHERMAN CARTER BARNHART
ARCHITECTS, PLLC


REVISIONS		
No.	Description	Date

SHEET


A3.1

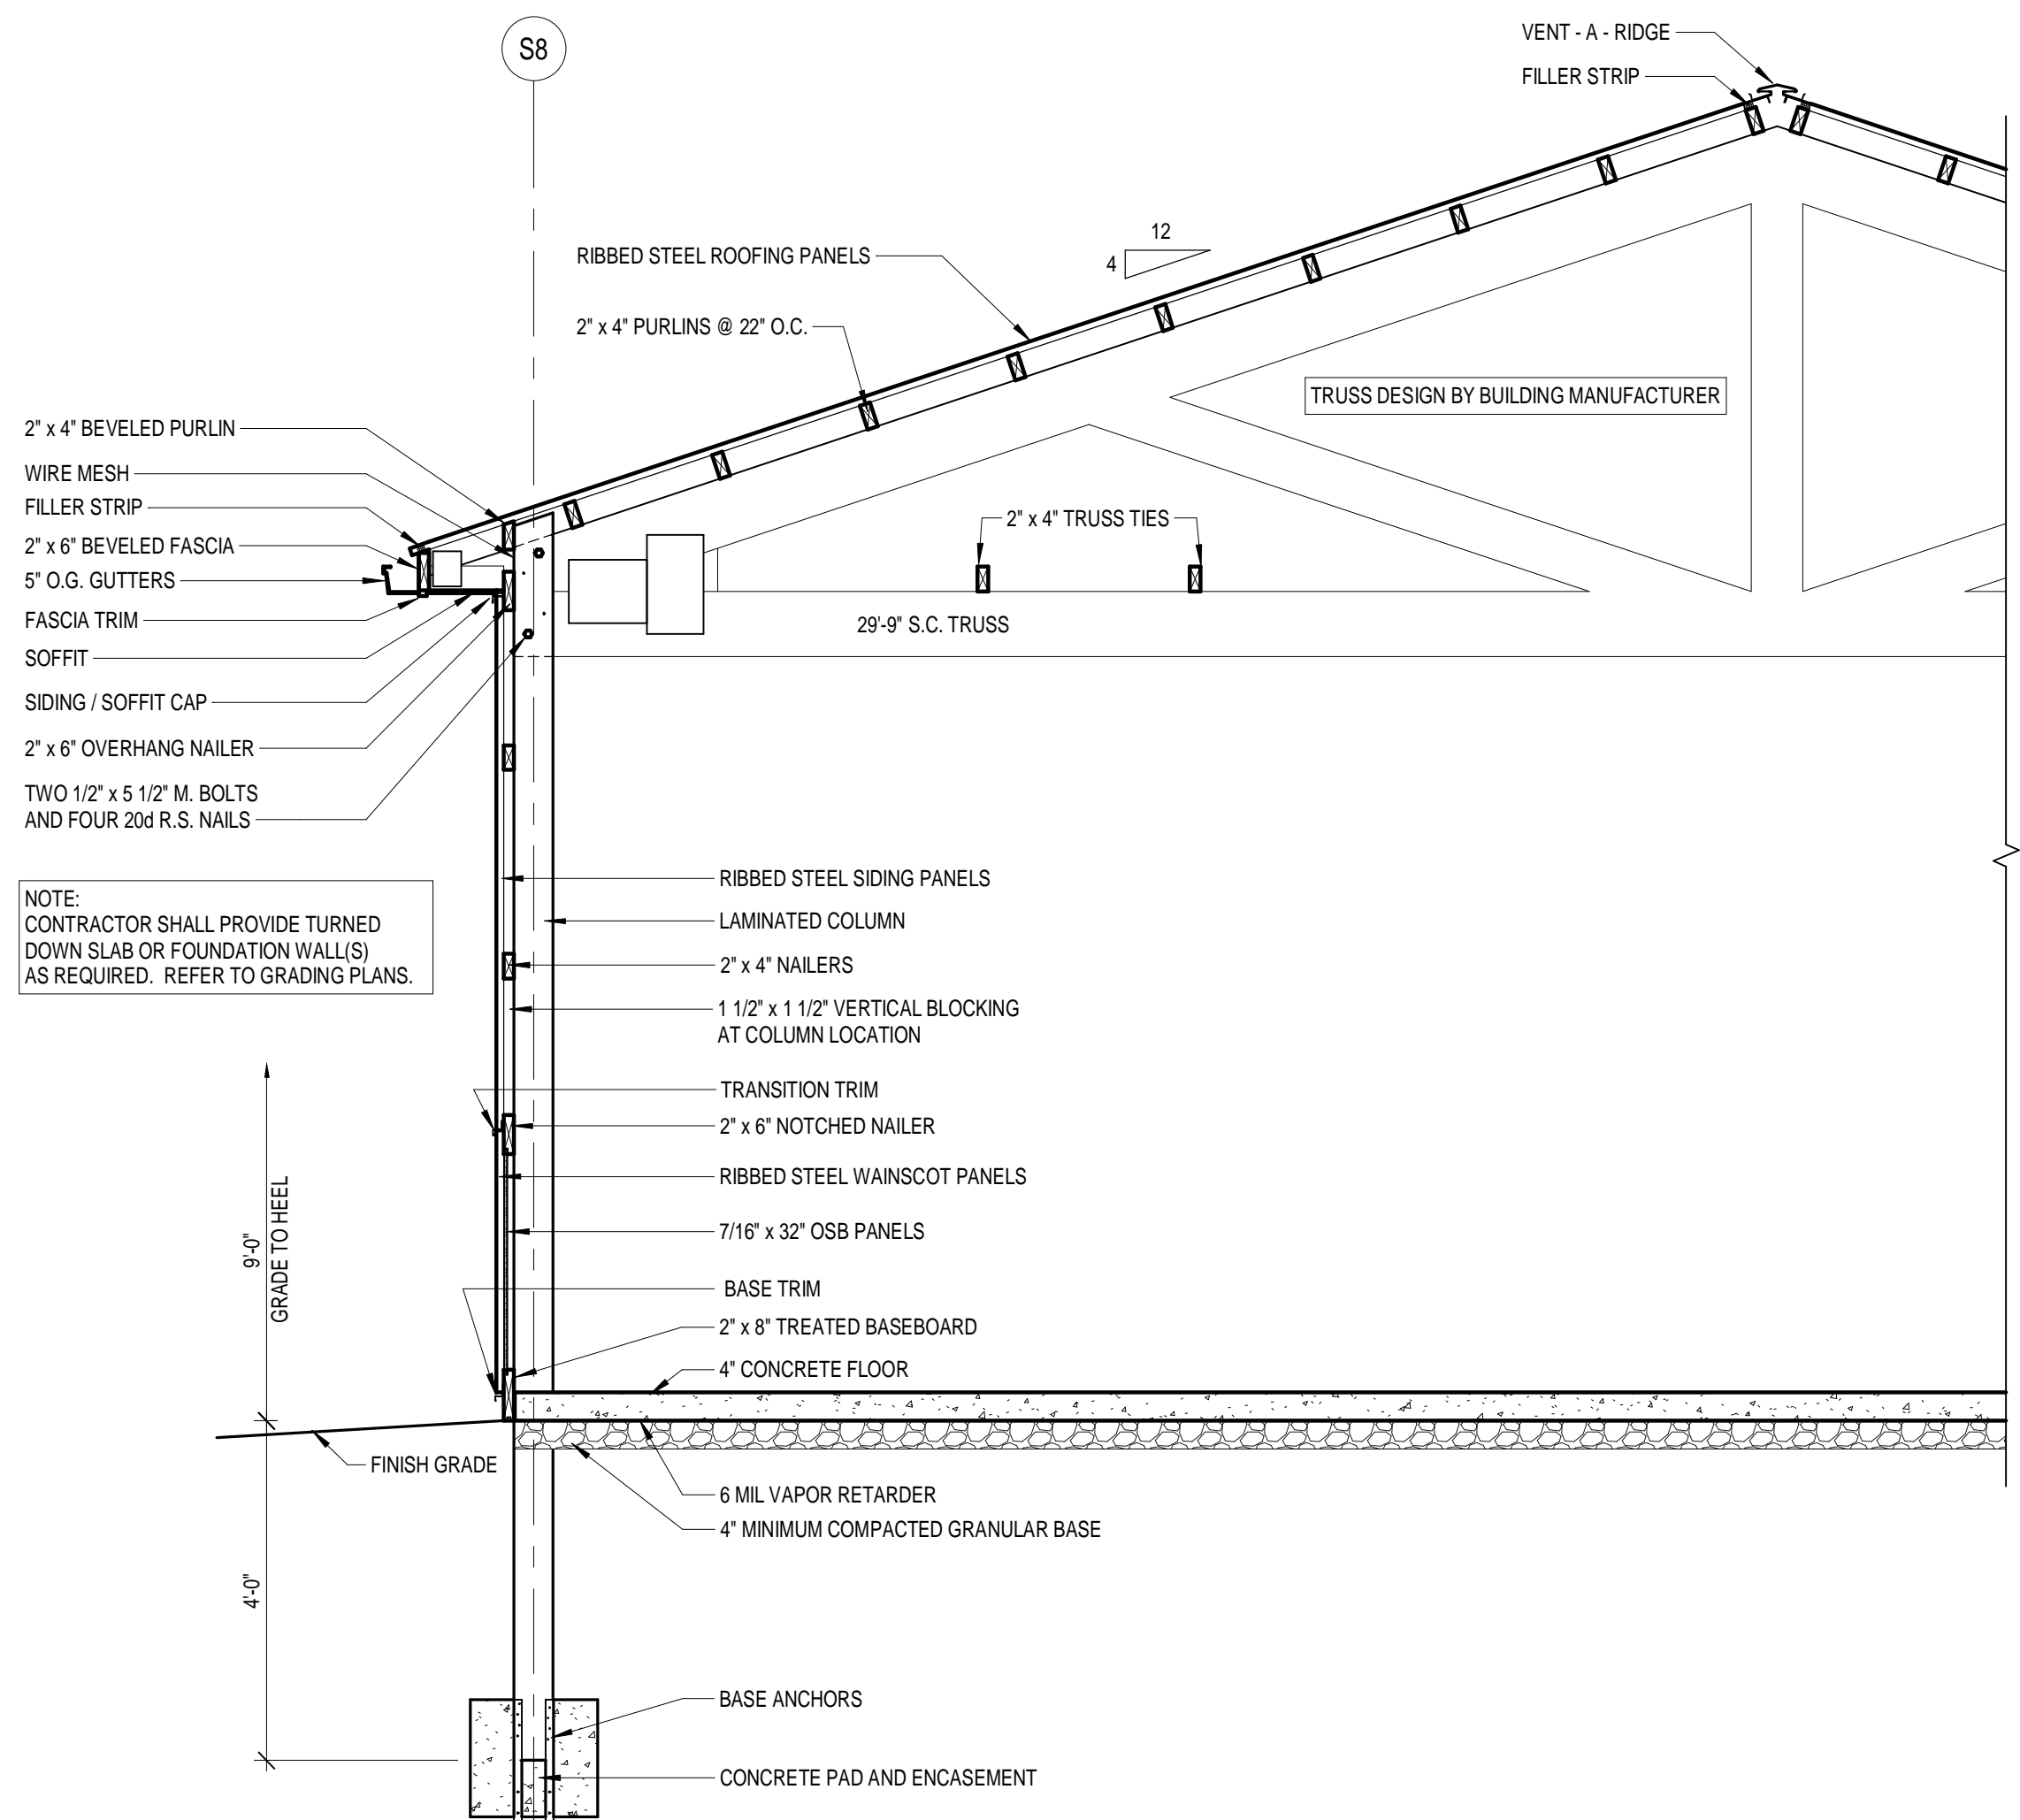


2 BUILDING SECTION AT STORAGE BLDG.
1/2" = 1'-0"

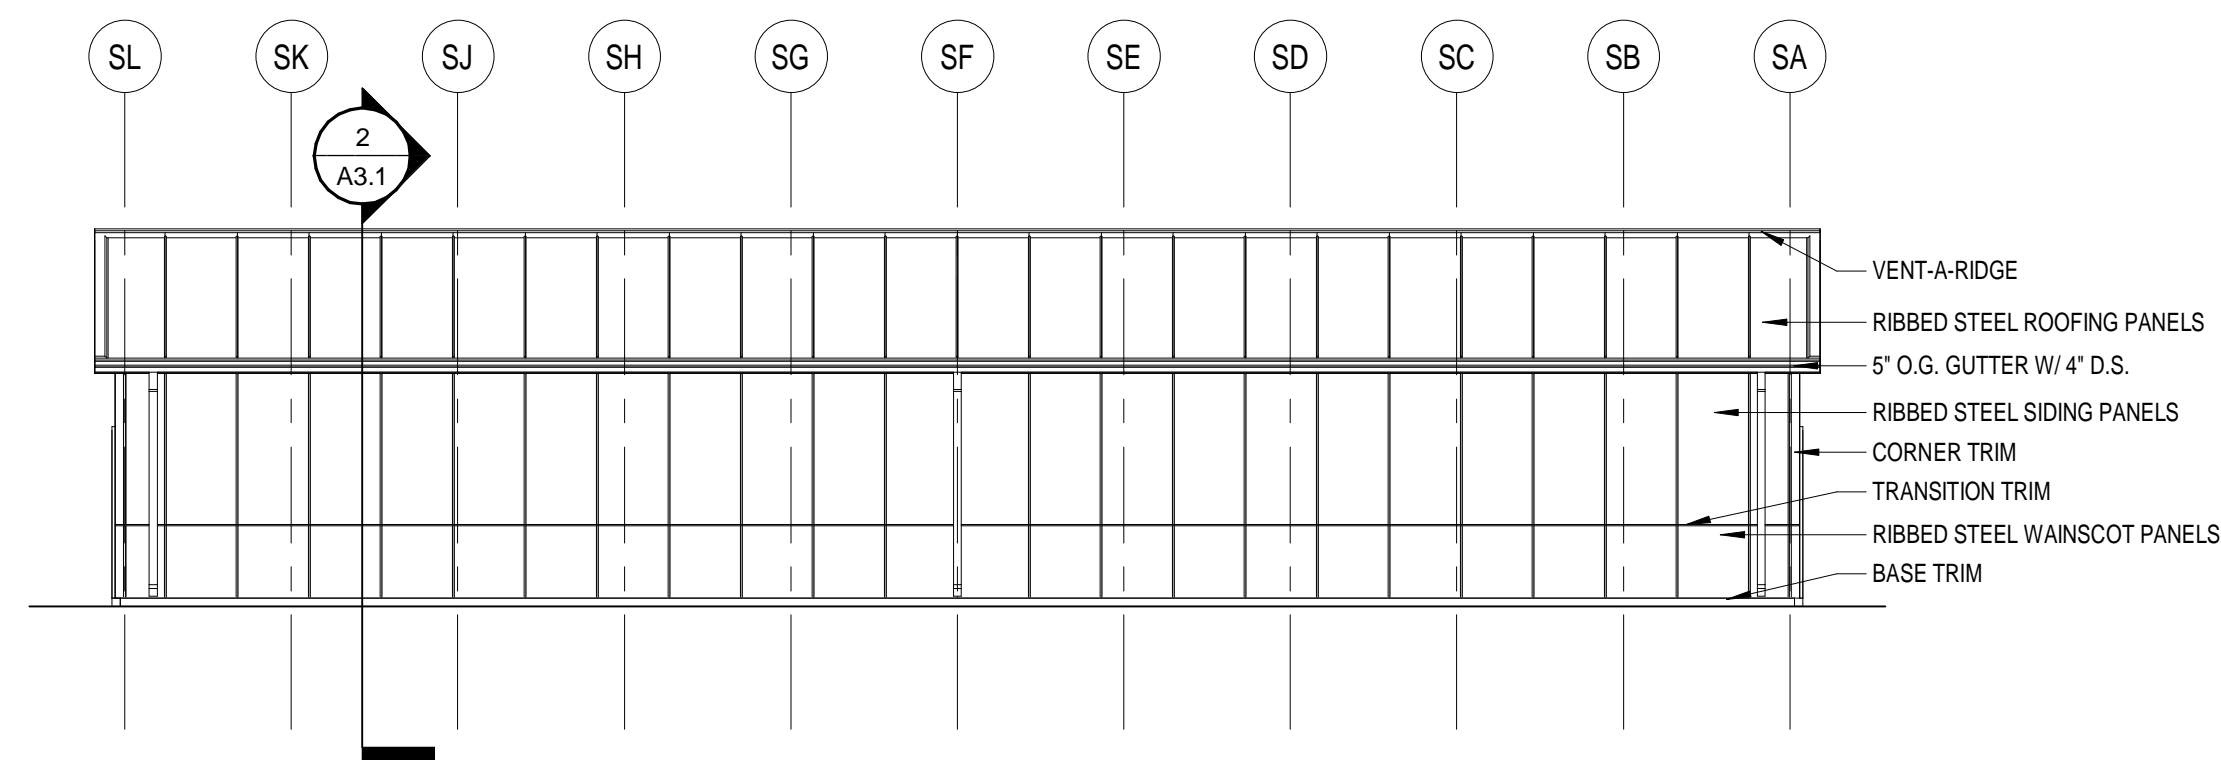


3 STORAGE BLDG - NORTH ELEVATION
1/8" = 1'-0"

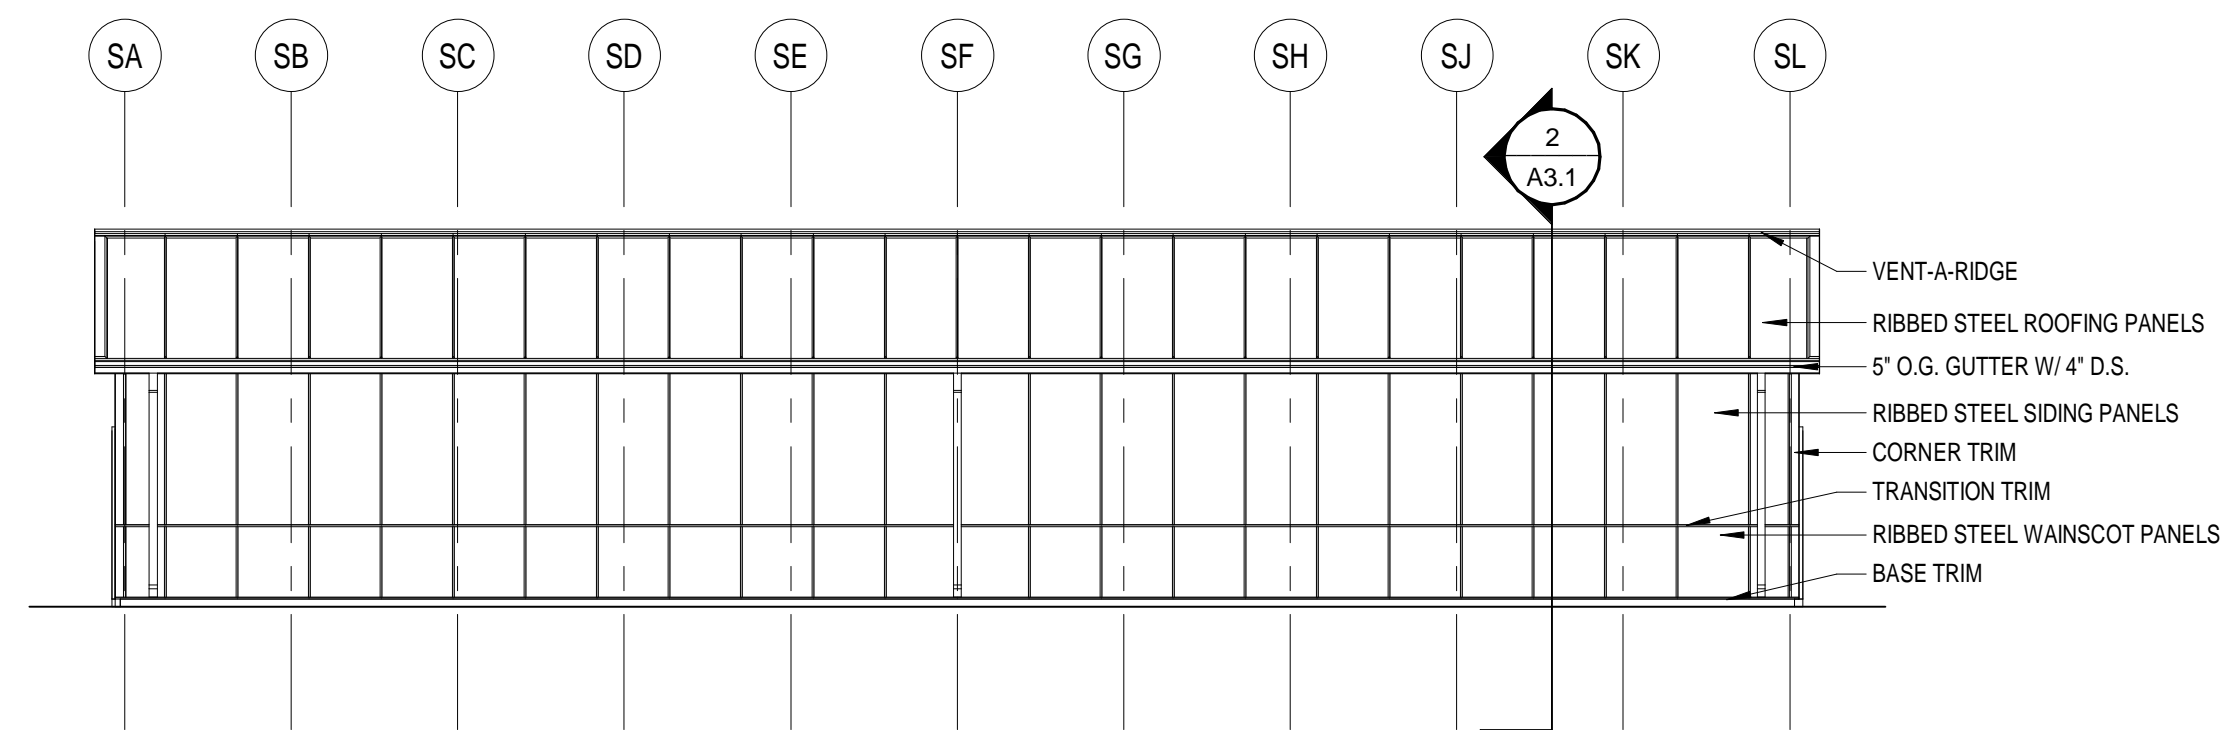

4 STORAGE BLDG - SOUTH ELEVATION
1/8" = 1'-0"

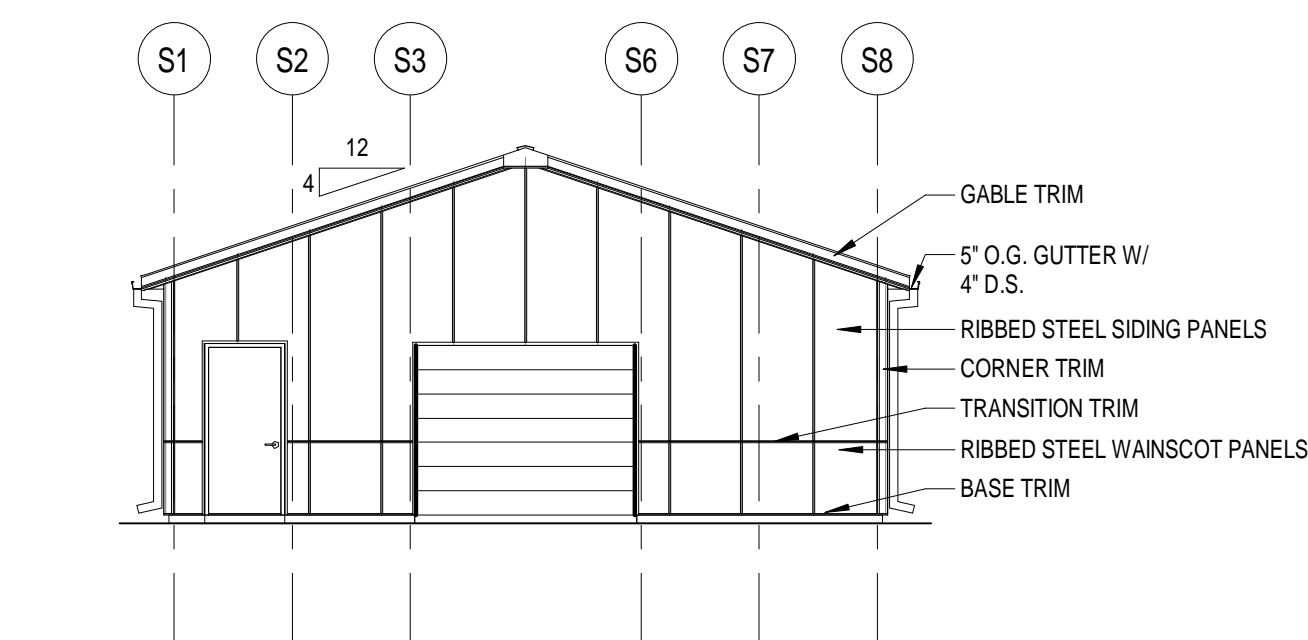

6 STORAGE BLDG - WEST ELEVATION
1/8" = 1'-0"

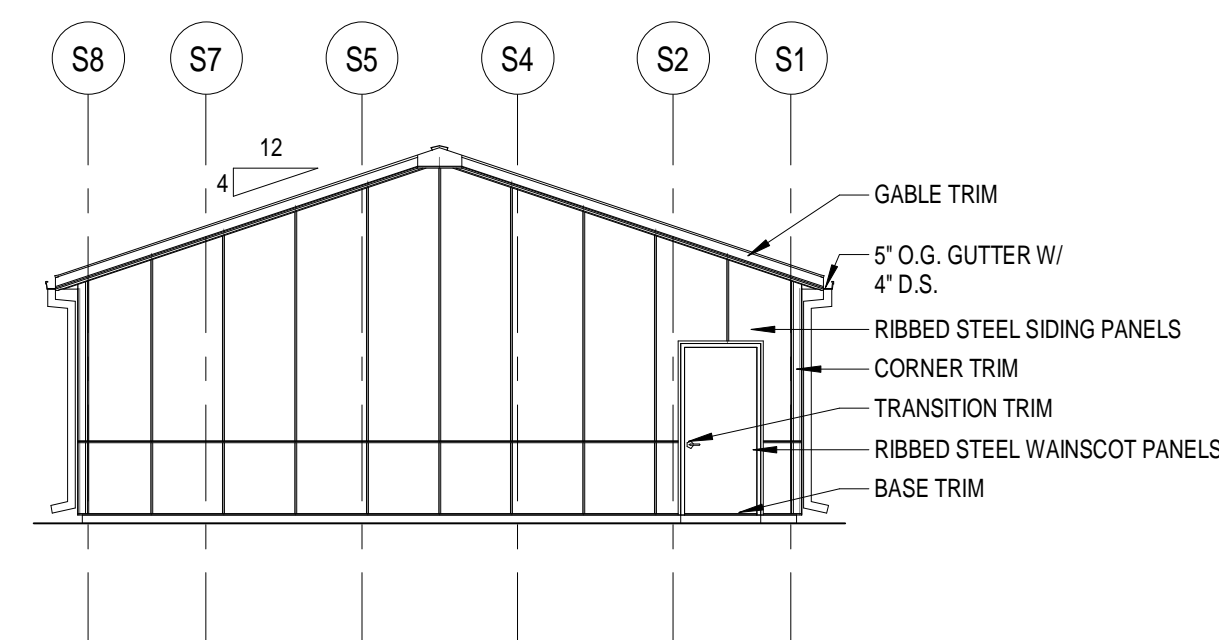

5 STORAGE BLDG - EAST ELEVATION
1/8" = 1'-0"

DESIGN CRITERIA.....

ROOF LOADING:

TOP CHORD LIVE LOAD:	20 PSF
TOP CHORD DEAD LOAD:	4 PSF
BOTTOM CHORD DEAD LOAD:	4 PSF
TOTAL LOAD:	28 PSF
WIND SPEED:	90 MPH (V30)
EXPOSURE B	
IMPORTANCE FACTOR (WIND) = 1.0	
BASE SHEAR (TRANSVERSE) = 5,100 POUNDS	
BASE SHEAR (LONGITUDINAL) = 3,150 POUNDS	

THE DESIGN OF THE ROOF TRUSS
AND SIDING OF THE LAMINATED
COLUMN AND FOOTING IS THE
RESPONSIBILITY OF THE
BUILDING MANUFACTURER.

SNOW CALCULATION:



P _s = LIVE ROOF LOAD
P _g = 20 PSF = GROUND SNOW LOAD
C _e = 1.0 = EXPOSURE FACTOR
C _t = 1.2 = THERMAL FACTOR
I = 1.0 = IMPORTANCE FACTOR (SNOW)
C _s = 1.0 = SLOPE FACTOR
P _s = 7 x P _g x C _e x C _t x I x C _s
16.8 PSF = 7 x 20 x 1.0 x 1.2 x 1.0 x 1.0

MINIMUM ROOF LIVE LOAD CALCULATION:

L _r = ROOF LIVE LOAD
R ₁ = 1.0 = AREA REDUCTION FACTOR
R ₂ = 1.0 = PITCH REDUCTION FACTOR
L _r = 20 PSF x R ₁ x R ₂
20 PSF = 20 x 1.0 x 1.0
DESIGN FOR MINIMUM 20 PSF ROOF LIVE LOAD


SEISMIC:

IMPORTANCE FACTOR (SEISMIC) = 1.0
S _{DS} = 0.287
S ₀₁ = 0.160
SITE CLASS : D
USE GROUP : I
SEISMIC DESIGN CATEGORY : B
SIMPLIFIED ANALYTICAL PROCEDURE
BASE SHEAR (TRANSVERSE) = 1,650 POUNDS
BASE SHEAR (LONGITUDINAL) = 1,050 POUNDS

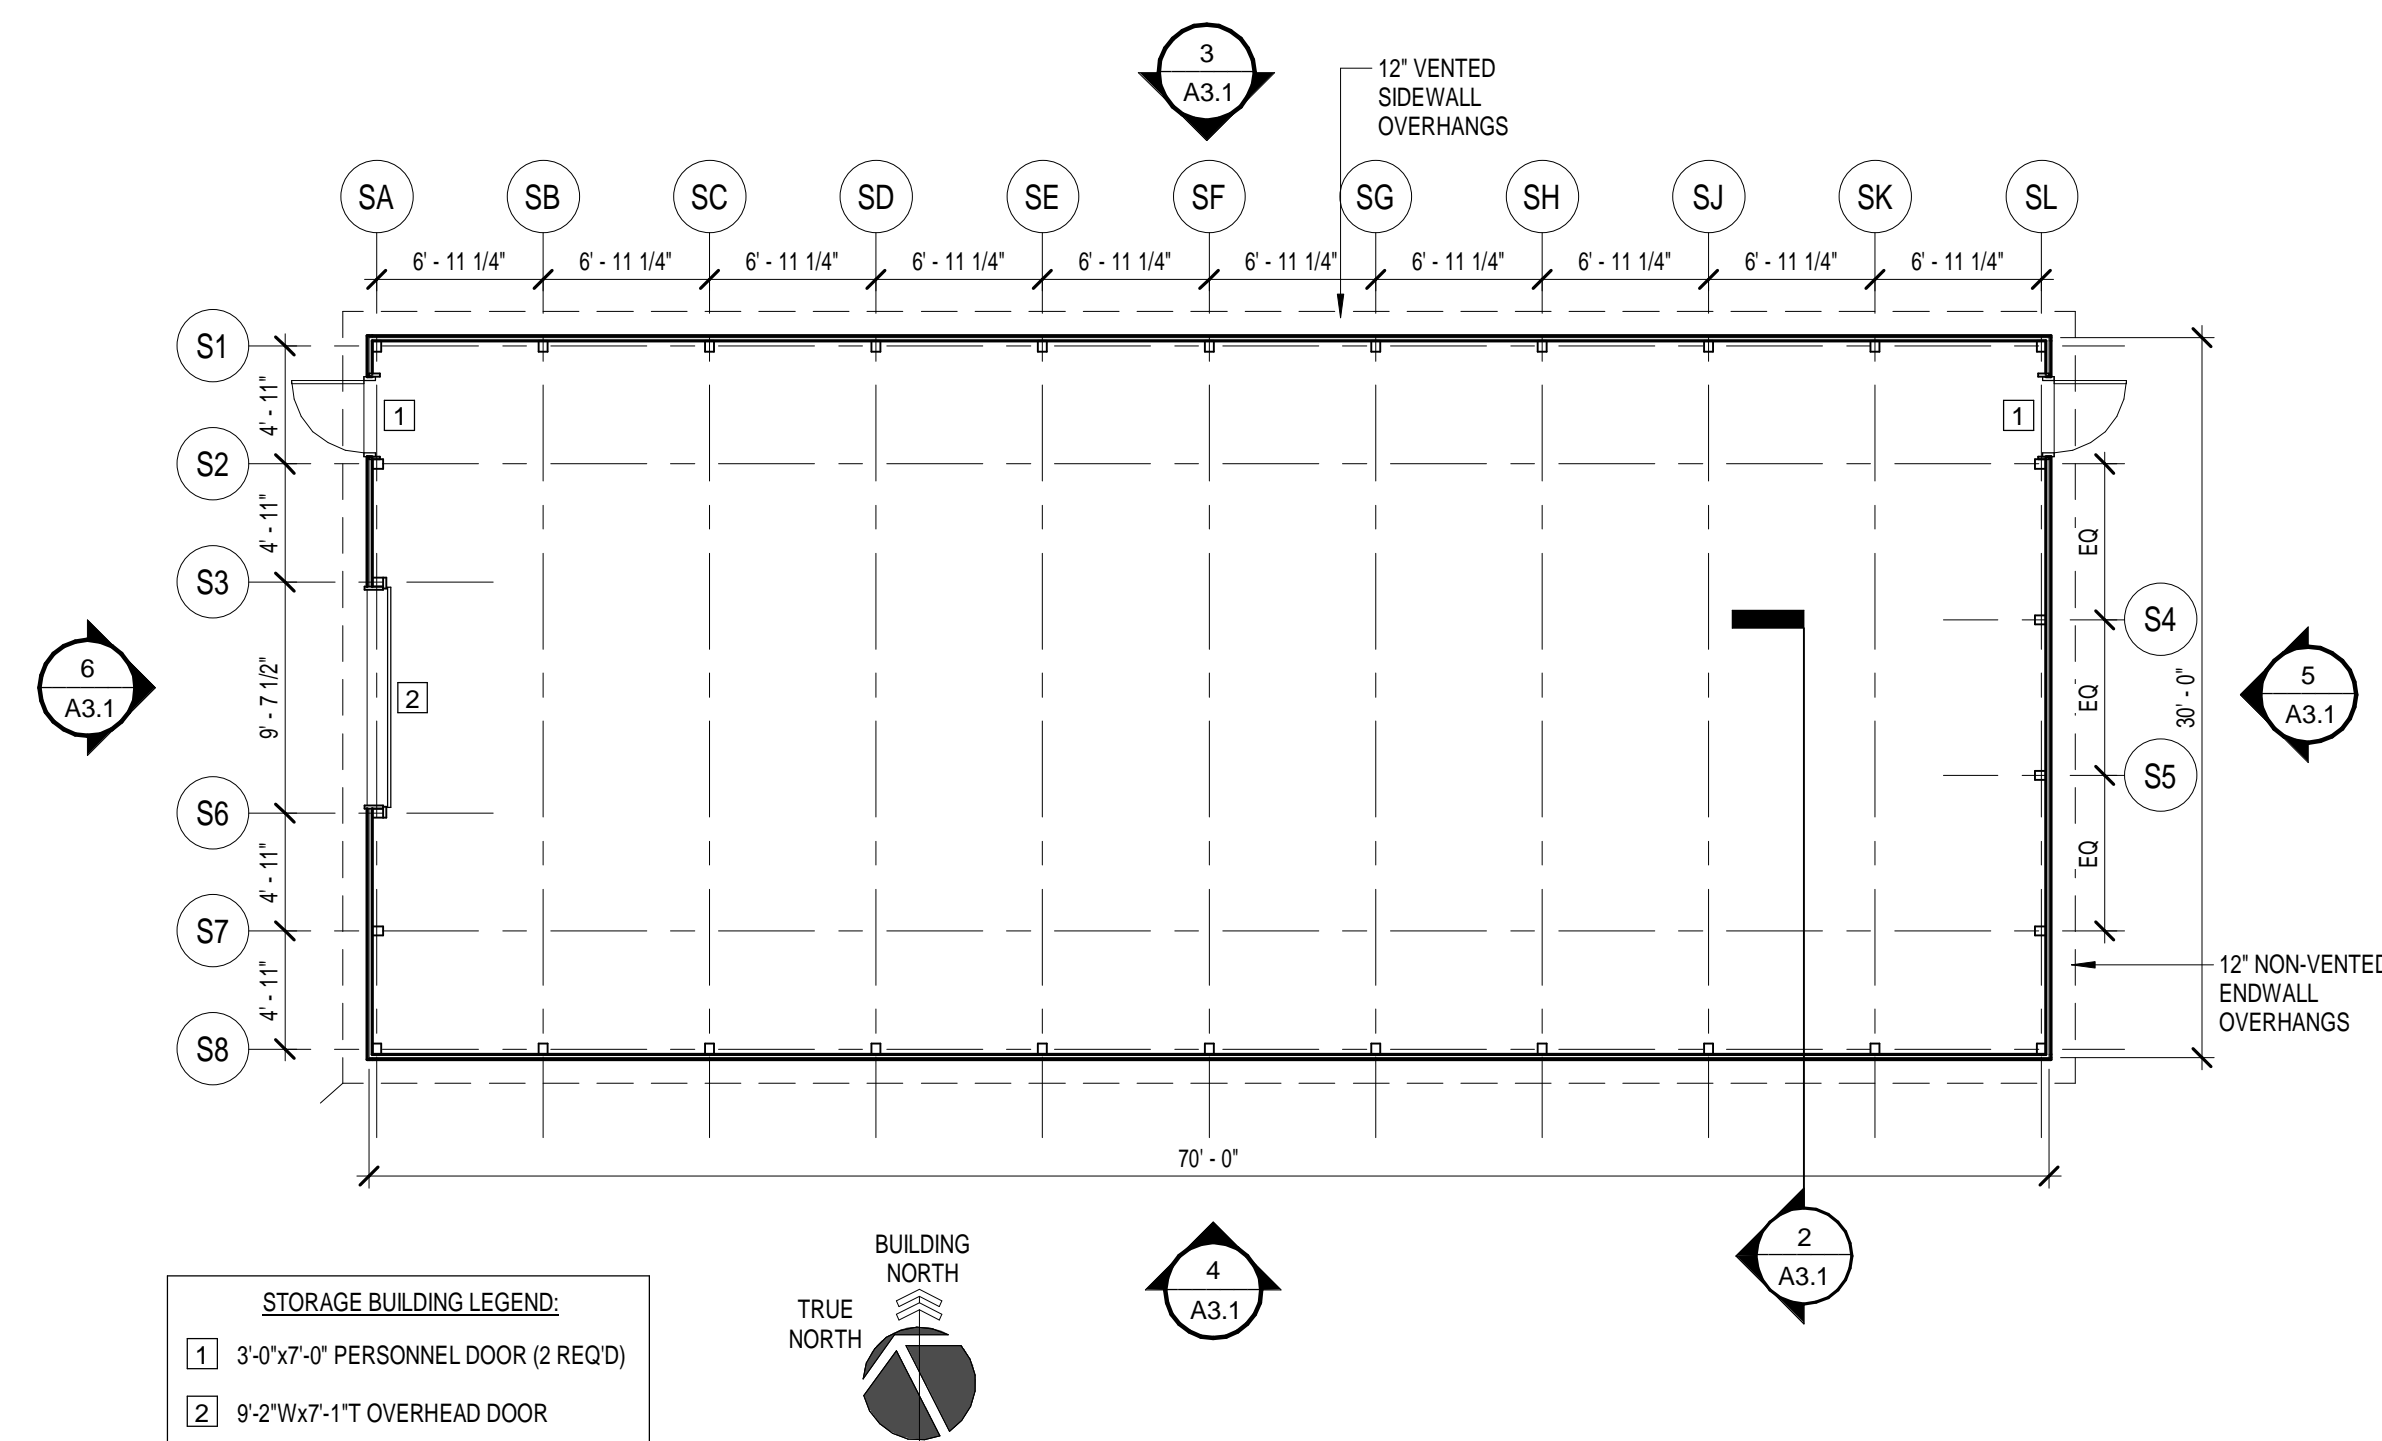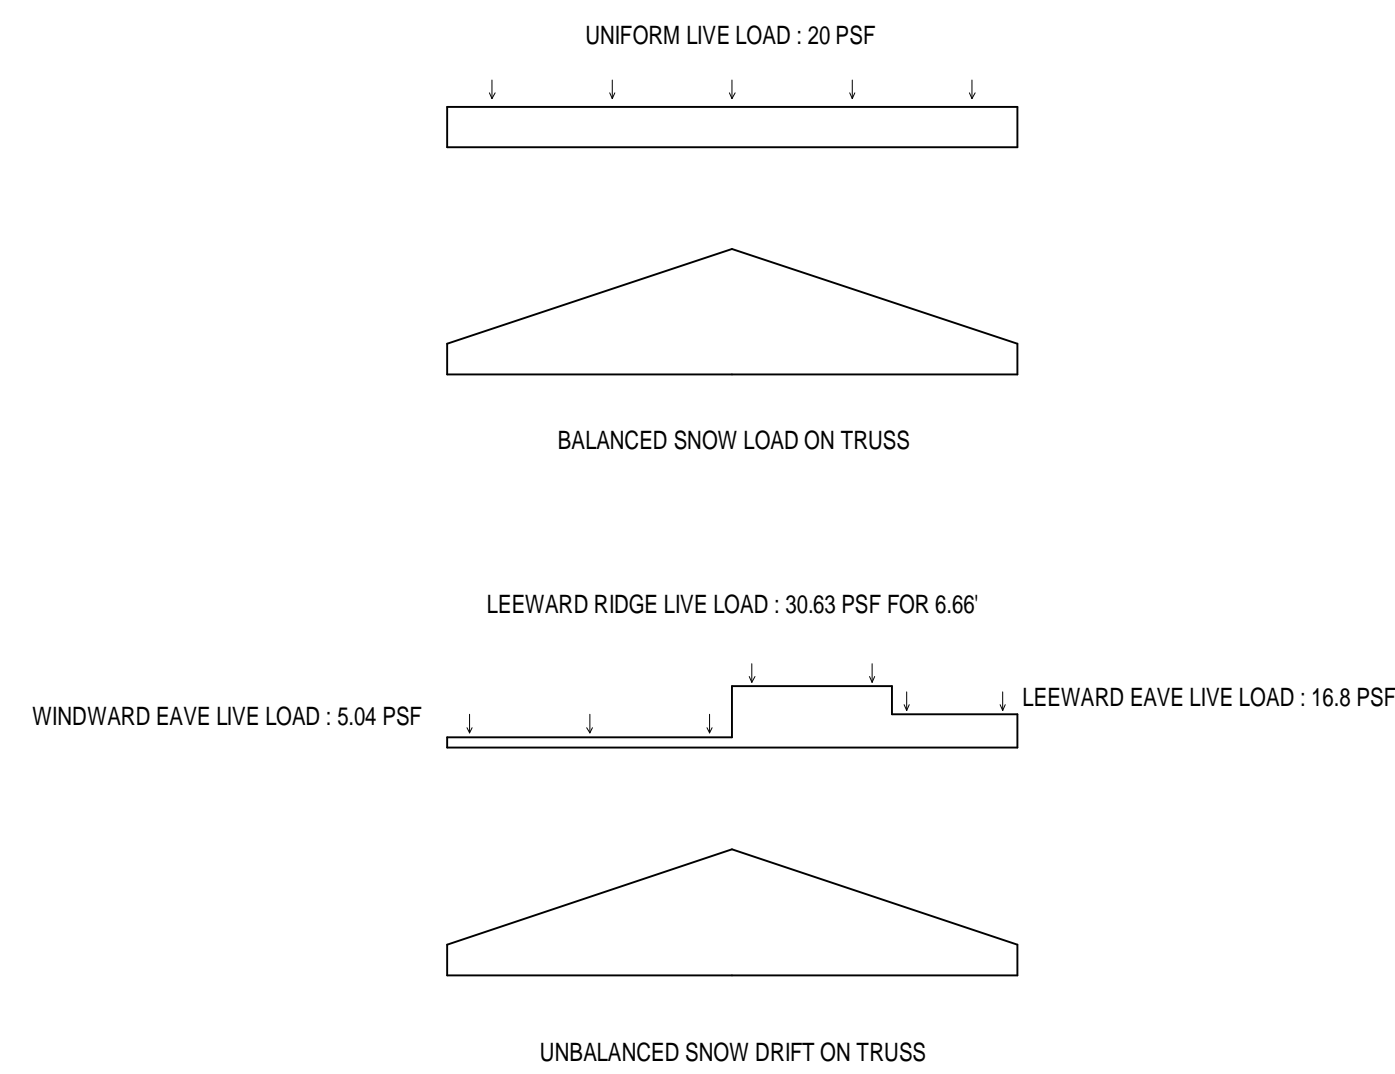


1 FLOOR PLAN - STORAGE BUILDING
1/8" = 1'-0"


1744 BG#17-236
SPENCER CO. HIGH SCHOOL ACADEMIC AND ATHLETIC BUILDINGS
4/22/2018 1:29:31 PM

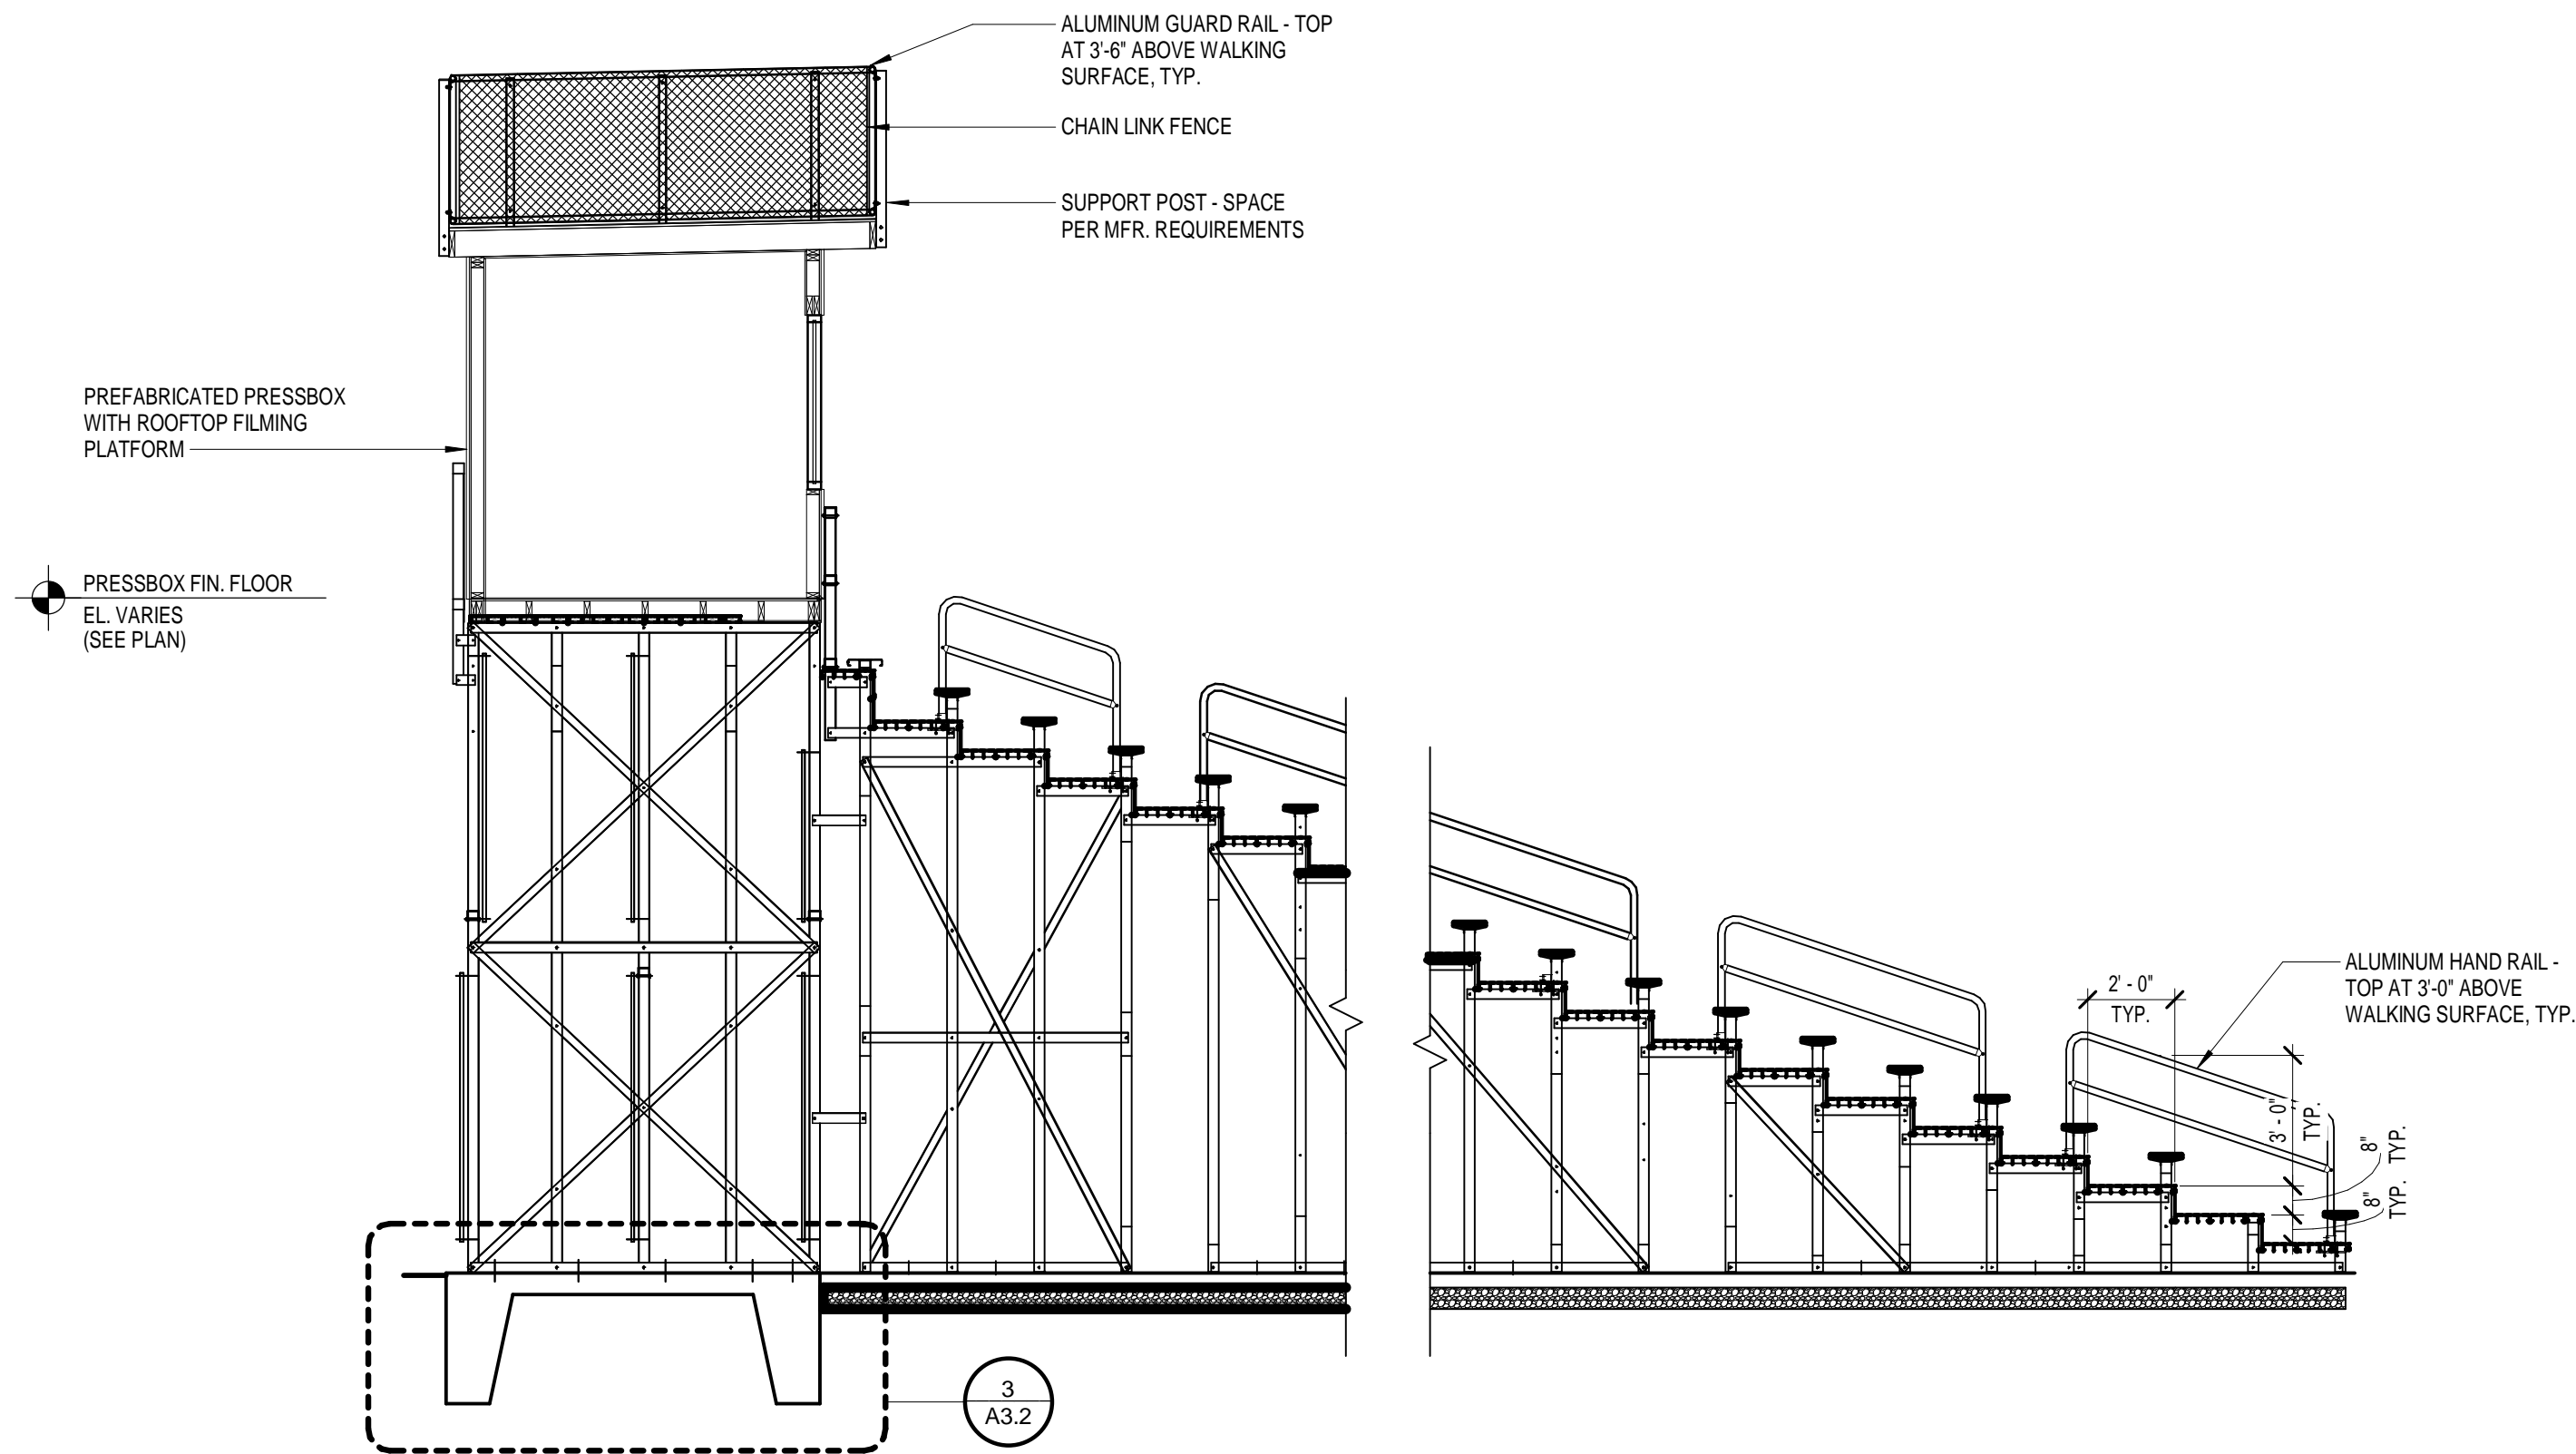


4 BLEACHER SECTION
1/4" = 1'-0"

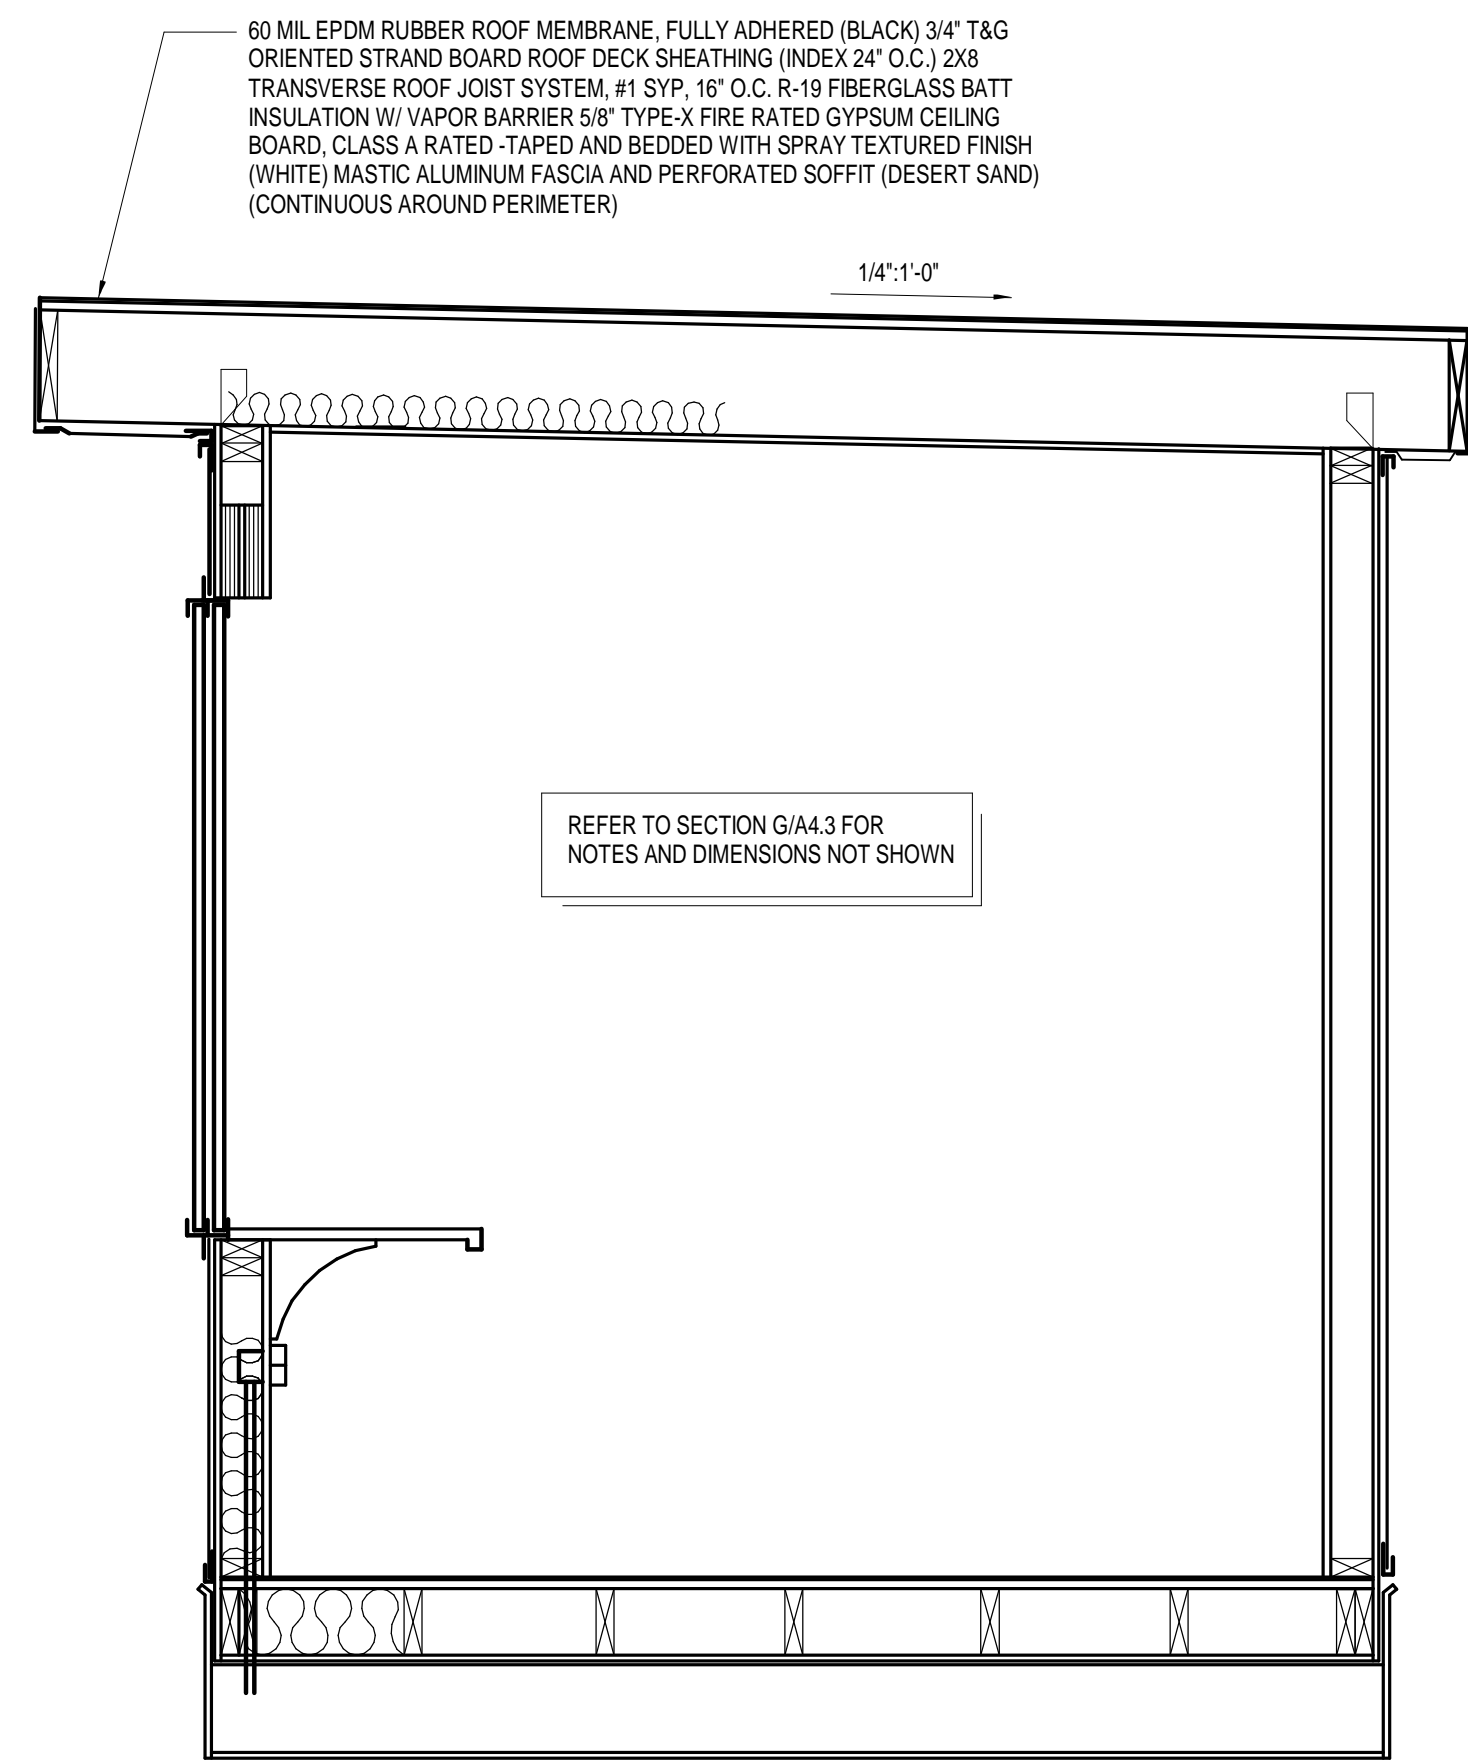


5 PRESS BOX SECTION
3/4" = 1'-0"

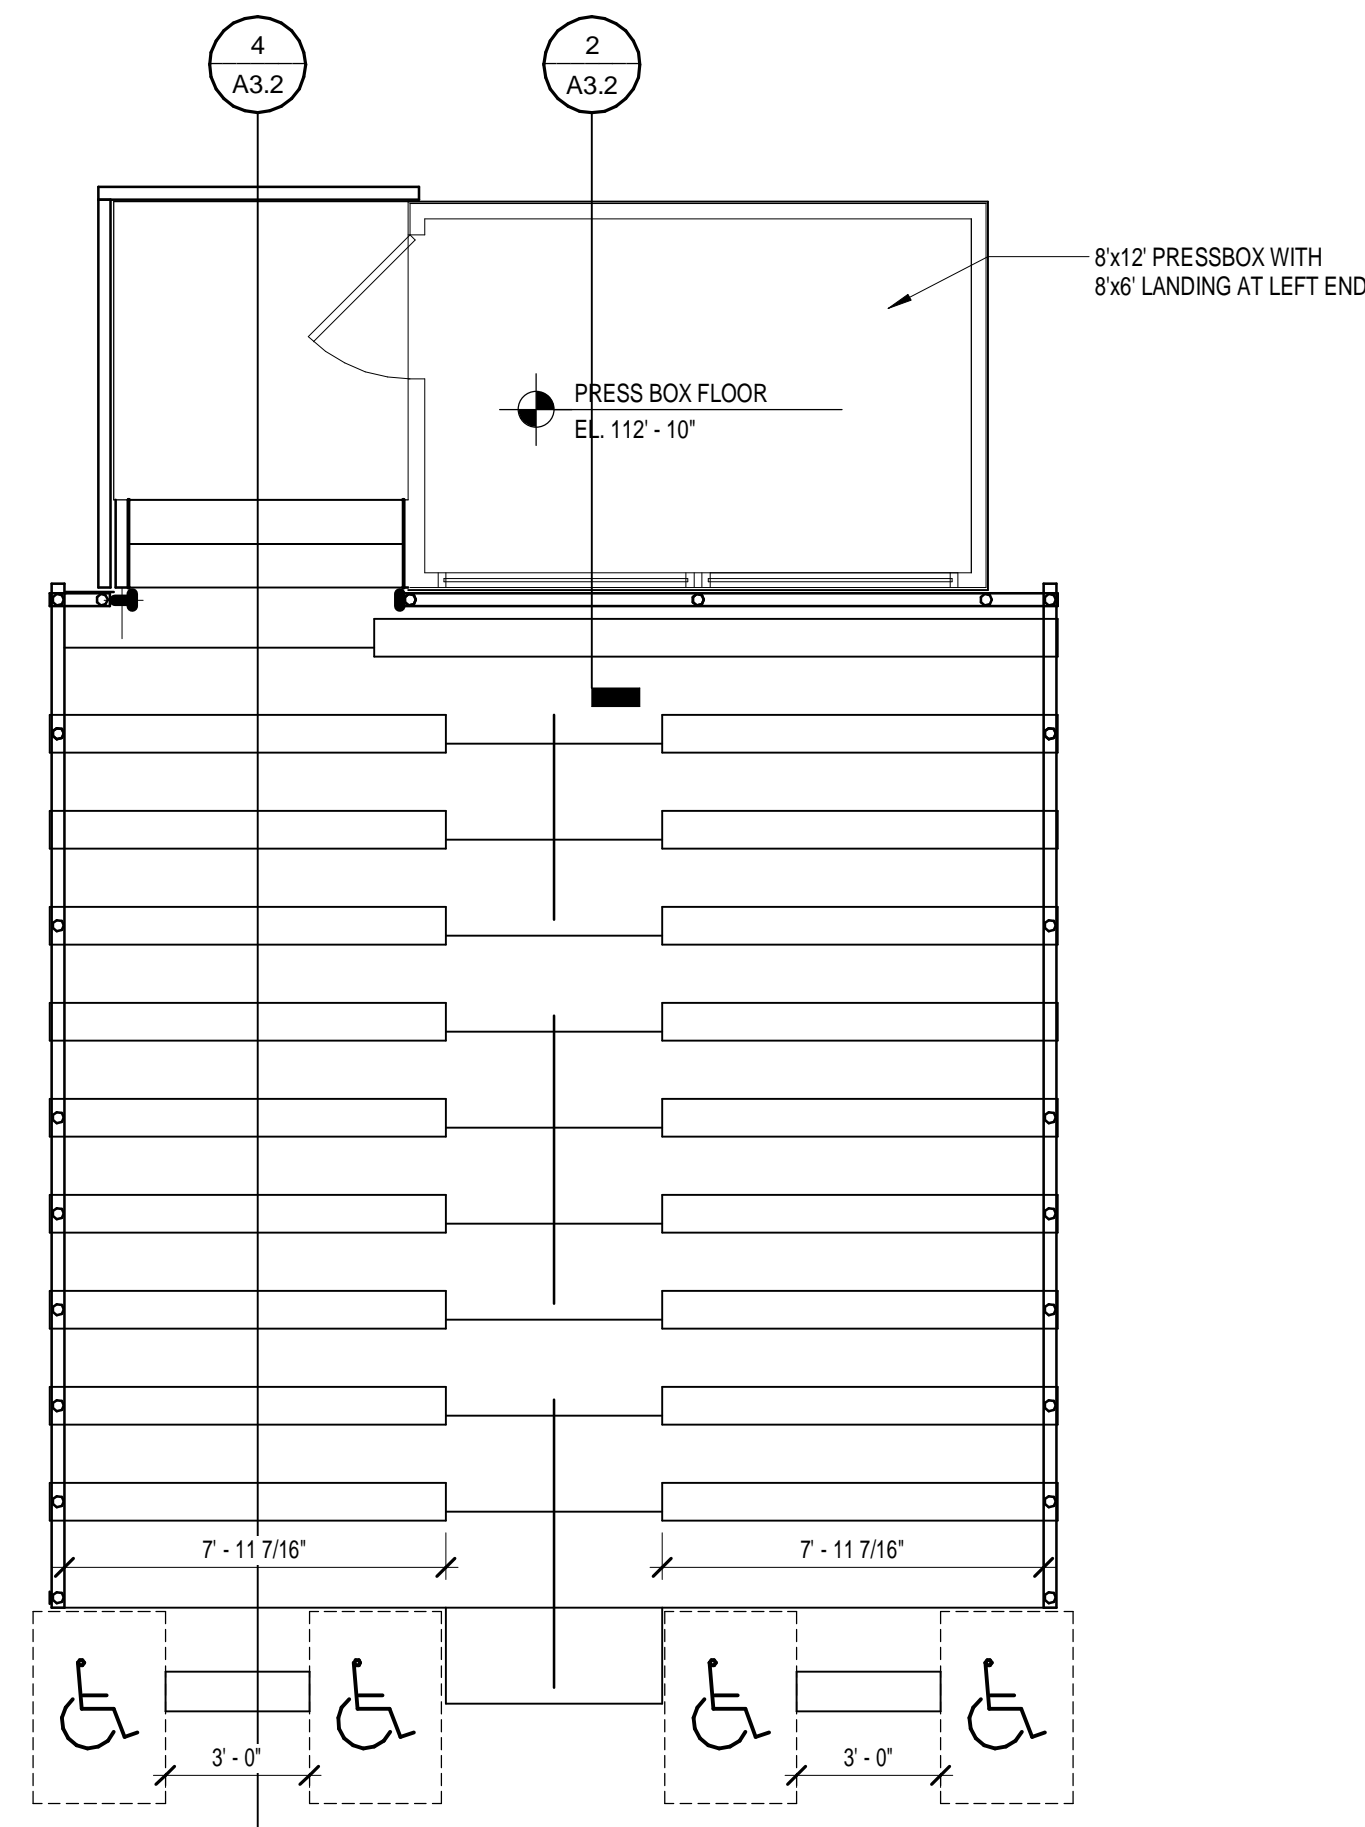

1 SOFTBALL BLEACHER PLAN
1/4" = 1'-0"

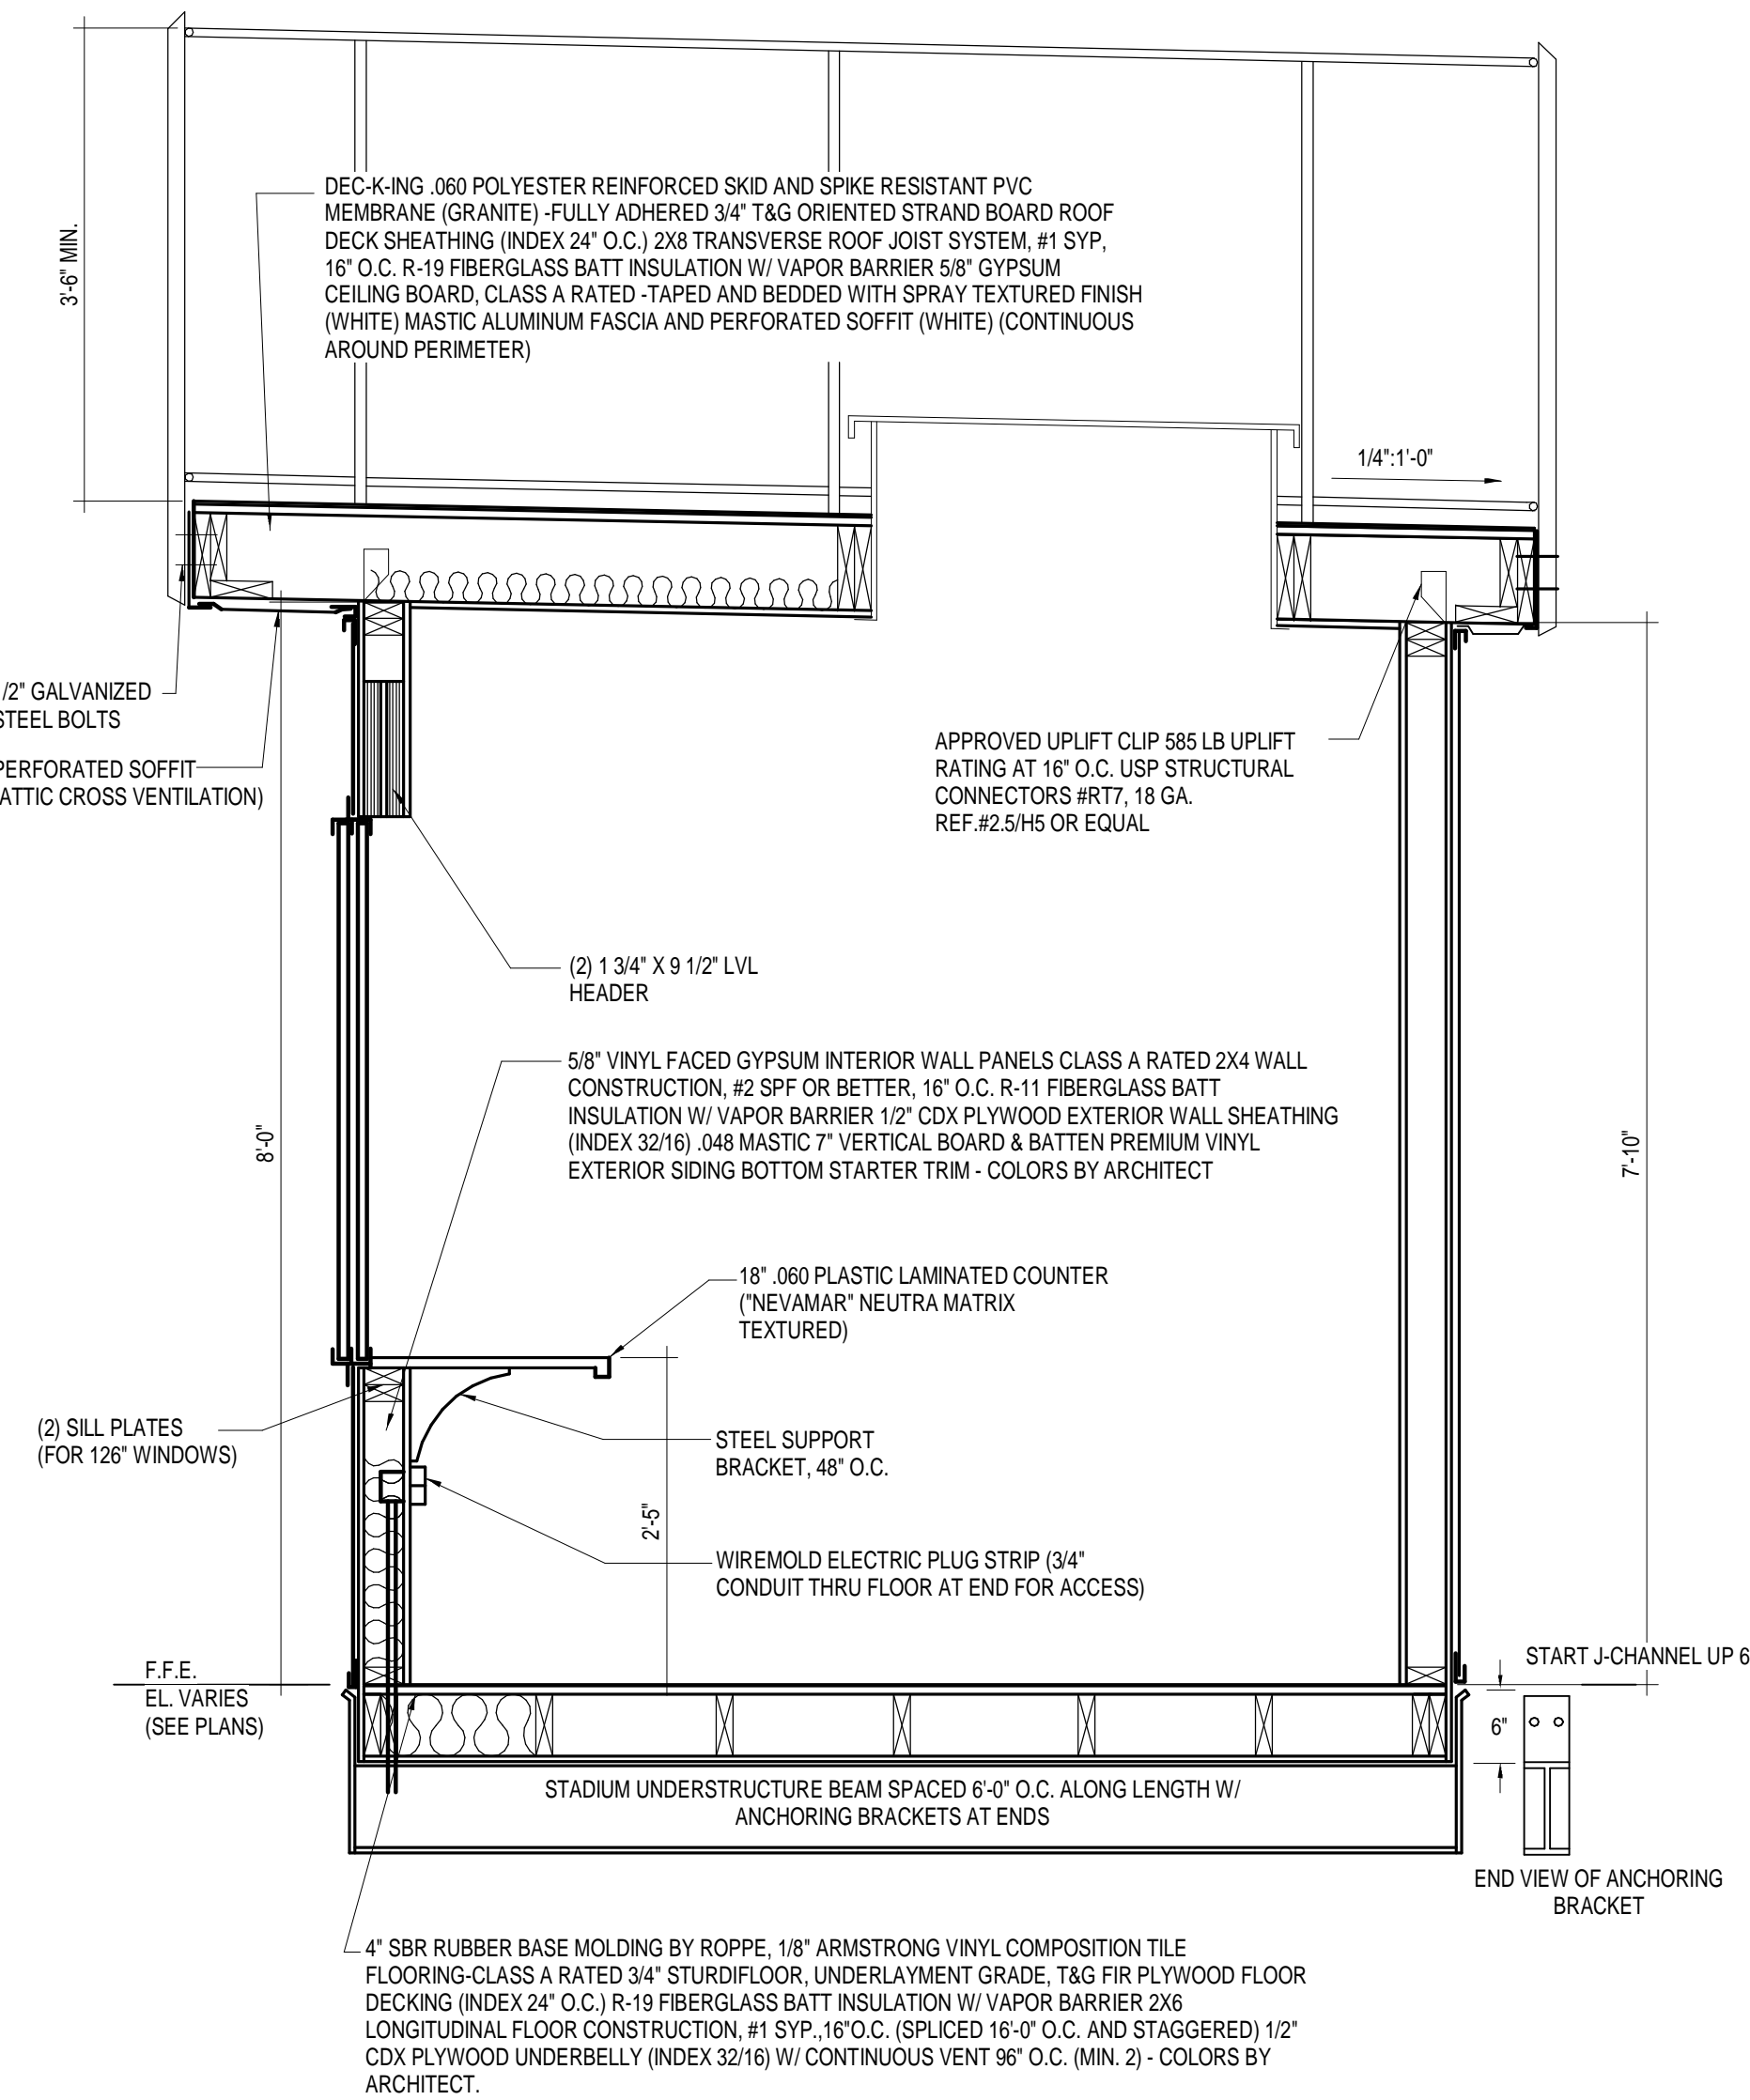

2 PRESS BOX SECTION
3/4" = 1'-0"

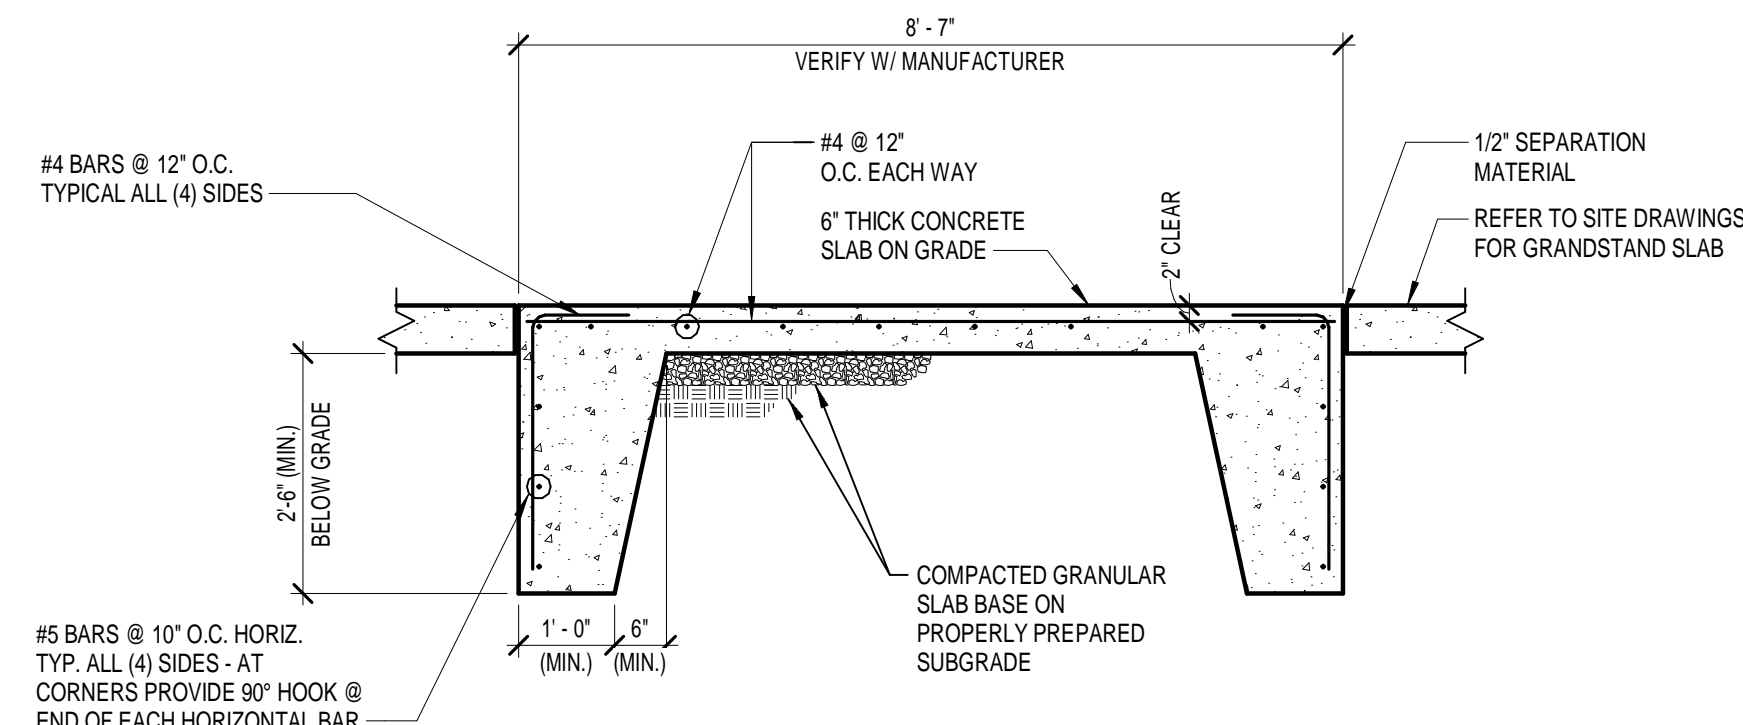

3 PRESS BOX SLAB DETAIL
1/2" = 1'-0"

JOB NO.	1744, BG#17-236
DATE	APR 23, 2018
DRAWN	Author
CHECKED	Checker

COPYRIGHT © 2018
SHERMAN CARTER BARNHART
ARCHITECTS, PLLC

REVISIONS		
No.	Description	Date

SHEET