





April 2020 in Review

May 28, 2020


April 2020 Temperature Ranks

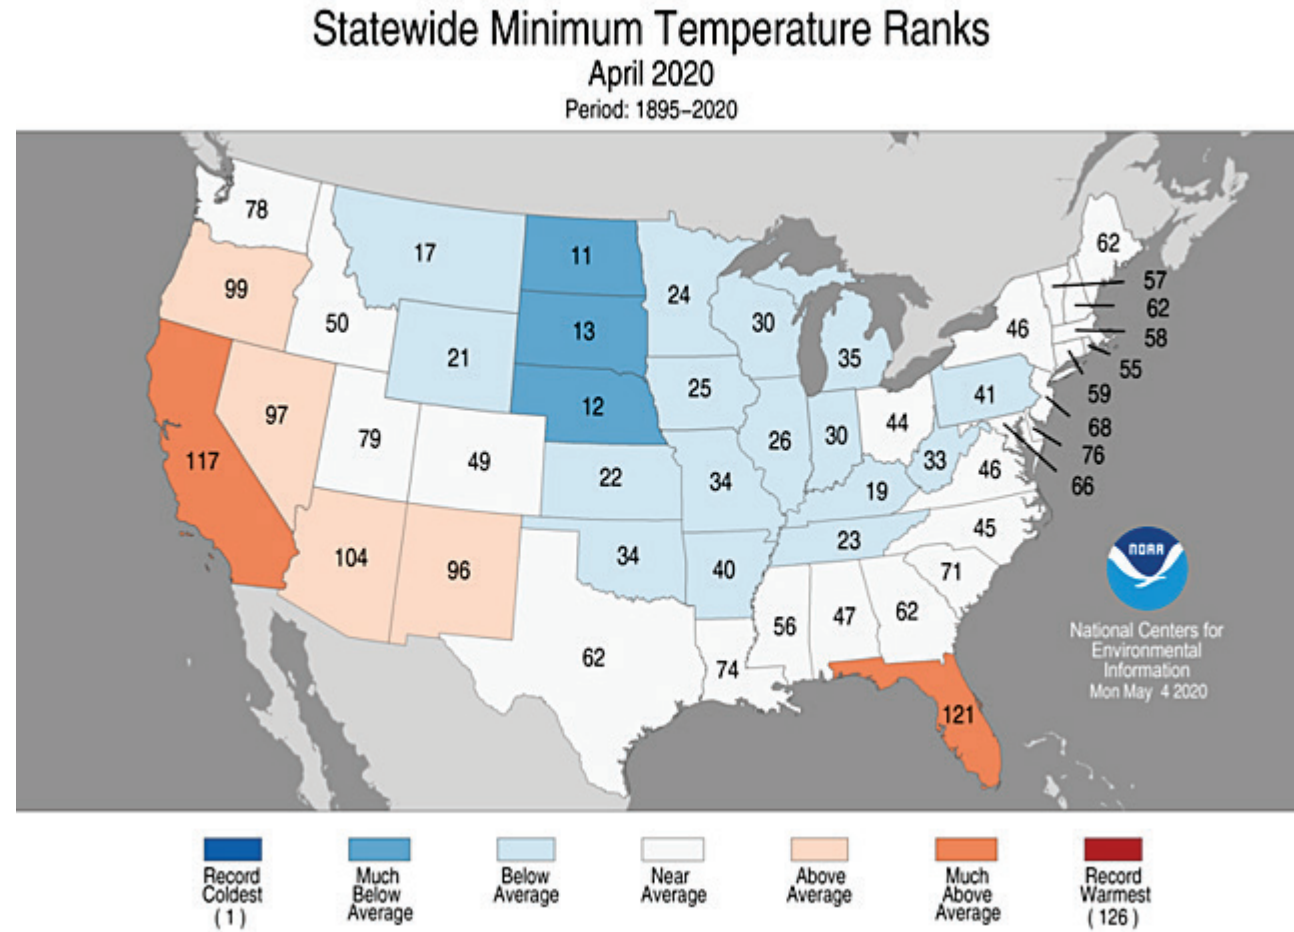

April 2020 AR Load

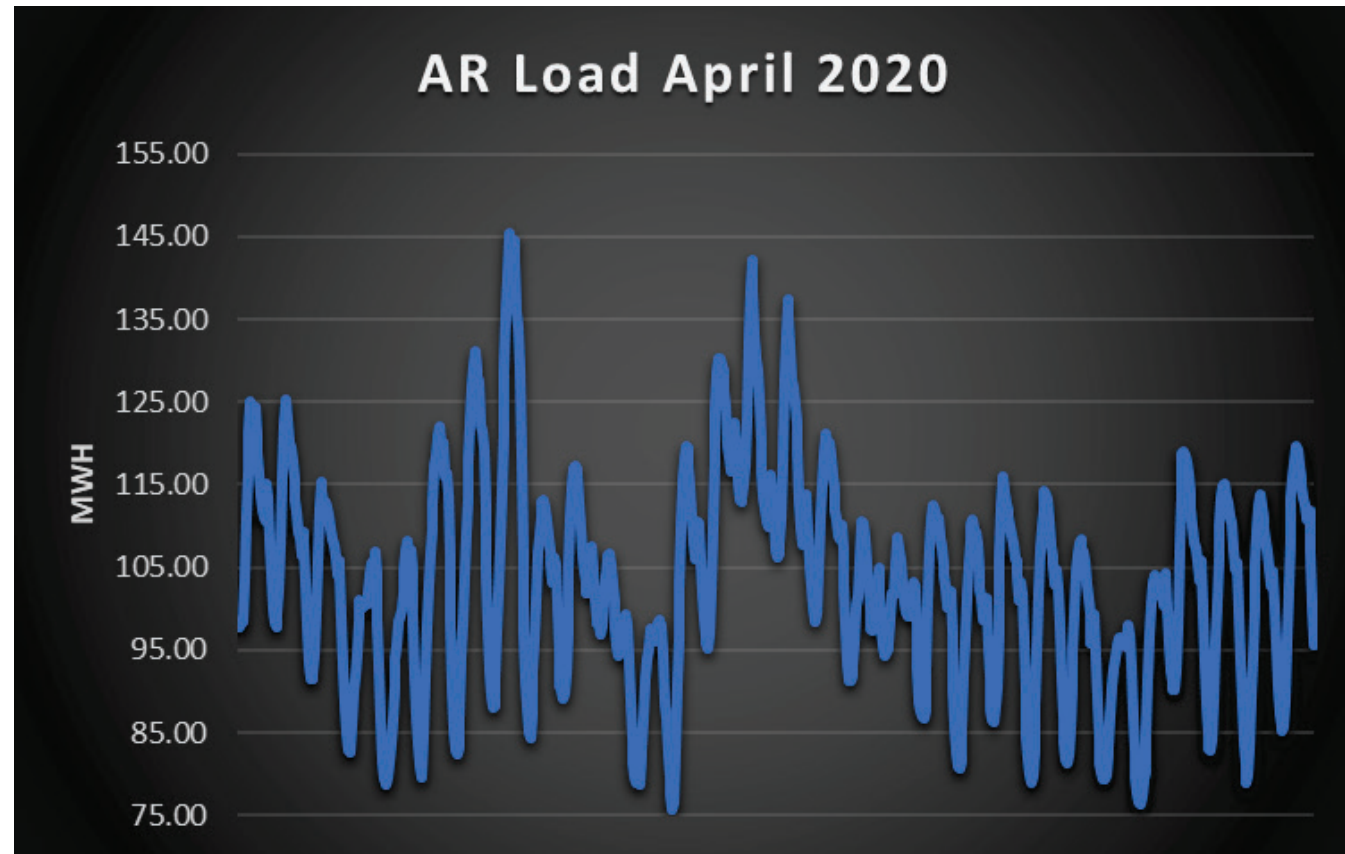


April 2020 Non-AR Load

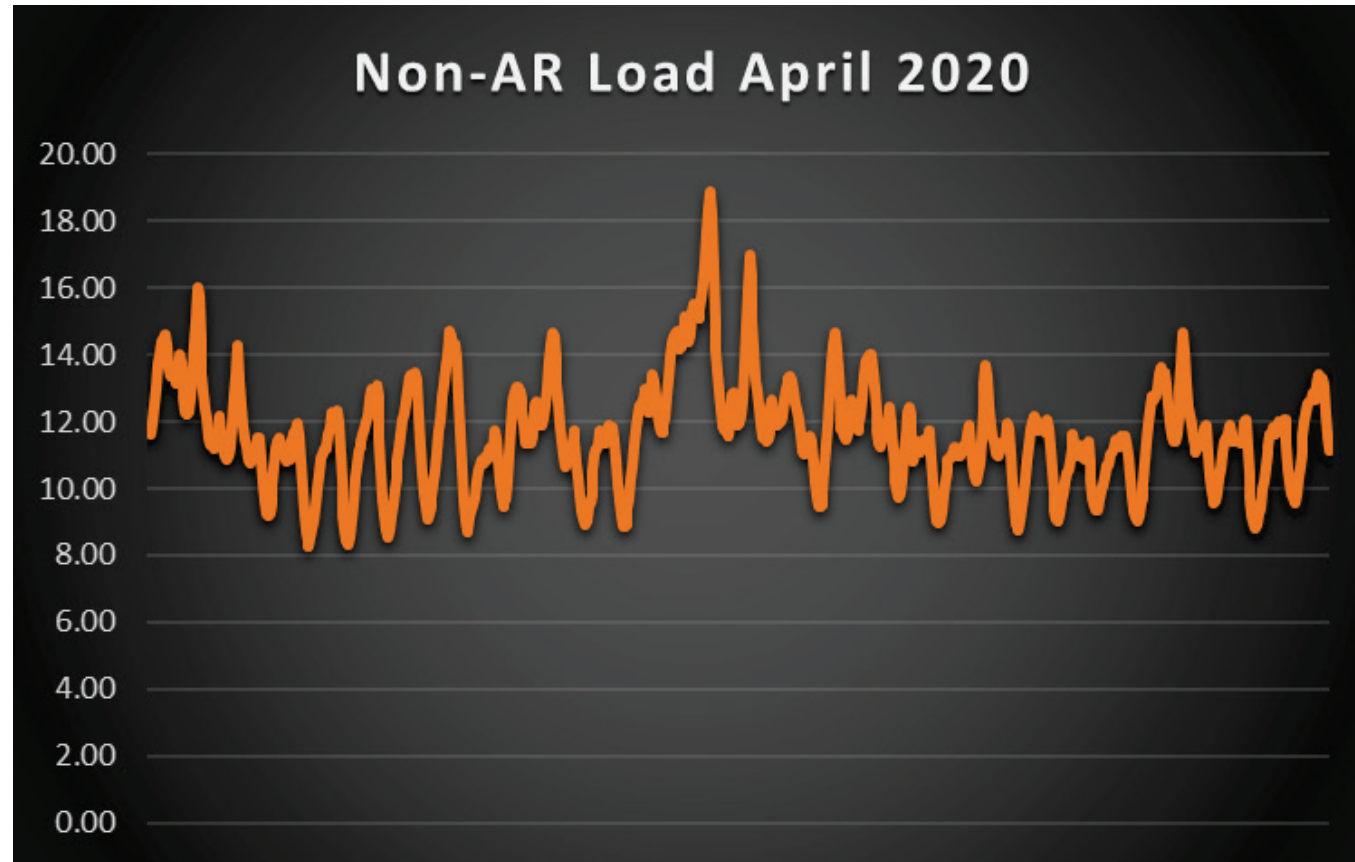


April 2020 Snapshot

Apr-20							
Member	Budget Energy (MWh)	Actual Energy (MWh)	Actual vs. Budget Energy	Budget NCP (MW)	Actual NCP (MW)	Actual vs. Budget NCP	Timestamp (HE EST)
Barbourville	6,594	5,567	84%	13.63	10.54	77%	4/15/2020 8:00 AM
Bardwell	570	528	93%	1.24	1.19	96%	4/8/2020 5:00 PM
Benham	386	409	106%	1.19	1.11	93%	4/15/2020 6:00 AM
Berea	8,472	7,973	94%	17.68	17.77	101%	4/15/2020 7:00 AM
Corbin	6,240	5,183	83%	13.48	10.21	76%	4/15/2020 8:00 AM
Falmouth	1,341	1,210	90%	2.60	2.28	88%	4/8/2020 4:00 PM
Frankfort	52,722	39,226	74%	101.37	78.23	77%	4/15/2020 8:00 AM
Madisonville	23,261	16,994	73%	46.47	36.81	79%	4/8/2020 4:00 PM
Owensboro	58,708	50,638	86%	117.00	109.00	93%	
Paris	3,973	3,887	98%	8.39	9.17	109%	4/15/2020 8:00 AM
Providence	2,080	1,821	88%	4.36	4.07	93%	4/8/2020 5:00 PM


BREC PPA Capacity Factor

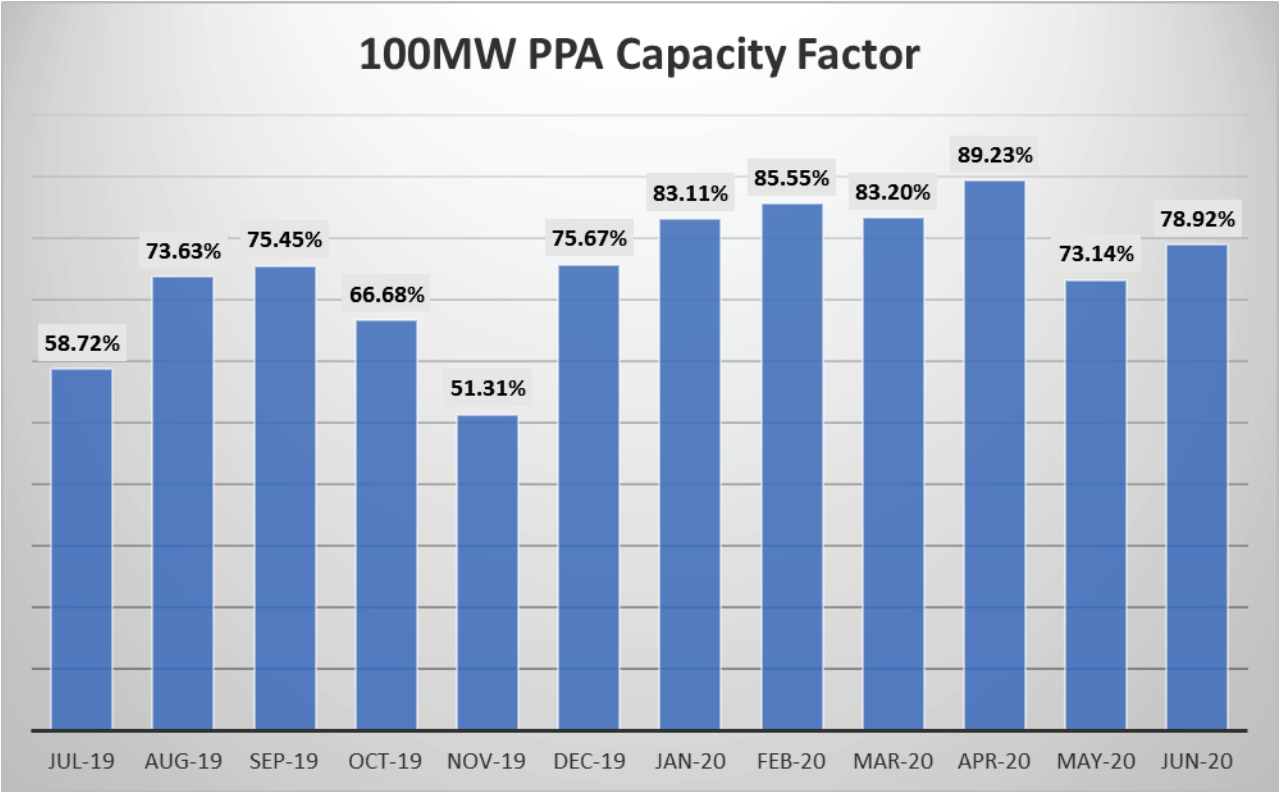


BREC Option Capacity Factor

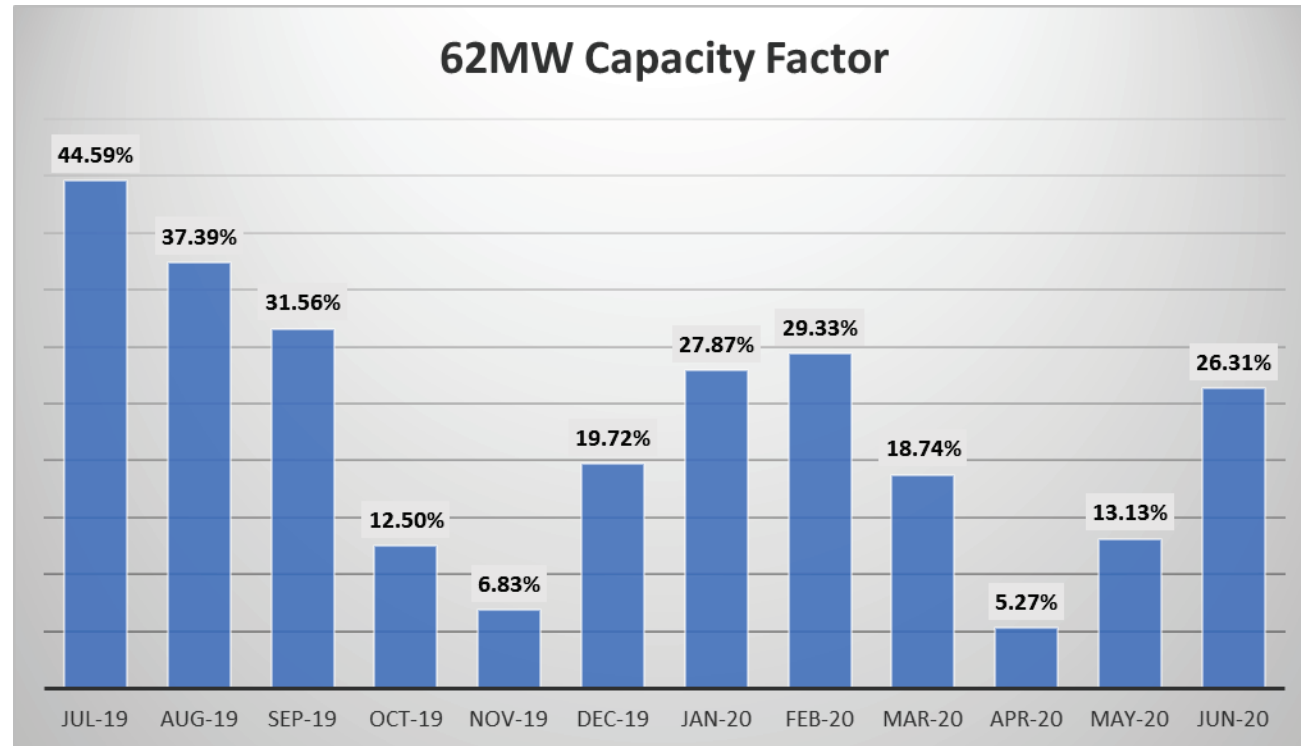


EEI/LGEE Capacity Factor

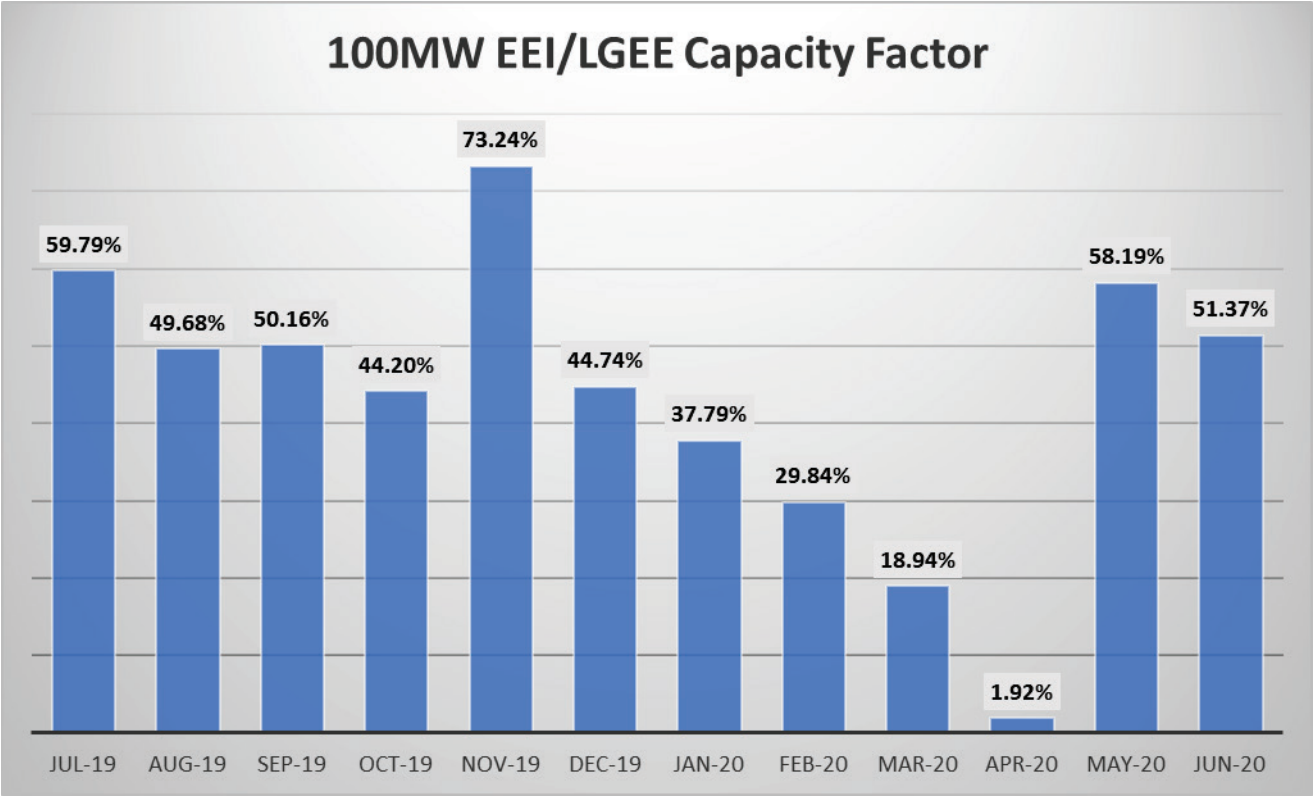

PPS PPA Capacity Factor

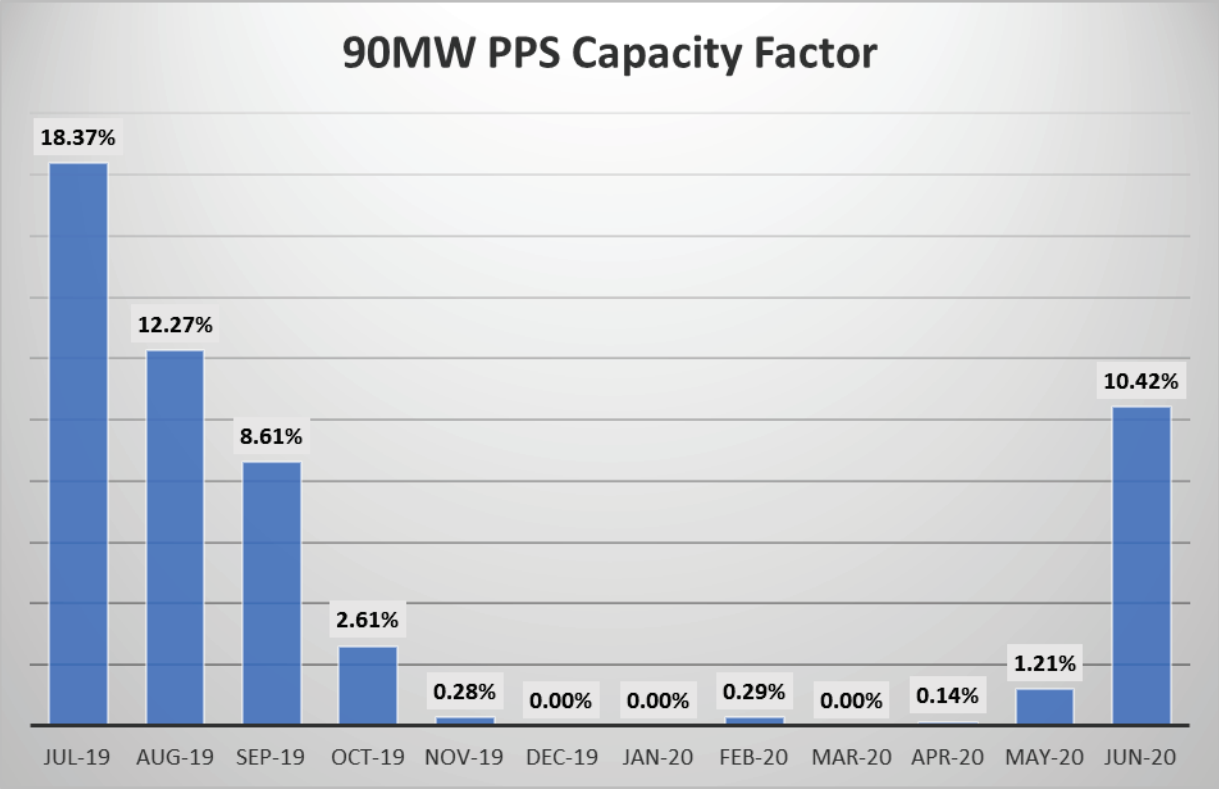


SEPA Capacity Factor

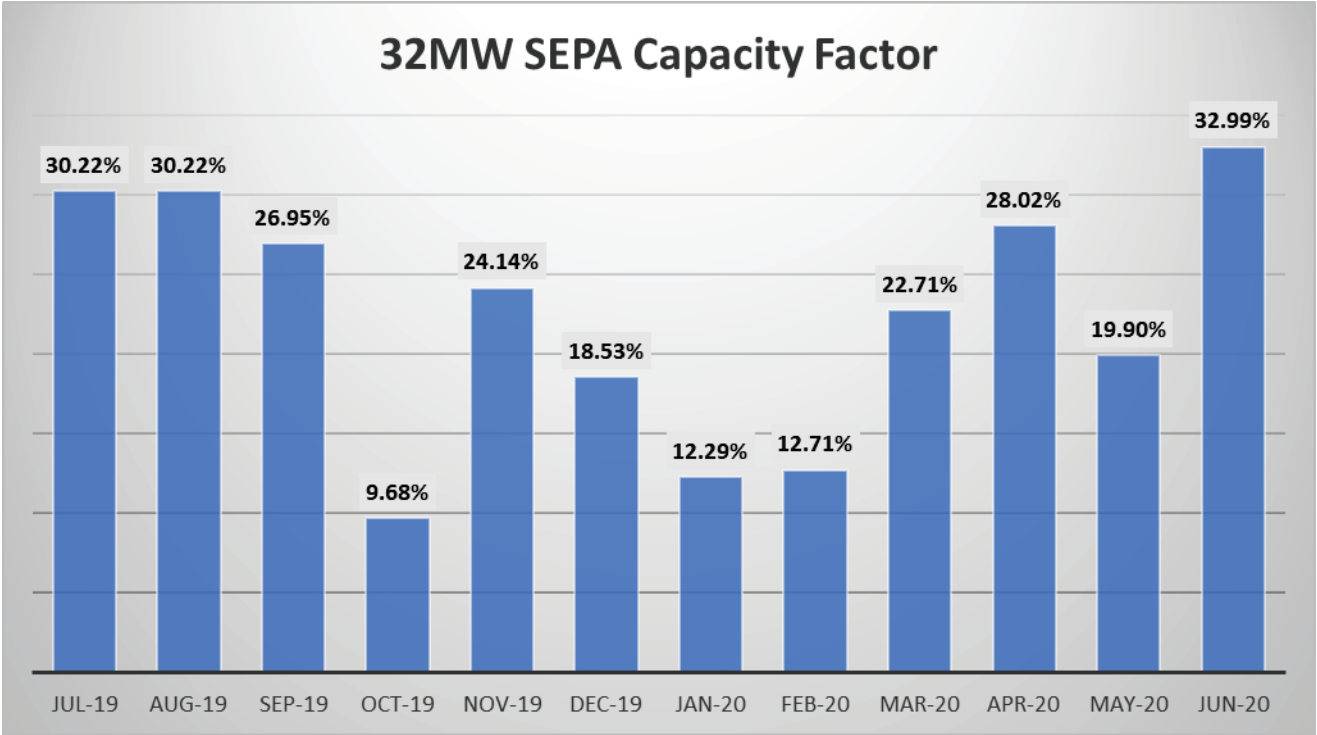

Working Gas in Storage


Working gas in underground storage compared with the 5-year maximum and minimum

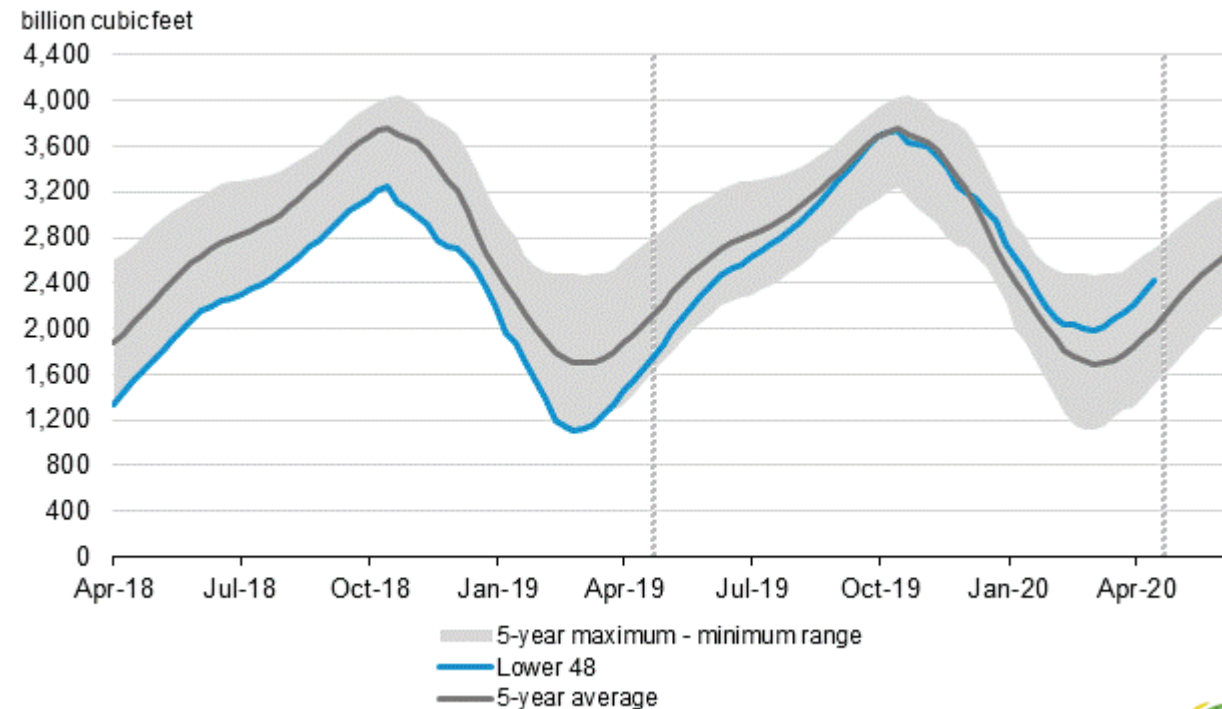

Source: U.S. Energy Information Administration



Indiana Hub

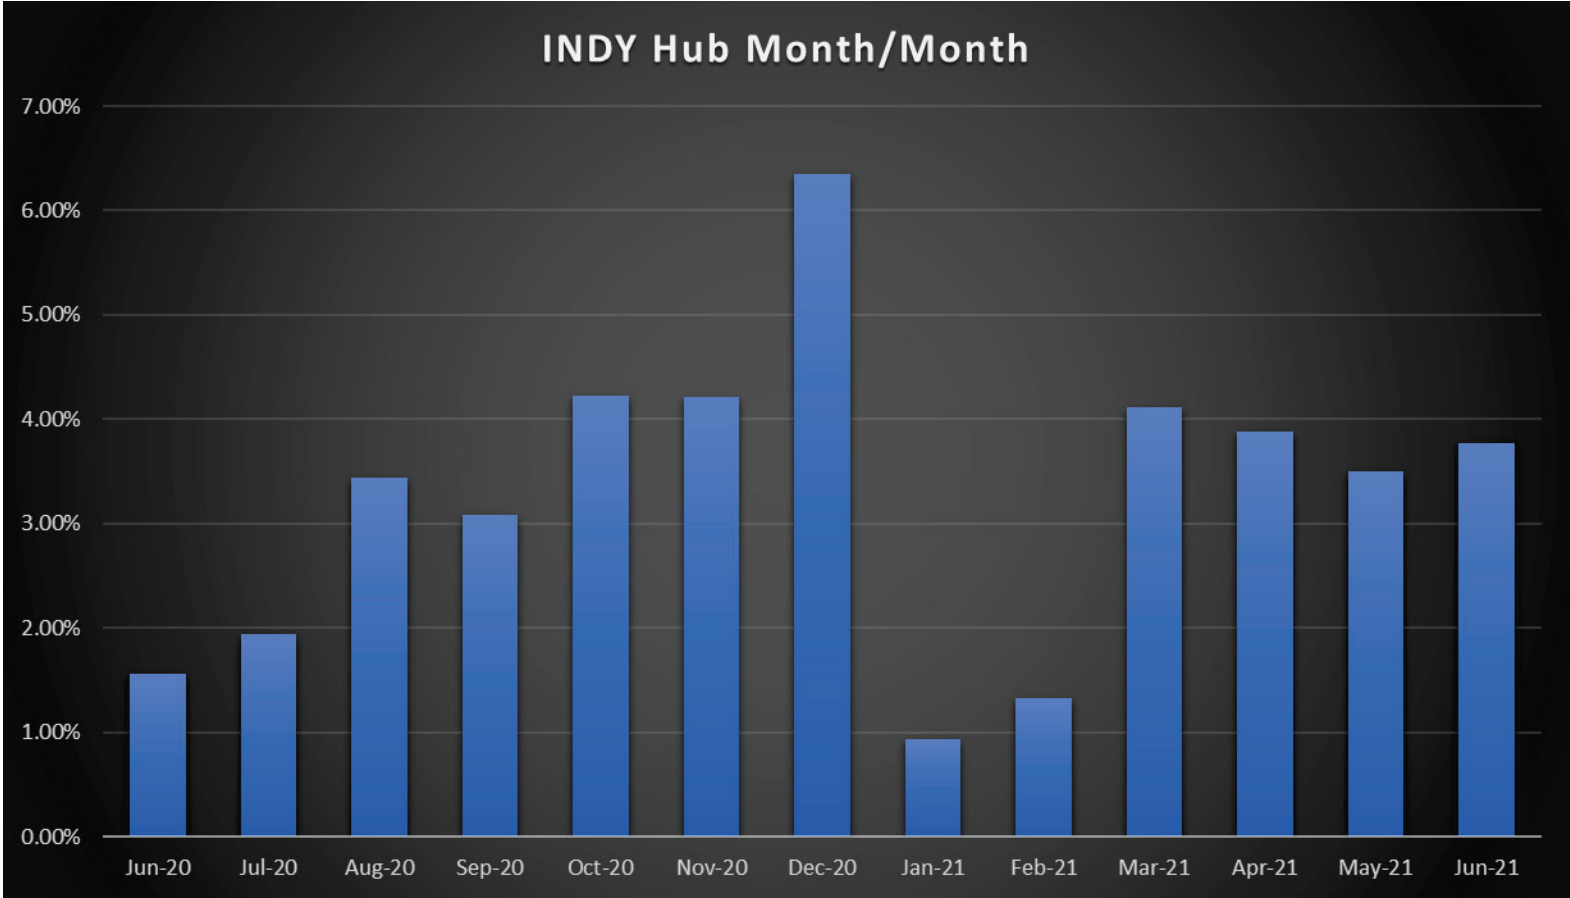

Henry Hub

