



KENTUCKY MUNICIPAL ENERGY AGENCY




July 2020 in Review

August 27, 2020

Statewide Average Temperature Ranks


July 2020

Period: 1895–2020

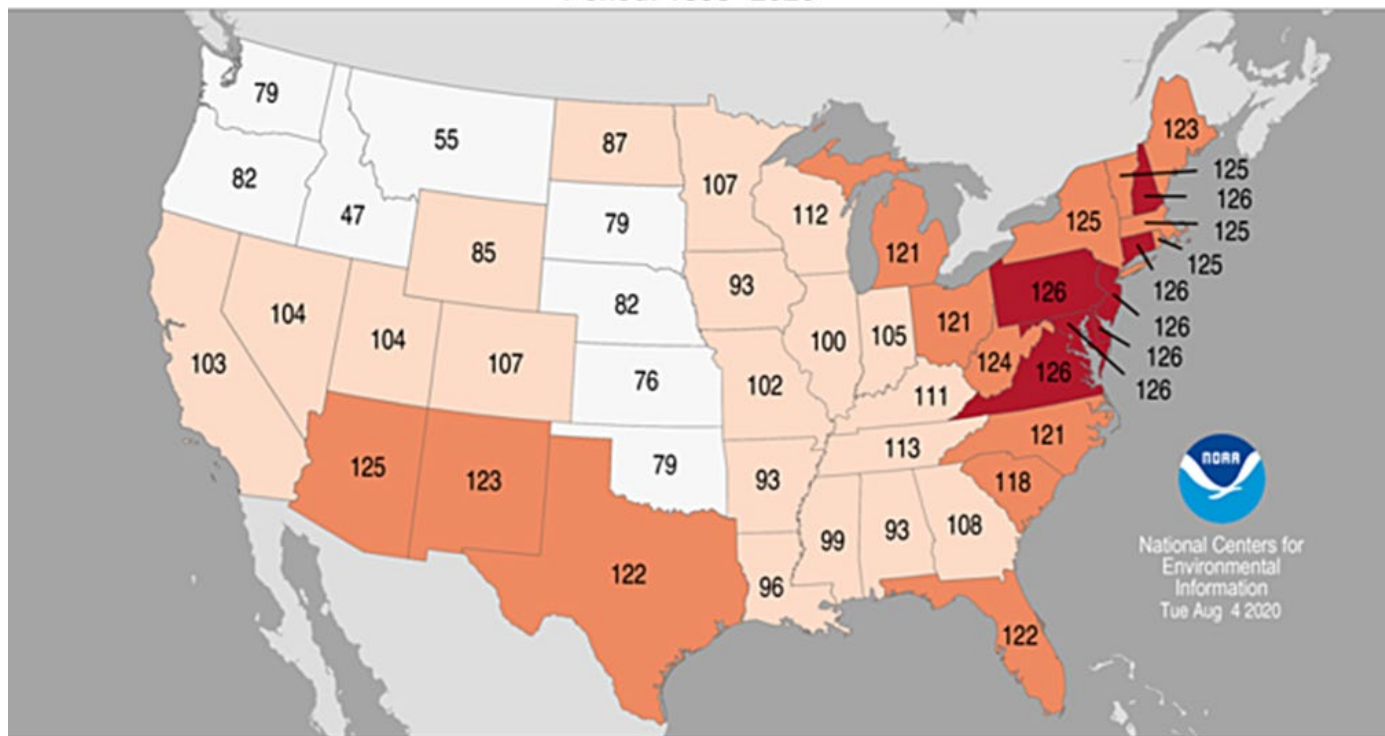


<https://www.ncdc.noaa.gov/temp-and-precip/us-maps/>

AR Load July 2020

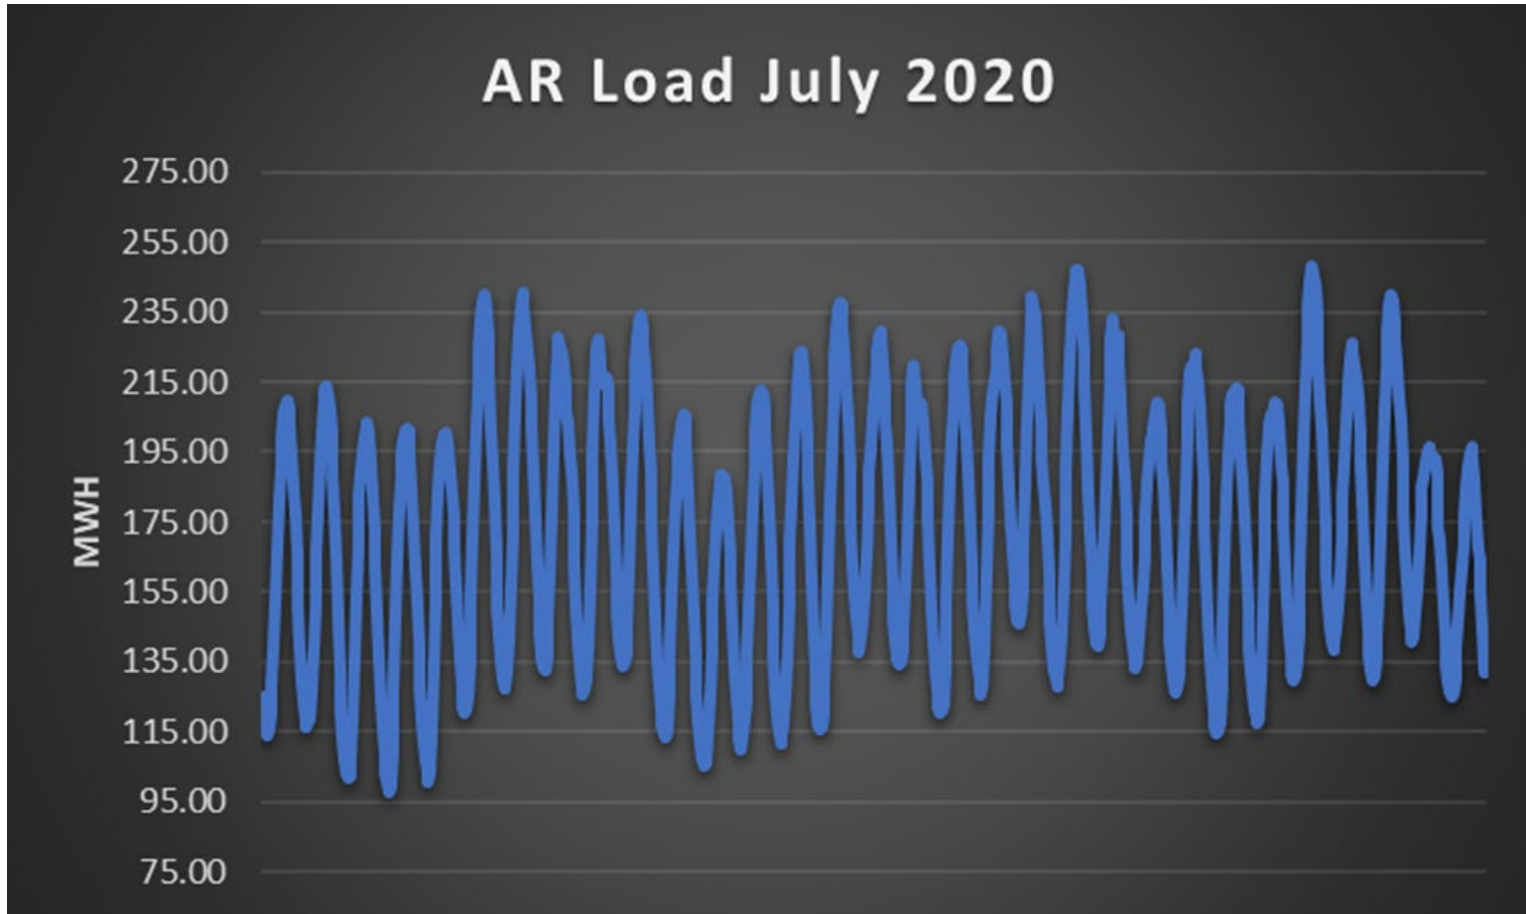


Non-AR Load July 2020

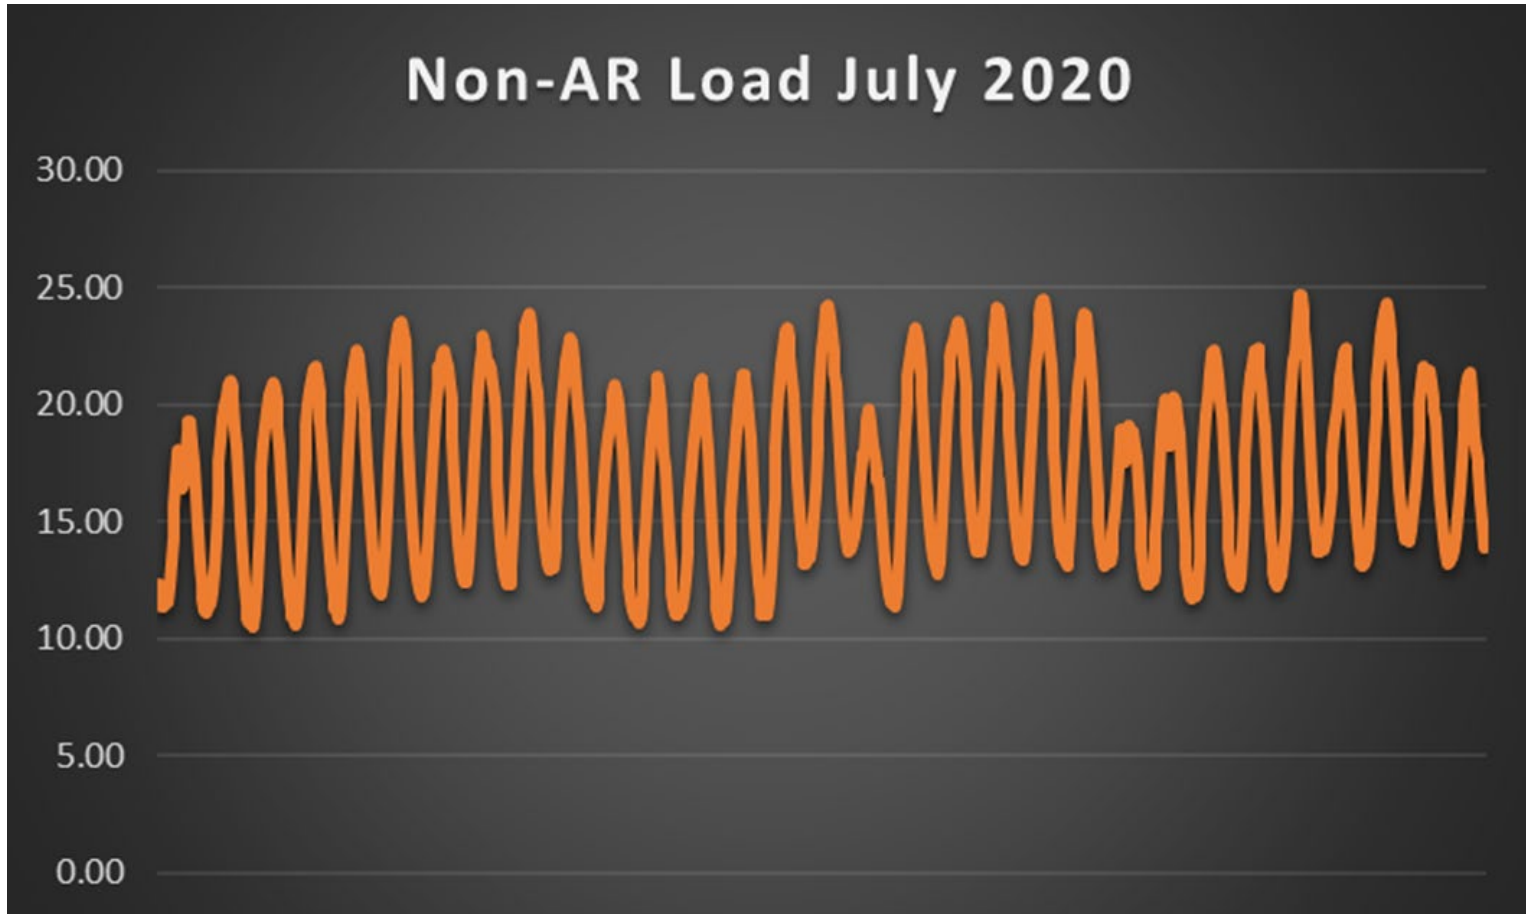


July 2020 Snapshot

Jul-20							
Member	Budget Energy (MWh)	Actual Energy (MWh)	Actual vs. Budget Energy	Budget NCP (MW)	Actual NCP (MW)	Actual vs. Budget NCP	Timestamp (HE EST)
Barbourville	9,444	8,915	94%	20.01	18.73	94%	7/20/2020 3:00 PM
Bardwell	1,086	1,023	94%	2.33	2.08	89%	7/20/2020 3:00 PM
Benham	498	469	94%	1.04	1.03	99%	7/21/2020 6:00 PM
Berea	14,254	12,254	86%	26.52	23.92	90%	7/27/2020 5:00 PM
Corbin	9,699	9,036	93%	20.38	18.47	91%	7/21/2020 3:00 PM
Falmouth	2,161	2,166	100%	4.31	4.40	102%	7/20/2020 4:00 PM
Frankfort	73,574	67,681	92%	147.80	129.16	87%	7/27/2020 3:00 PM
Madisonville	33,246	29,253	88%	64.90	56.35	87%	7/27/2020 3:00 PM
Owensboro	87,853	90,217	103%	178.00	171.00	96%	
Paris	6,186	7,277	118%	12.54	15.28	122%	7/27/2020 4:00 PM
Providence	3,405	3,333	98%	6.96	6.70	96%	7/7/2020 5:00 PM
AR	138,802	128,683	93%	279.23	251.18	90%	
Non-AR	14,752	12,724	86%	27.56	24.95	91%	
All	153,554	141,407	92%	306.79	276.13	90%	
Total	241,407	231,624	96%	484.79	447.13	92%	


BREC PPA Capacity Factor

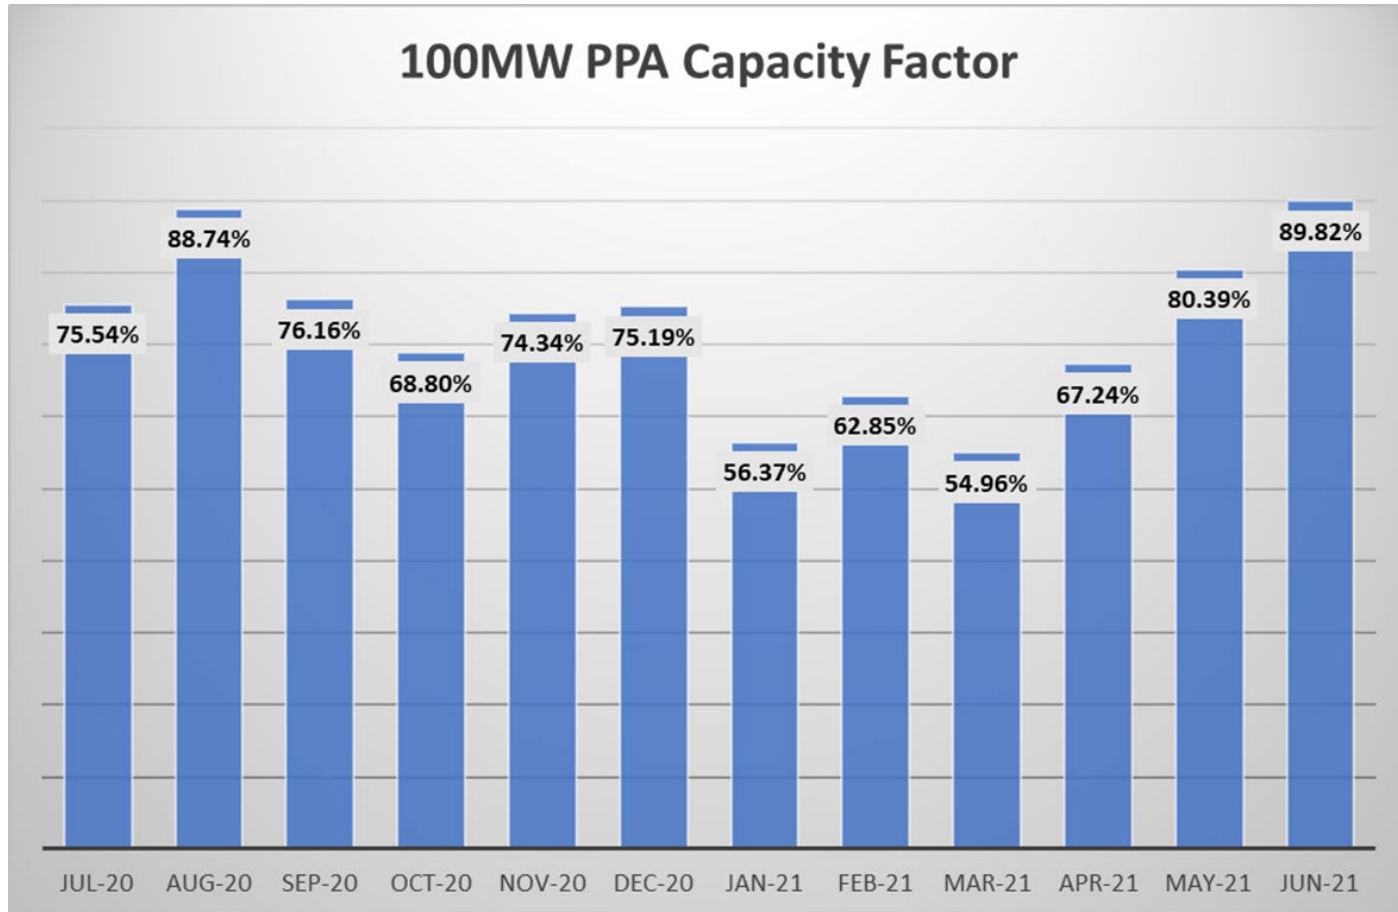


BREC Option Capacity Factor

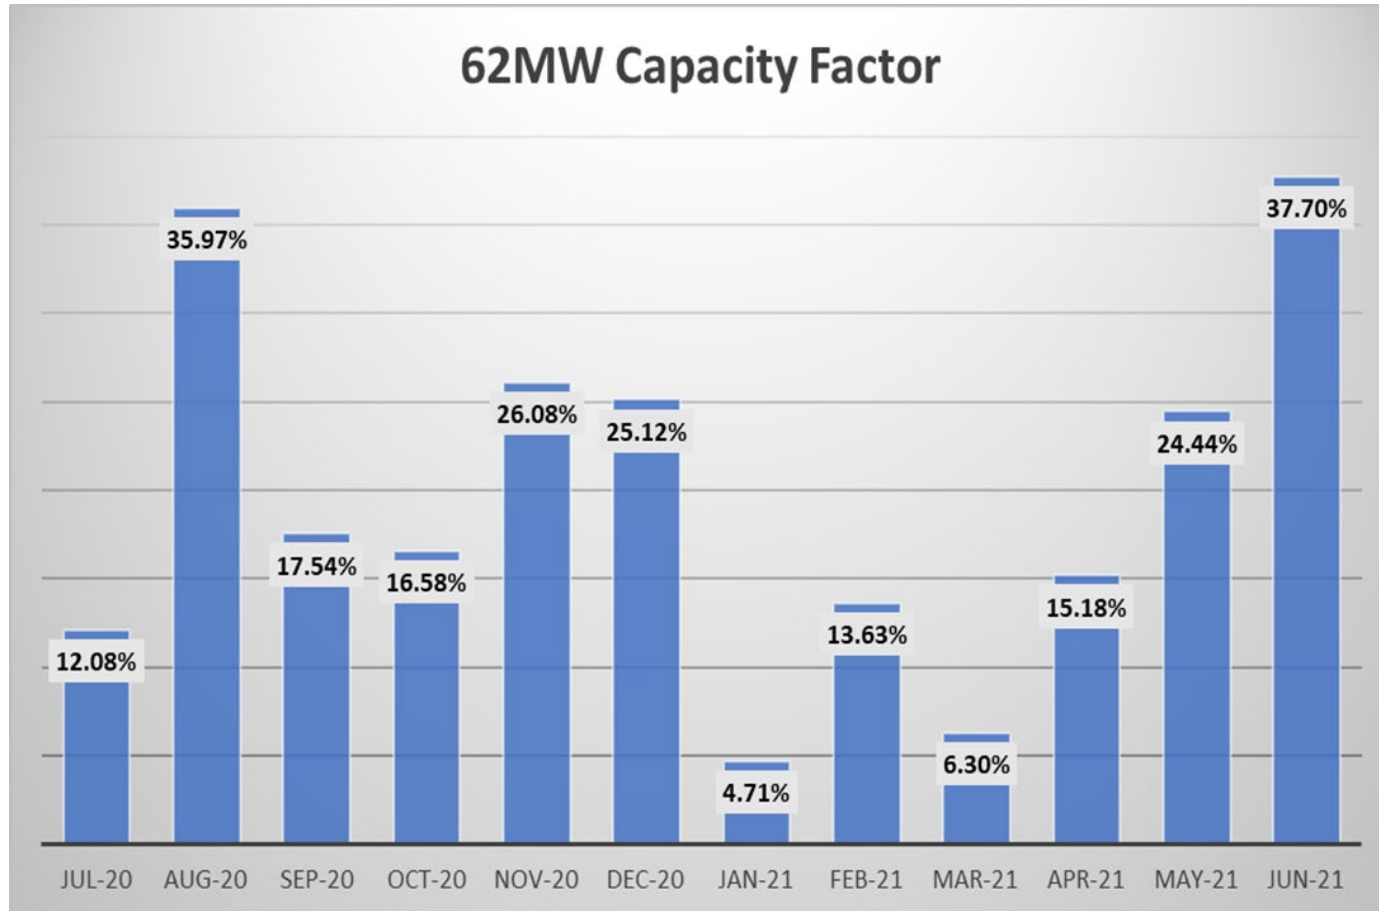


EEI/LGEE Capacity Factor

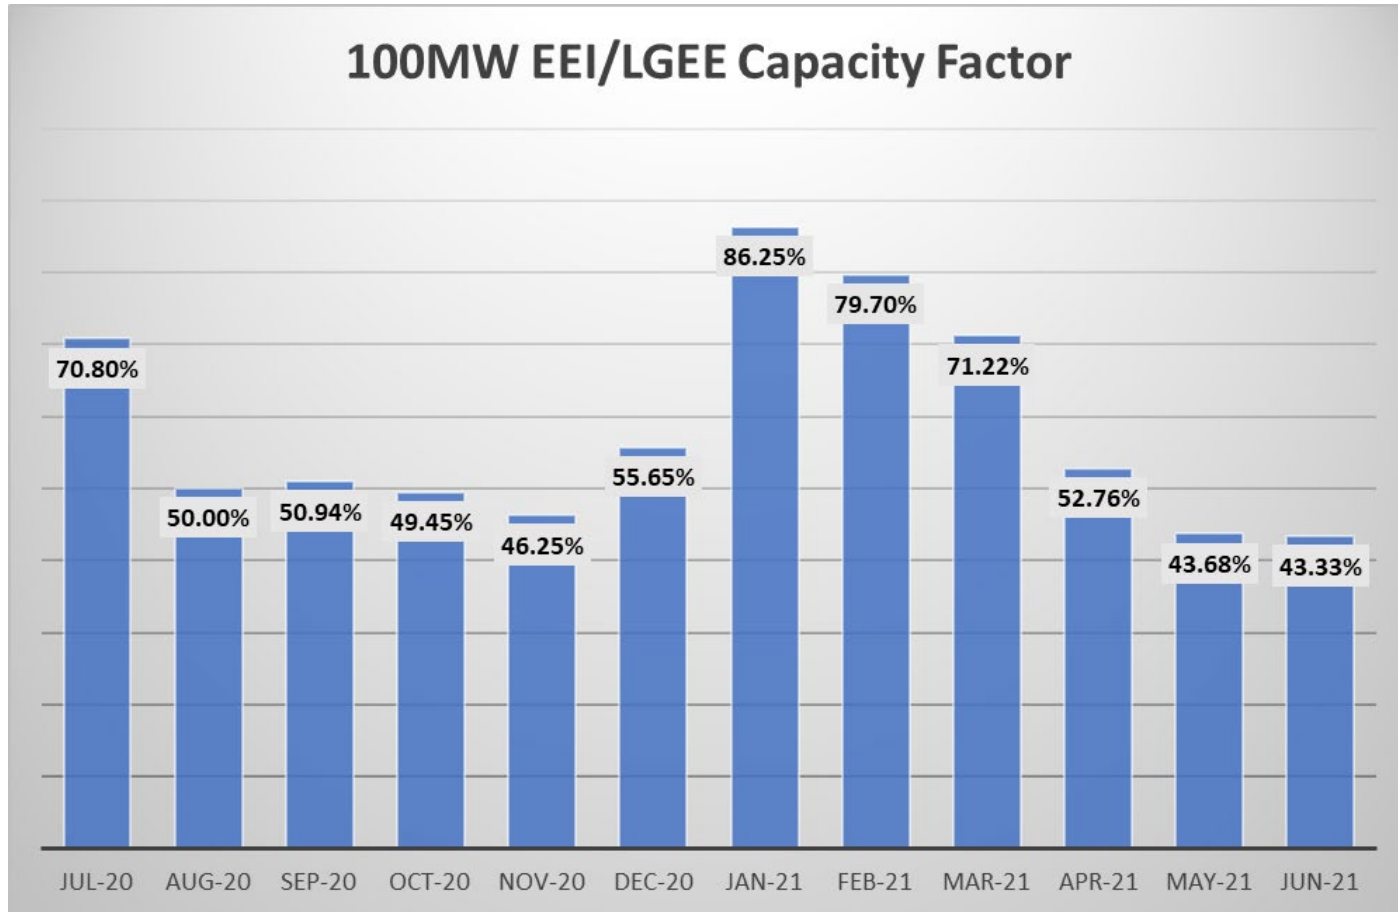

PPS PPA Capacity Factor

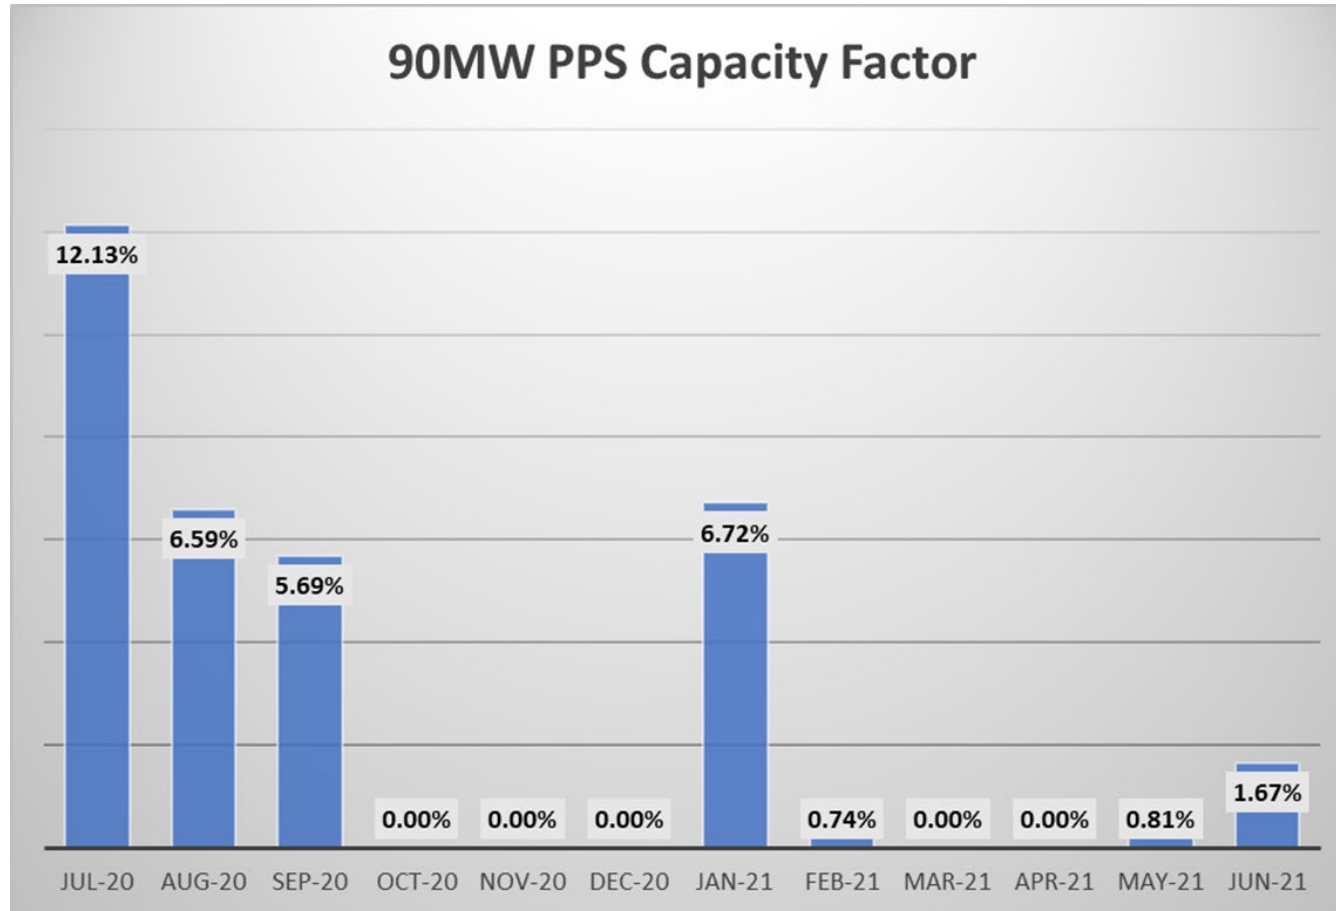


SEPA Capacity Factor

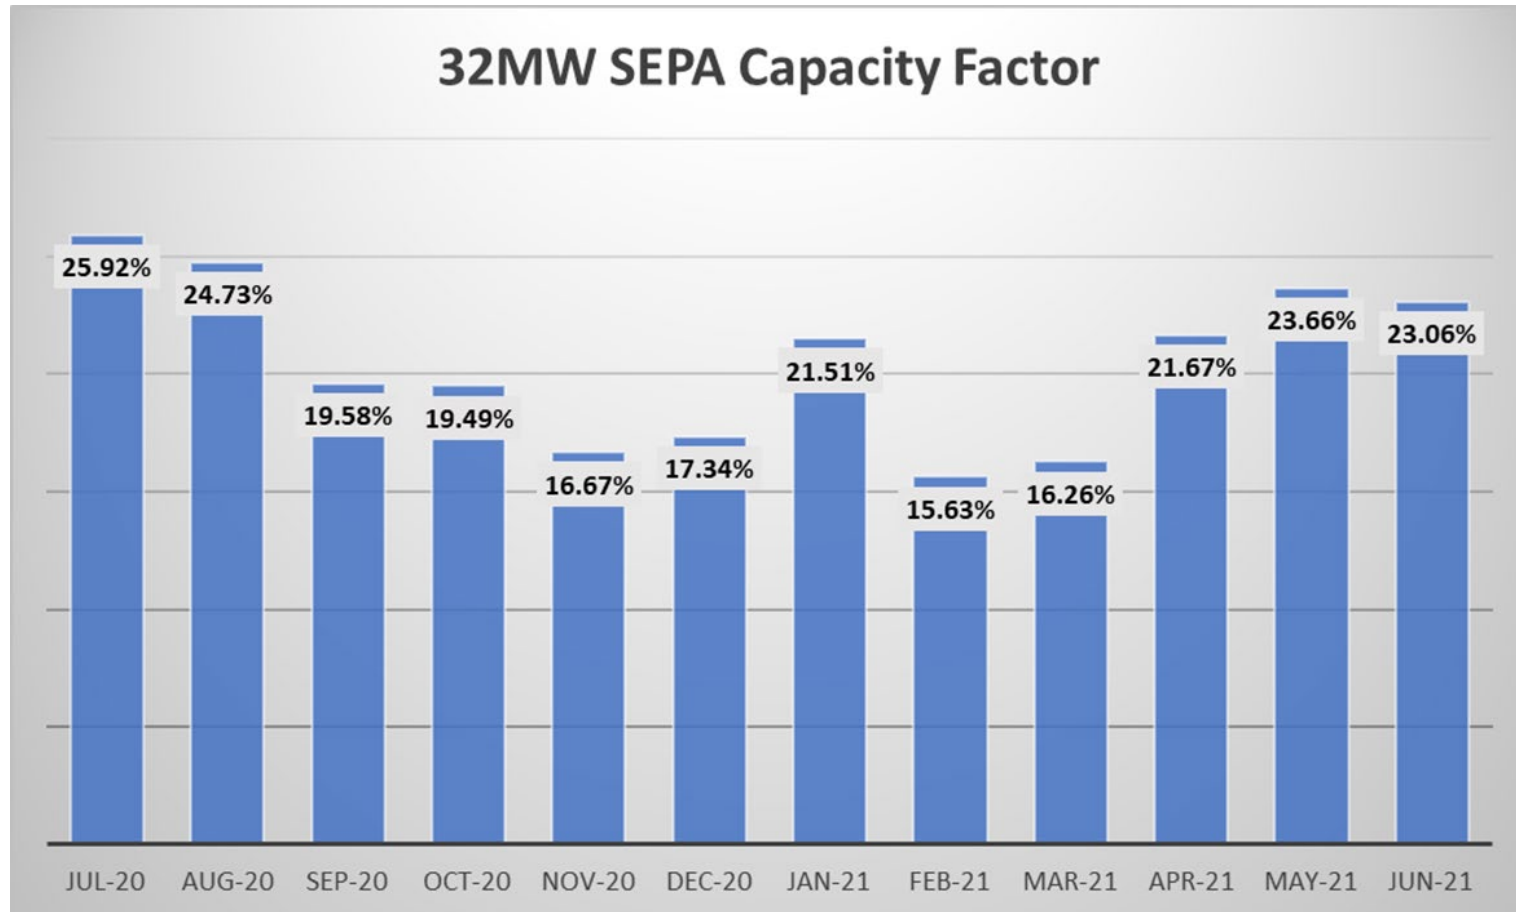

Working Gas in Storage


Working gas in underground storage compared with the 5-year maximum and minimum

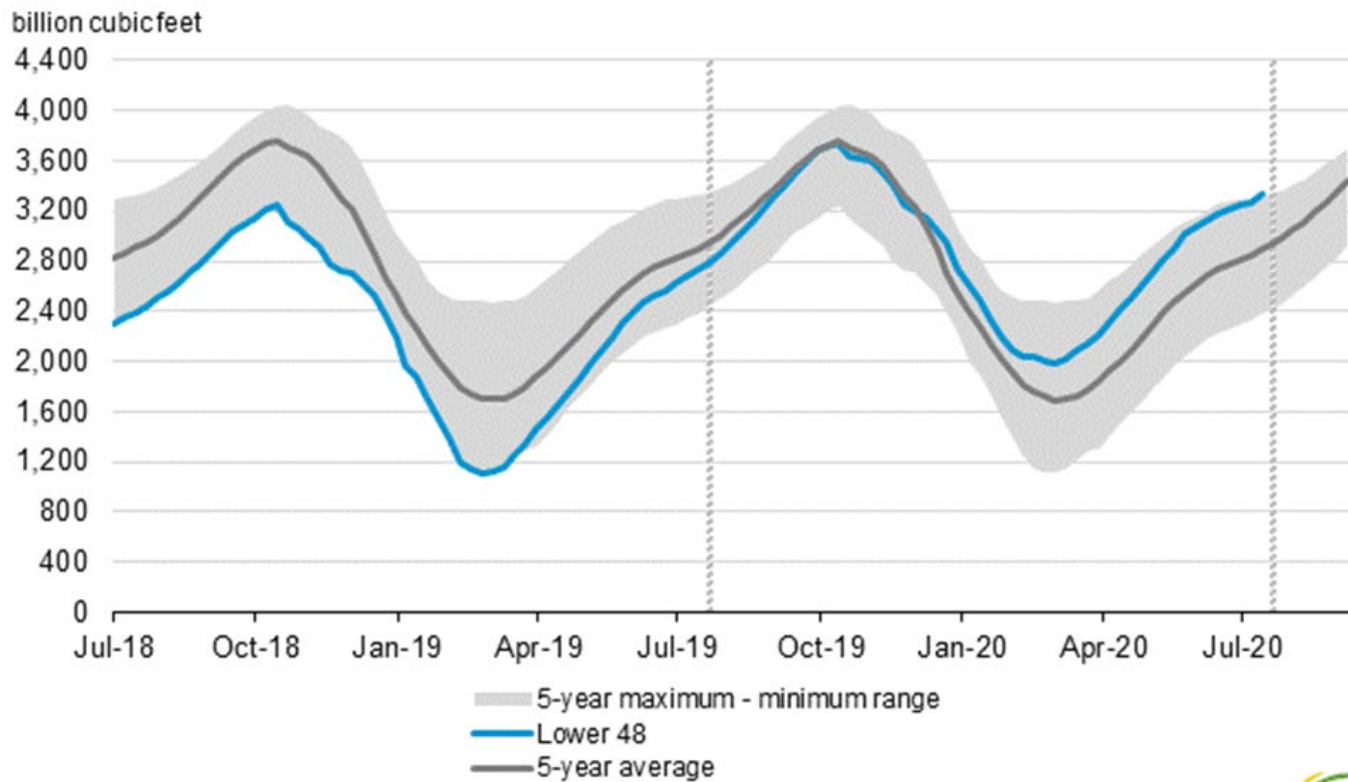

Source: U.S. Energy Information Administration



Indiana Hub ATC

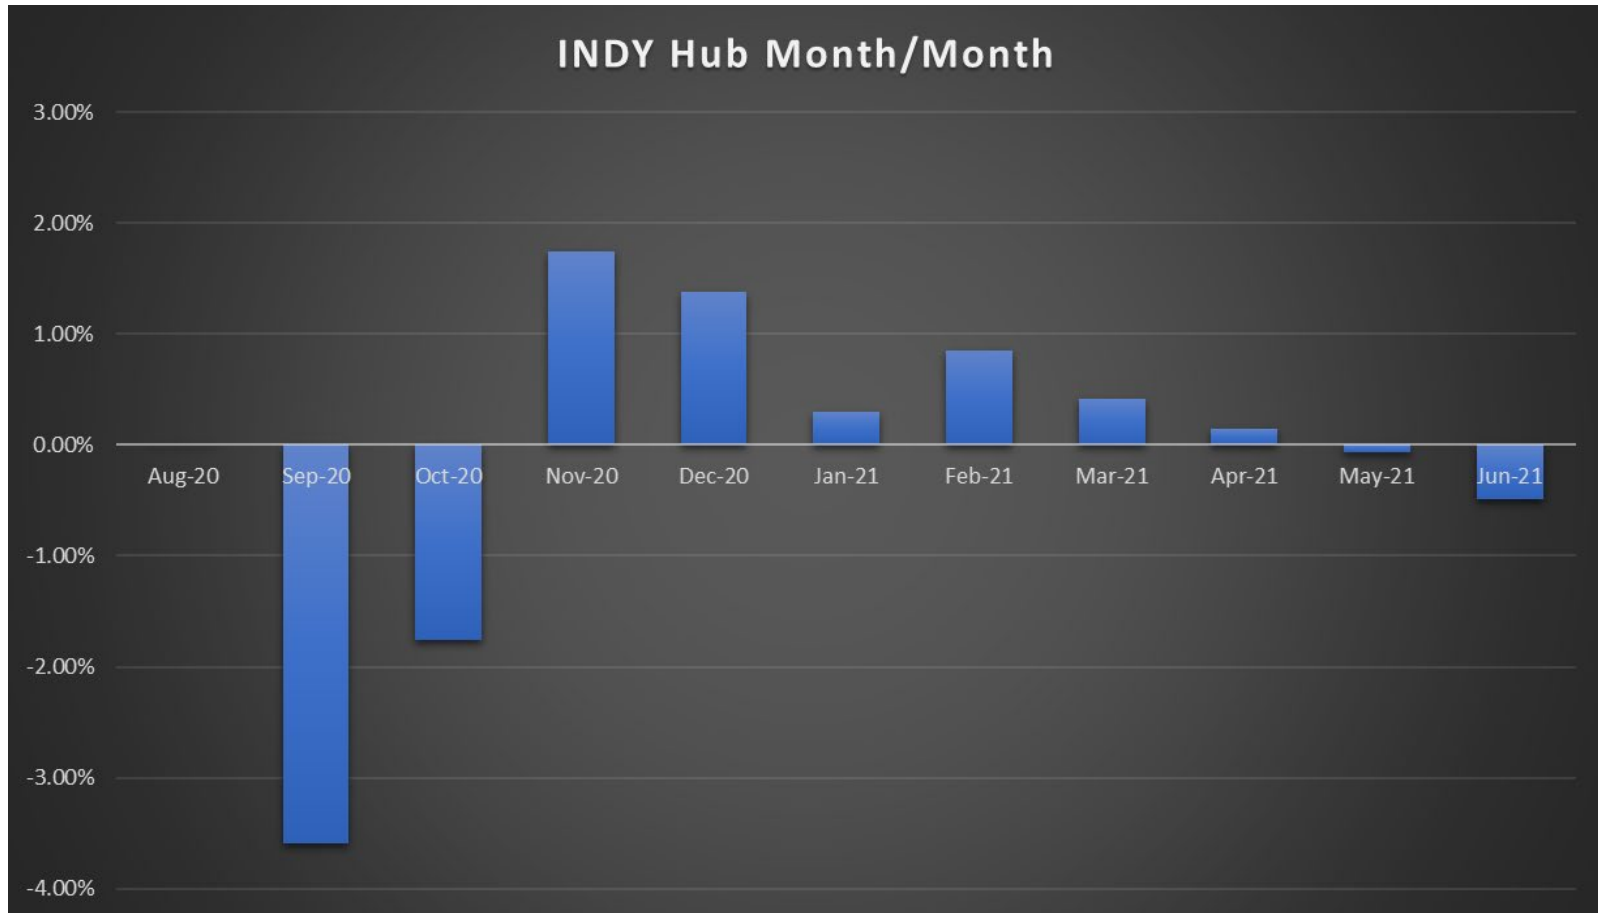

Tetco M1 30"

